

Correction

Correction: Antonijević, M.; Sučić, S.; Keserica, H. Augmented Reality Applications for Substation Management by Utilizing Standards-Compliant SCADA Communication. *Energies* 2018, 11, 599

Miro Antonijević *, Stjepan Sučić and Hrvoje Keserica

Končar-Power Plant and Electric Traction Engineering Inc., Fallerovo 22, 10000 Zagreb, Croatia; stjepan.sucic@koncar-ket.hr (S.S.); hrvoje.keserica@koncar-ket.hr (H.K.)

* Correspondence: miro.antonijevic@koncar-ket.hr

Received: 30 August 2018; Accepted: 31 August 2018; Published: 10 September 2018



The authors wish to make the following corrections to their paper [1]:
On page 15, Figure 15 should be changed from:

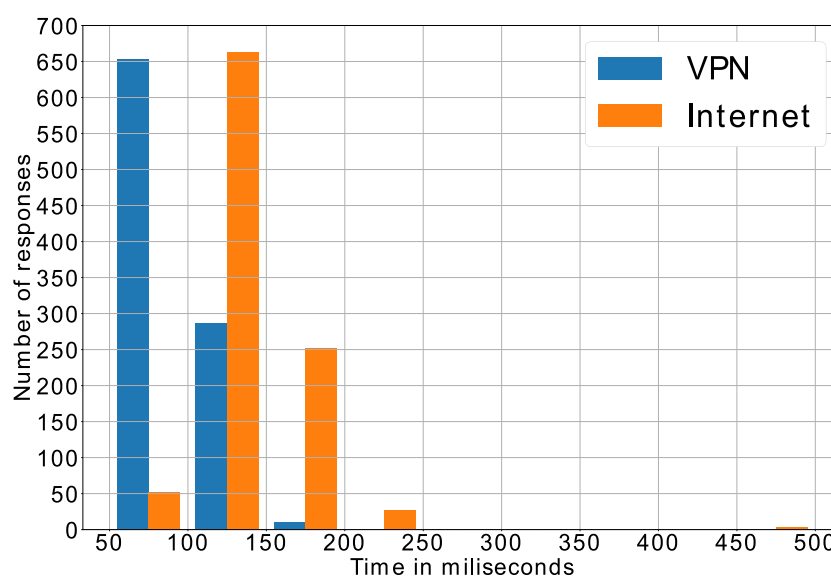


Figure 15. SCADA response time boxplot test results using local VPN and the 4G mobile Internet.

To the following correct version:

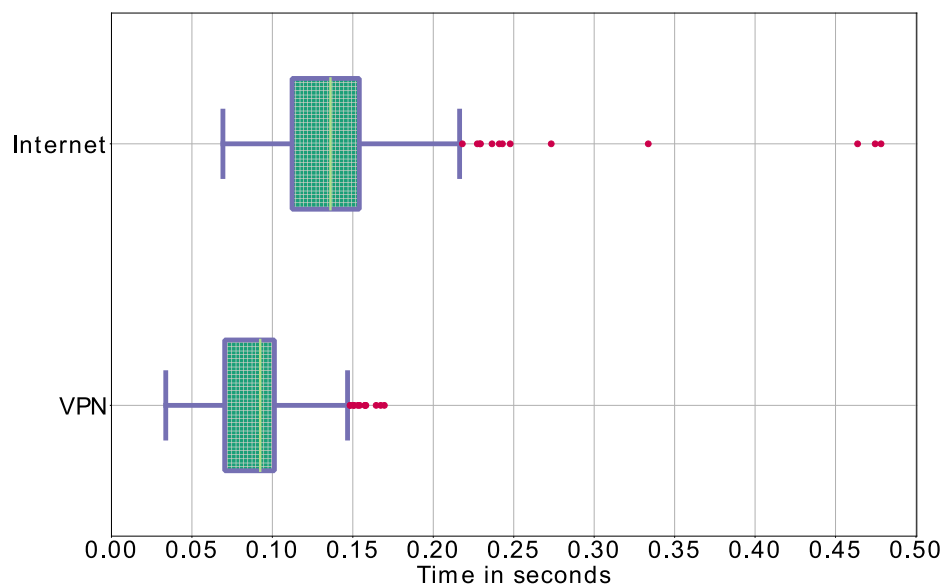


Figure 15. SCADA response time boxplot test results using local VPN and the 4G mobile Internet.

The authors would like to apologize for any inconvenience caused to the readers by these changes. The changes do not affect the scientific results. The manuscript will be updated and the original will remain online on the article webpage, with a reference to this Correction.

Reference

1. Antonijević, M.; Sučić, S.; Keserica, H. Augmented Reality Applications for Substation Management by Utilizing Standards-Compliant SCADA Communication. *Energies* **2018**, *11*, 599. [[CrossRef](#)]



© 2018 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).