

Supplementary Materials

1-(((6-(methoxycarbonyl)-5-oxononan-4-yl)oxy)carbonyl)cyclopropane-1-carboxylic acid

Evgenii S. Gorlov ¹, Diana V. Shuingalieva ^{1,2,3}, Alexey I. Ilovaisky ^{1,3}, Vera A. Vil' ^{1,3*}, and Alexander O. Terent'ev ^{1,3*}

¹ N. D. Zelinsky Institute of Organic Chemistry, Russian Academy of Sciences, 47 Leninsky Prospect, Moscow, 119991, Russian Federation

² D. Mendeleev University of Chemical Technology of Russia, 9 Miusskaya Square, Moscow 125047, Russian Federation

³ All-Russian Research Institute for Phytopathology, B. Vyazyomy, 143050, Moscow Region, Russian Federation

* Correspondence: vil@ioc.ac.ru (V.A.V.), terentev@ioc.ac.ru (A.O.T.)

Figure S1. ^1H NMR spectrum of 4-butylidene-3-propyloxetan-2-one (**1**).

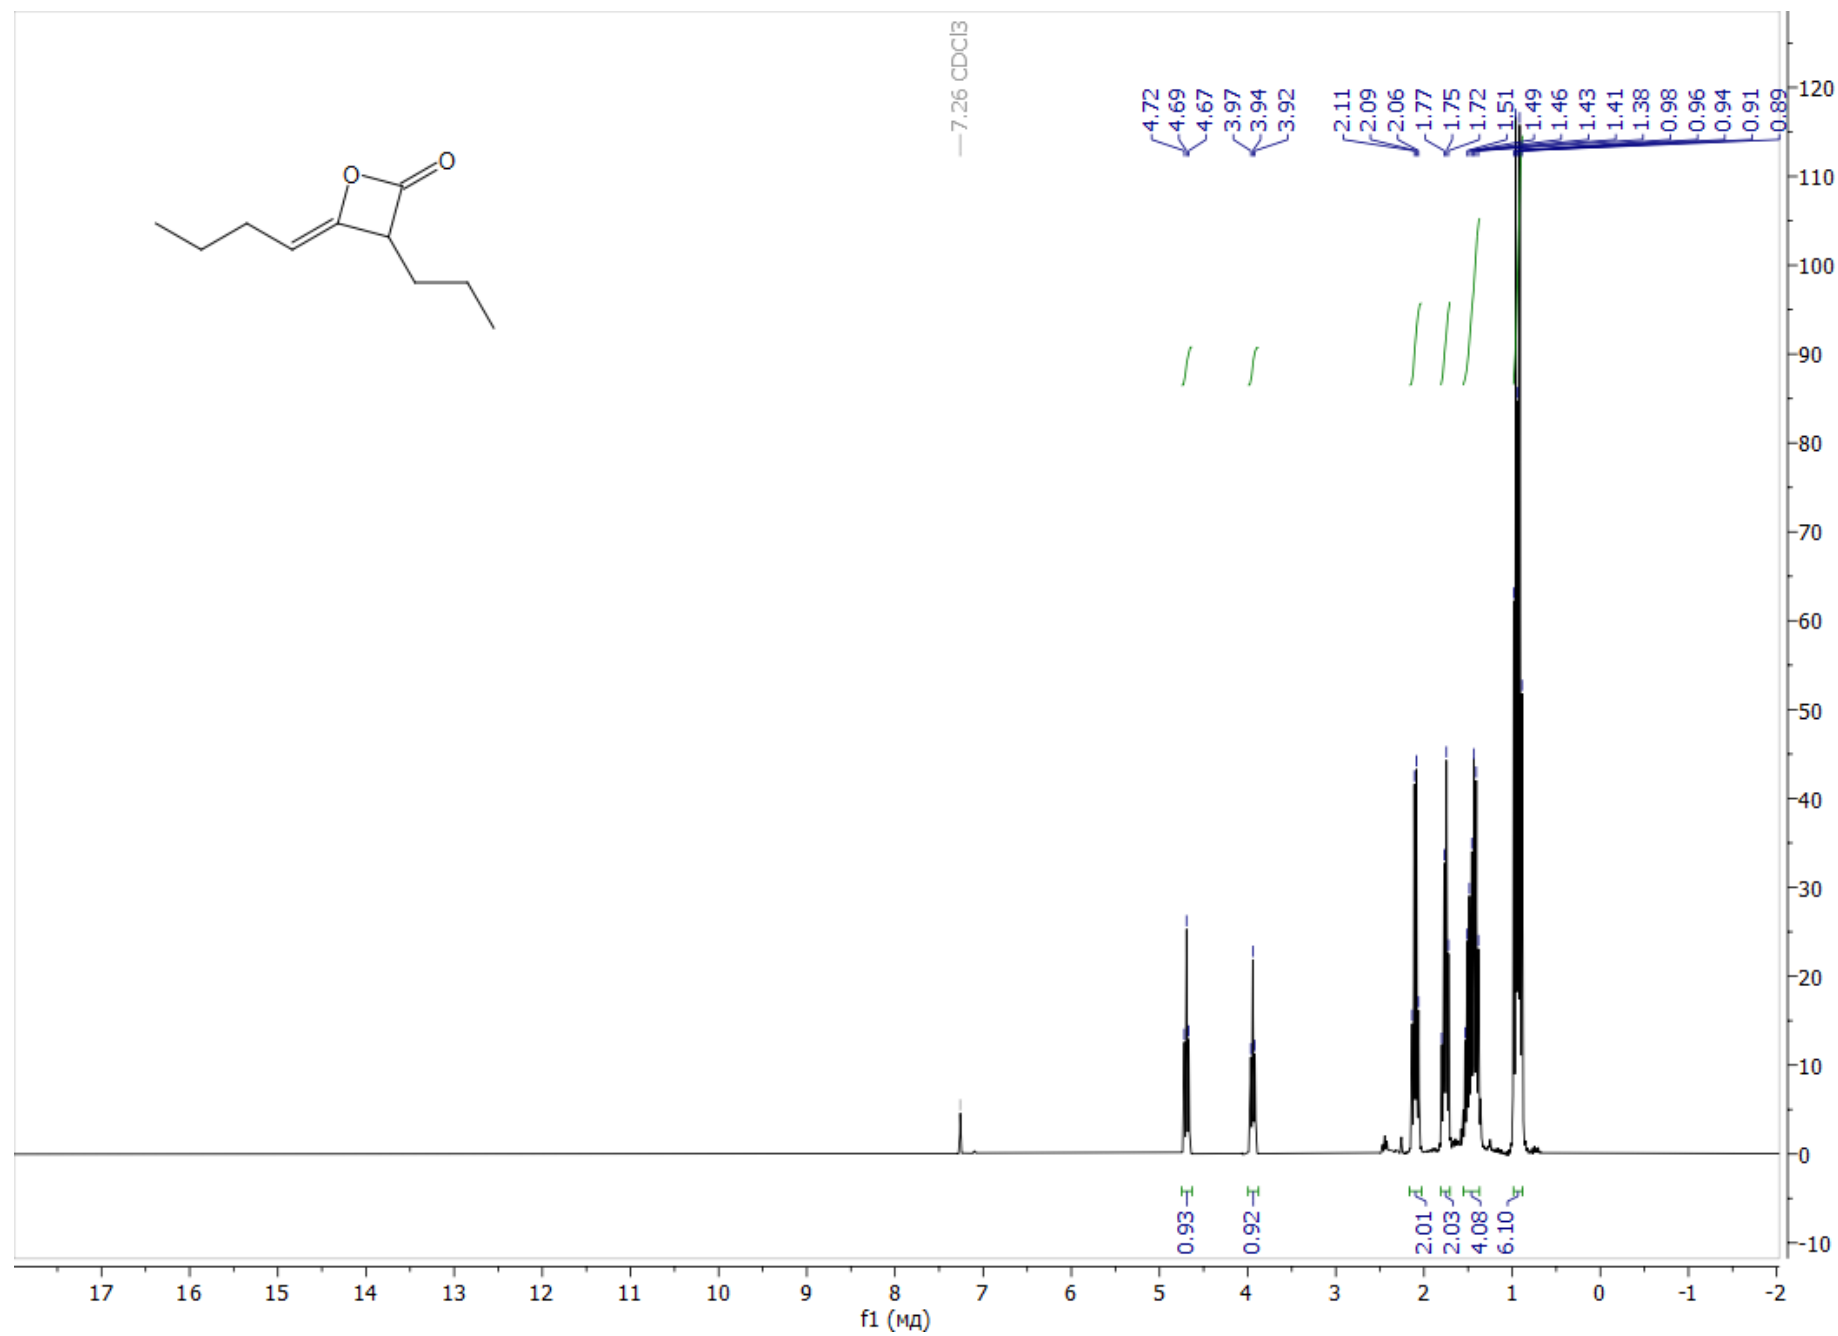


Figure S2. ^{13}C NMR spectrum of 4-butylidene-3-propyloxetan-2-one (**1**).

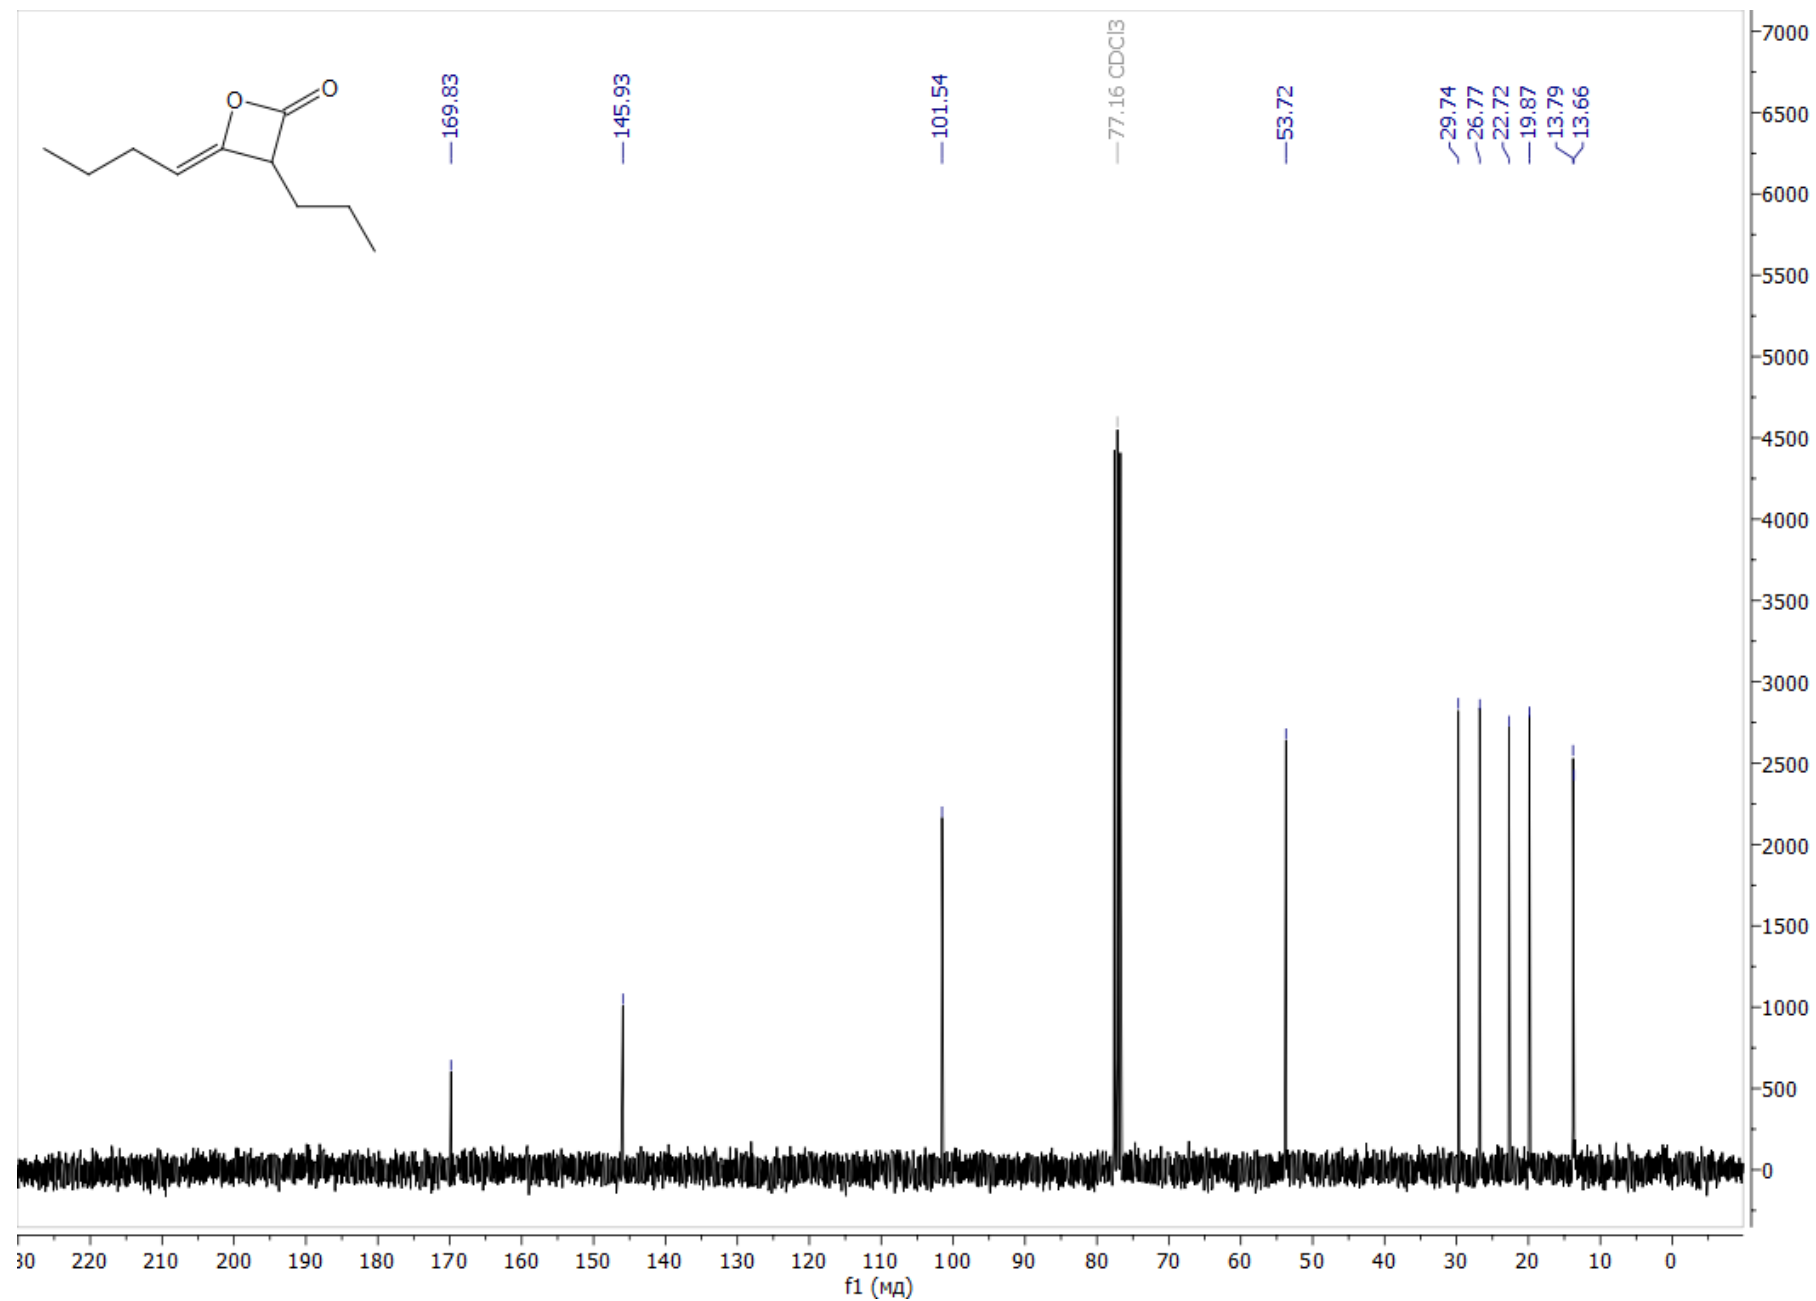


Figure S3. ^1H NMR spectrum of cyclopropyl malonoyl peroxide (**2**).

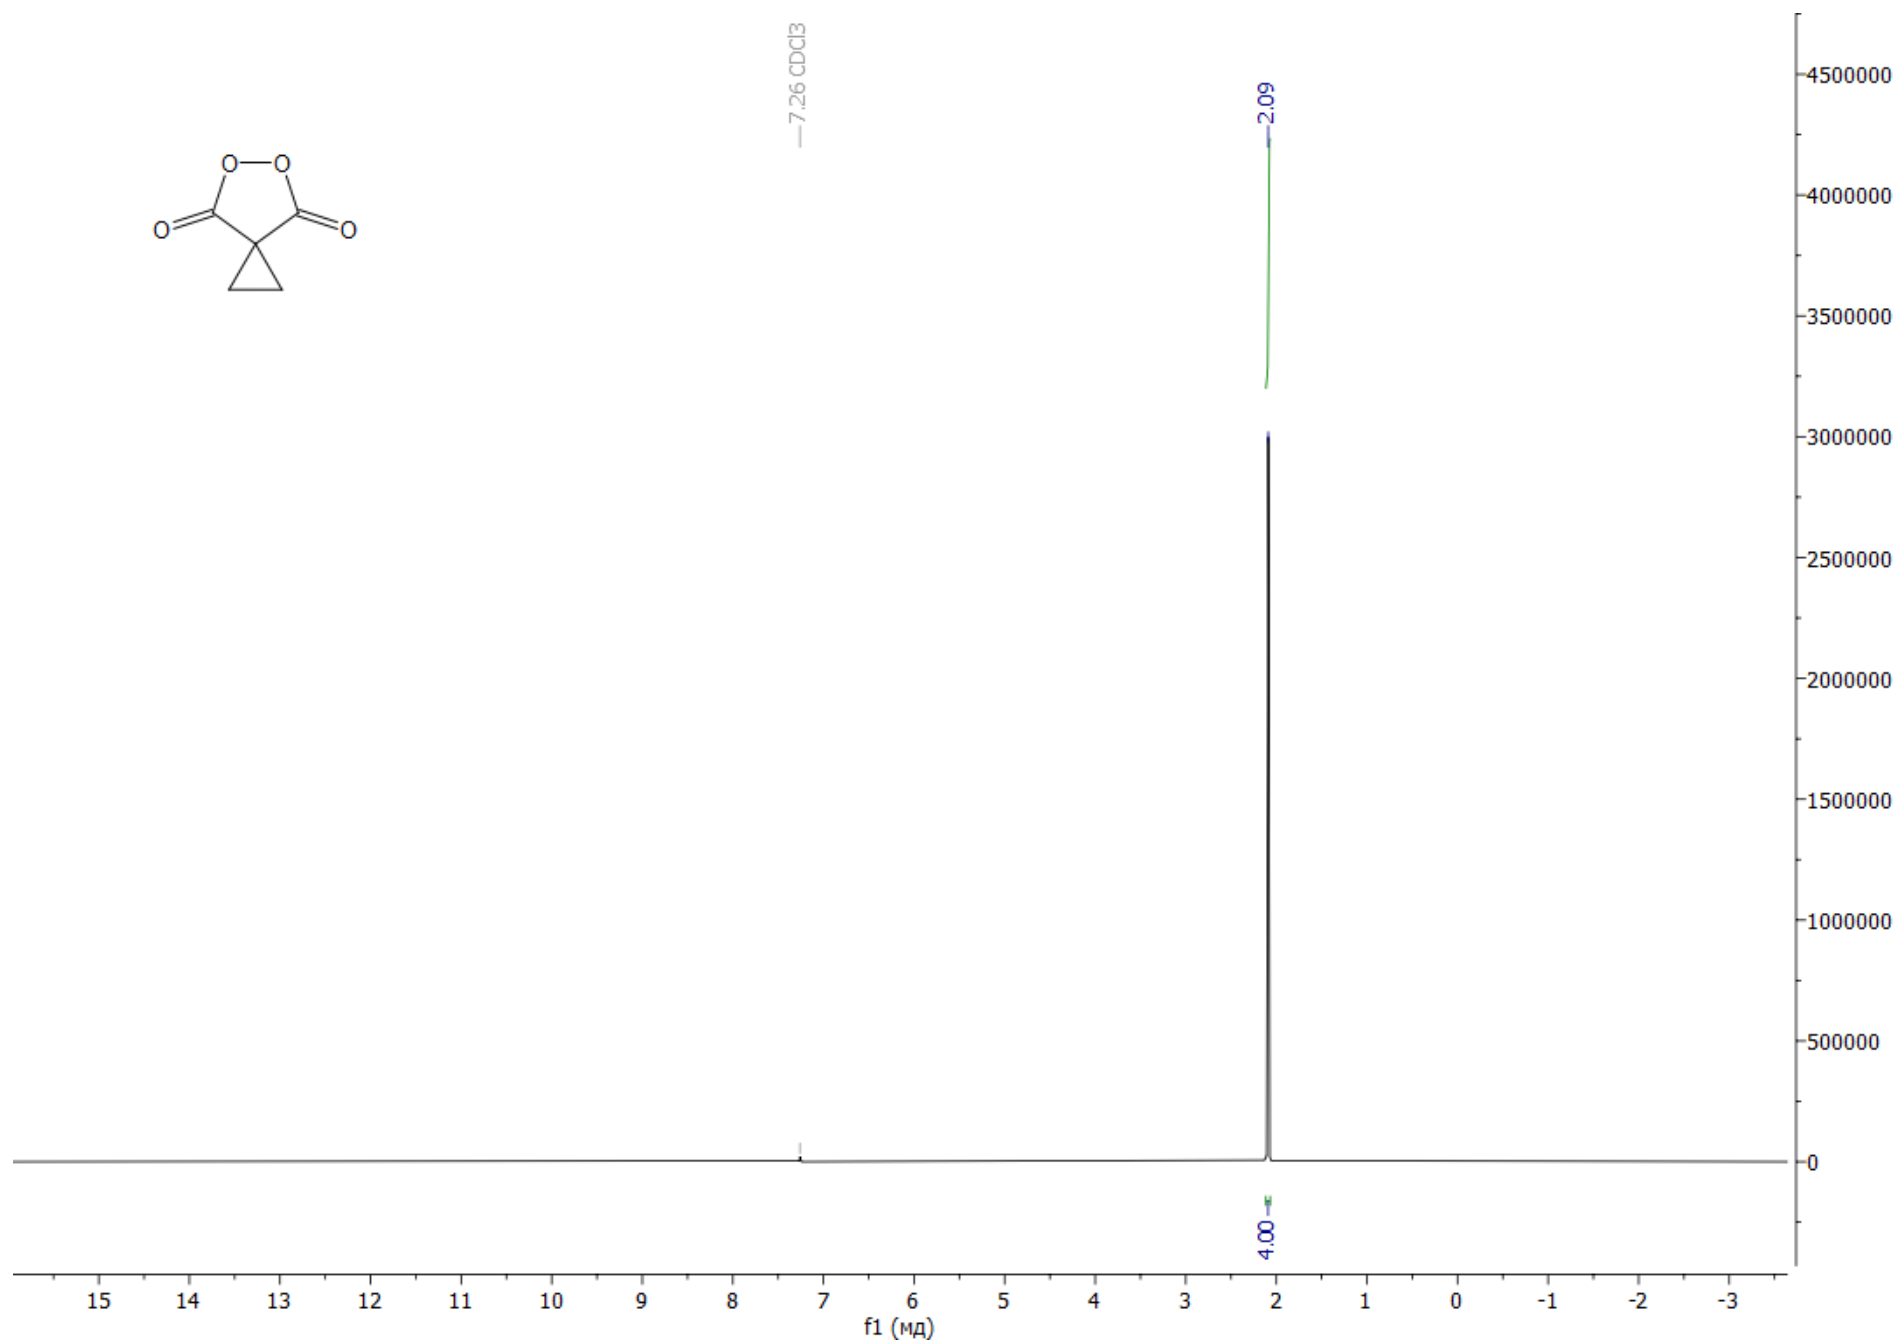


Figure S4. ^{13}C NMR spectrum of cyclopropyl malonoyl peroxide (**2**).

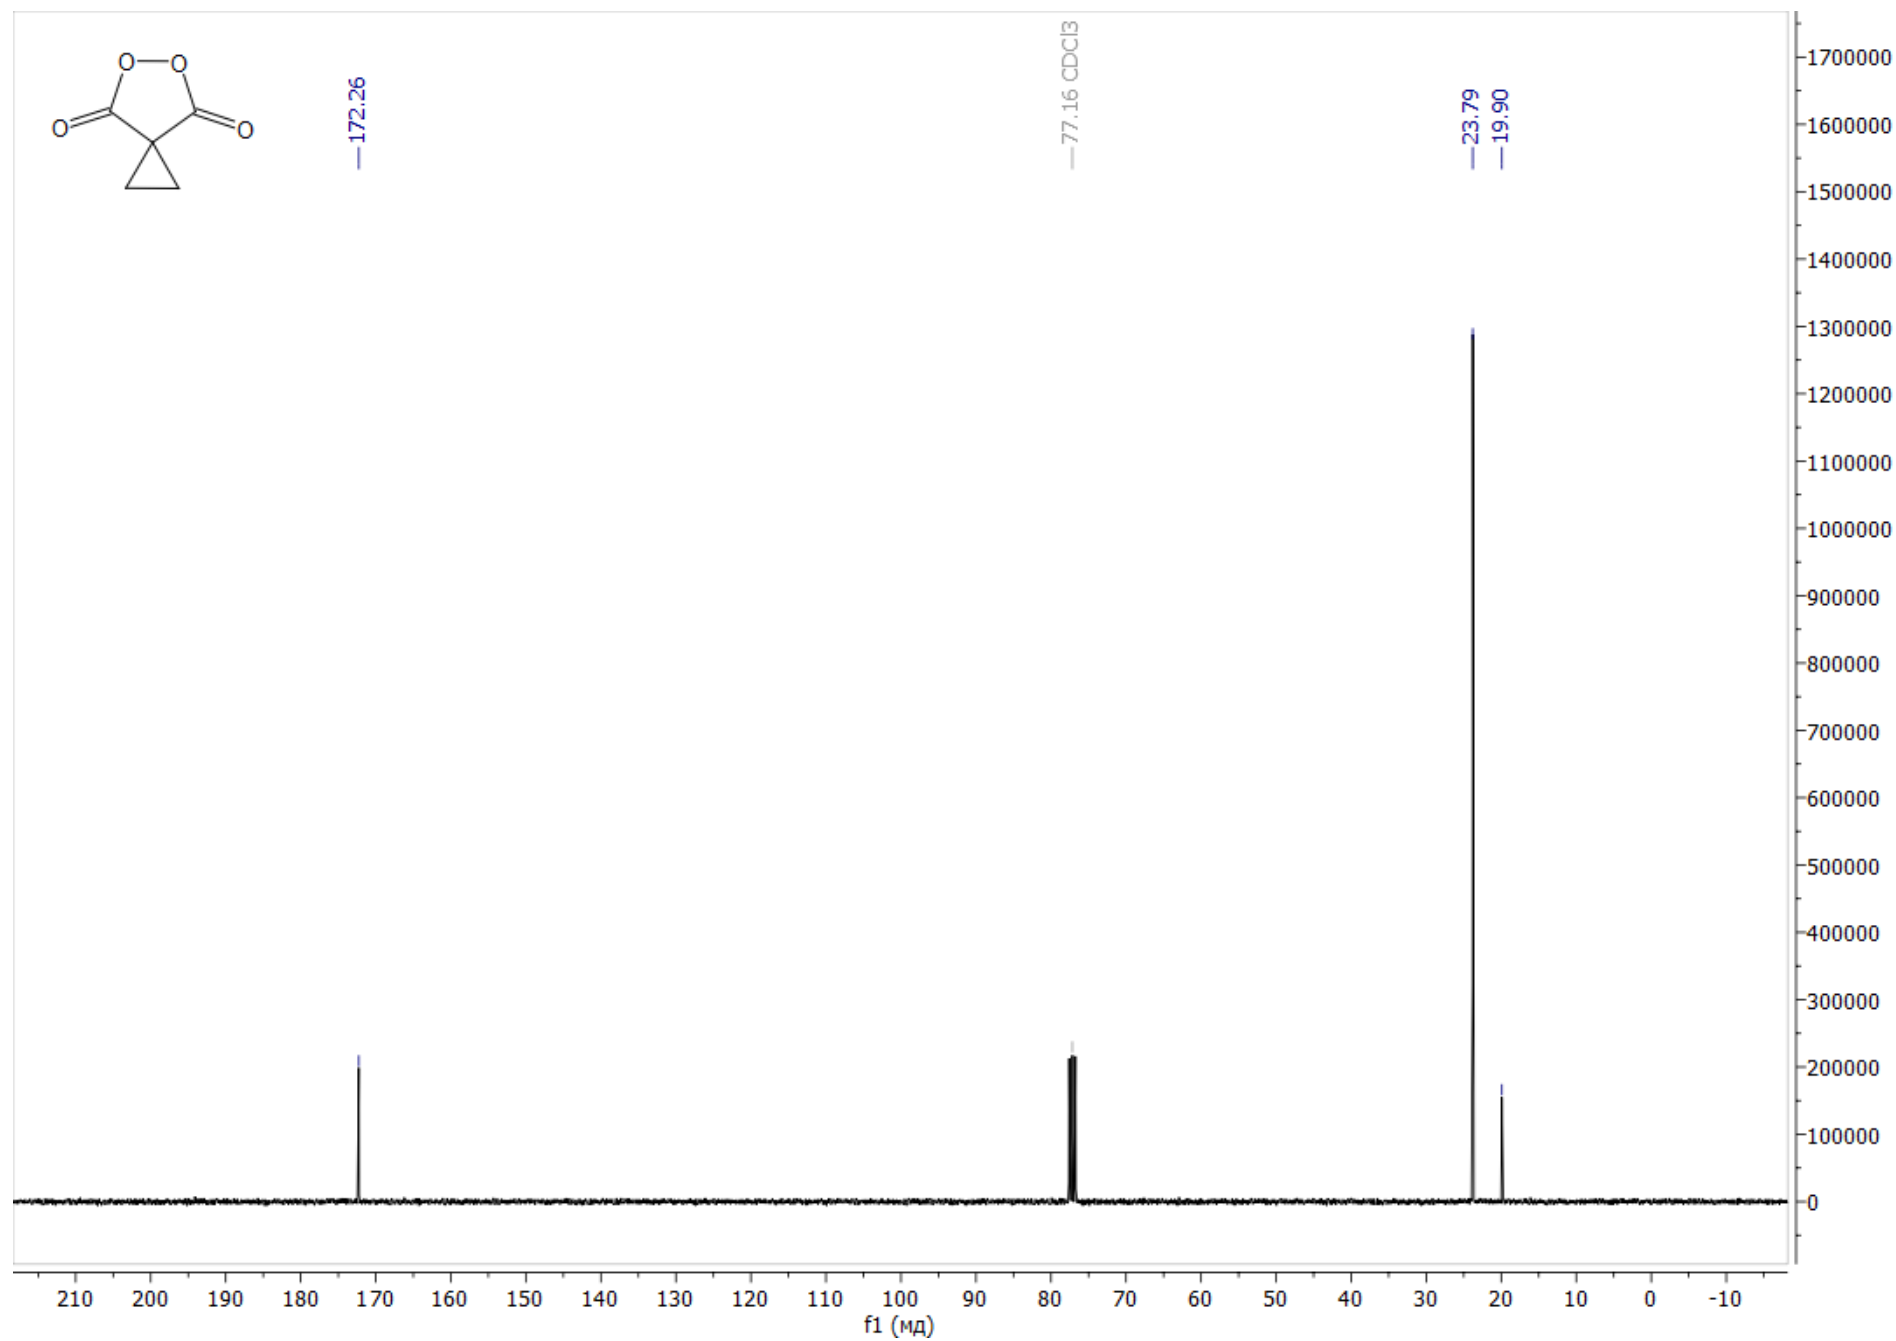


Figure S5. ^1H NMR spectrum of 1-(((6-(methoxycarbonyl)-5-oxononan-4-yl)oxy)carbonyl)cyclopropane-1-carboxylic acid (**3**).

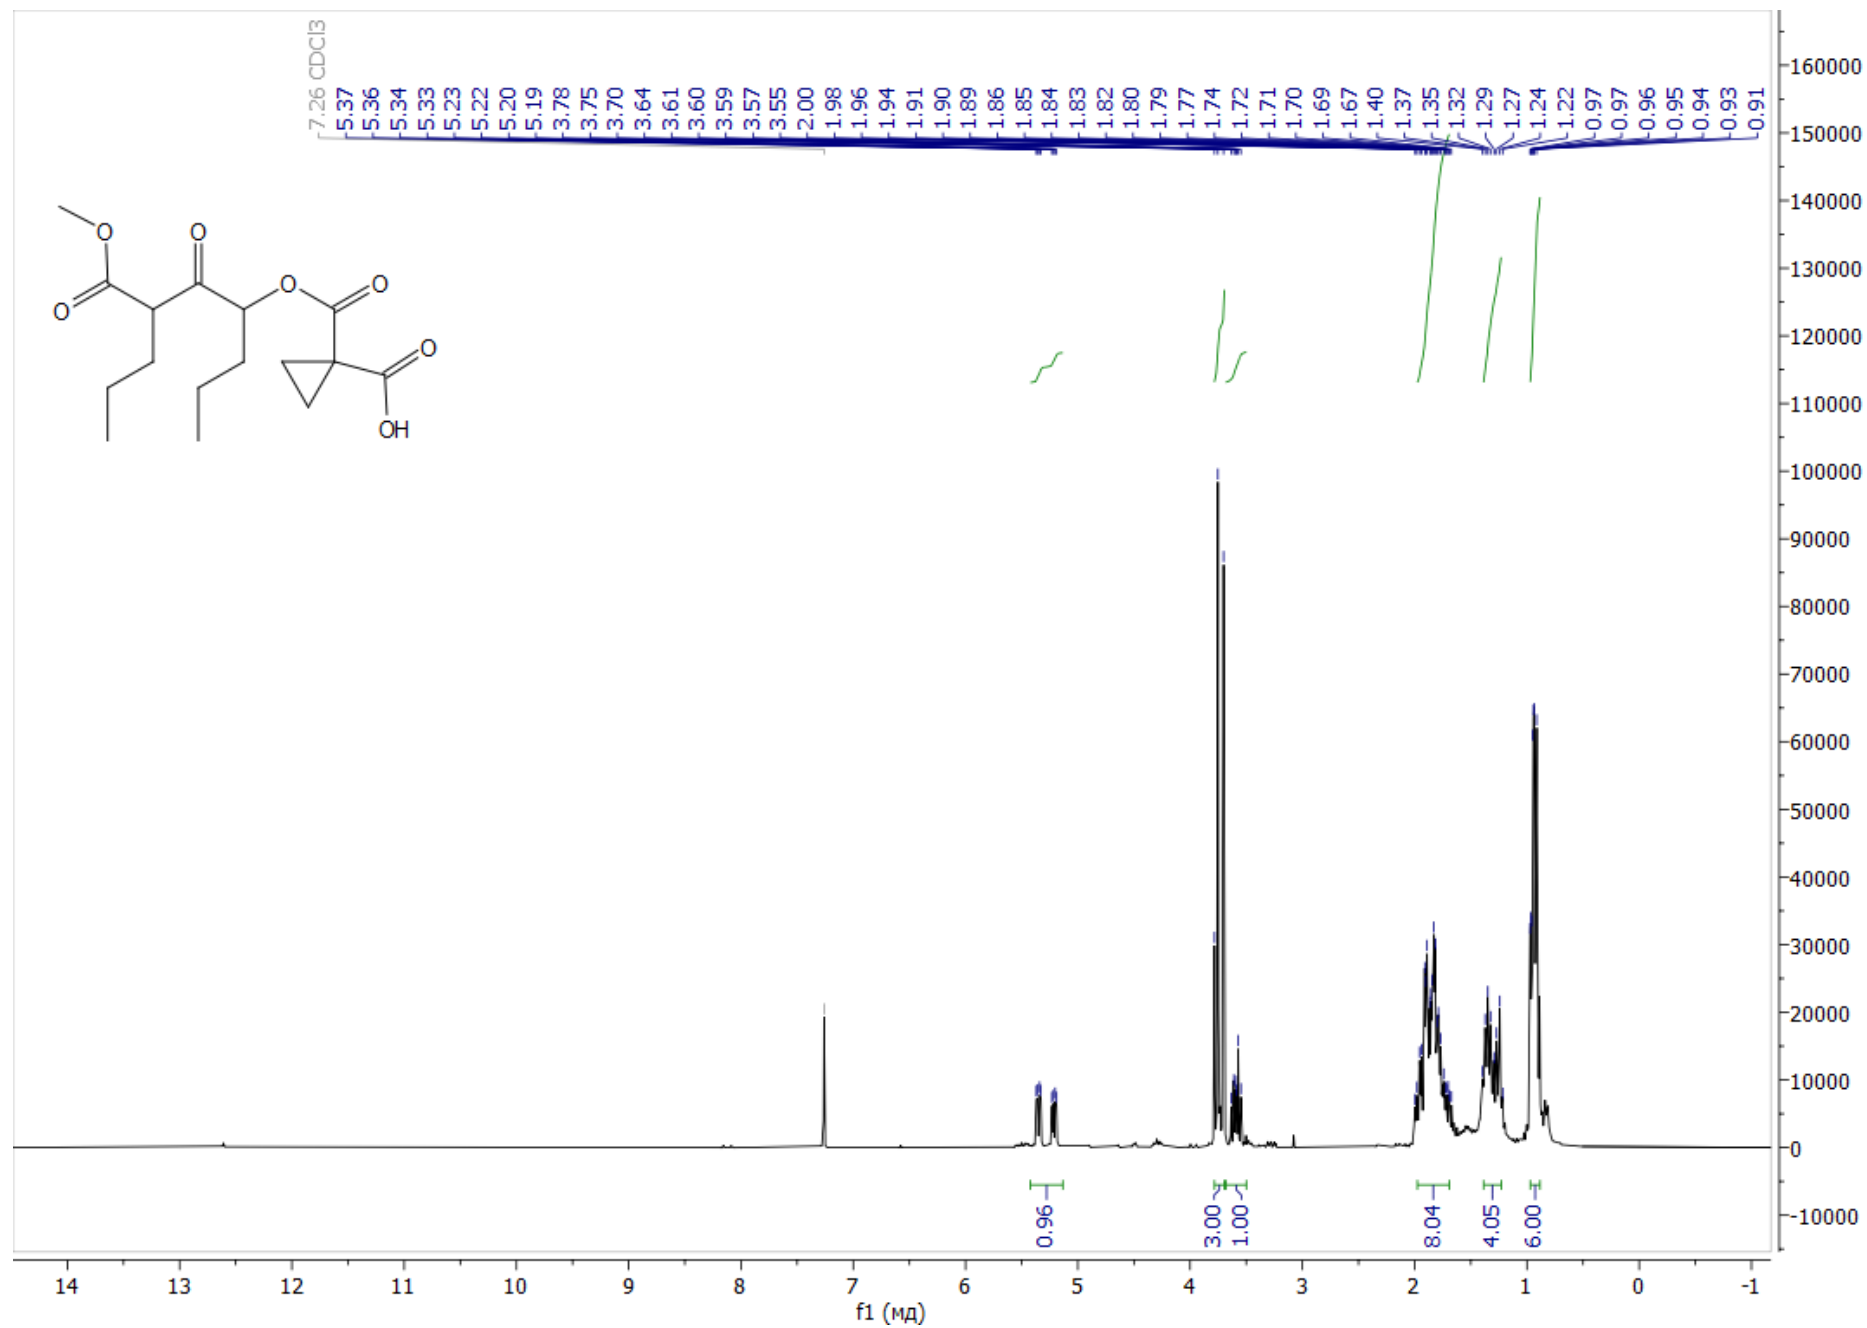


Figure S6. ^{13}C NMR spectrum of 1-(((6-(methoxycarbonyl)-5-oxononan-4-yl)oxy)carbonyl)cyclopropane-1-carboxylic acid (**3**).

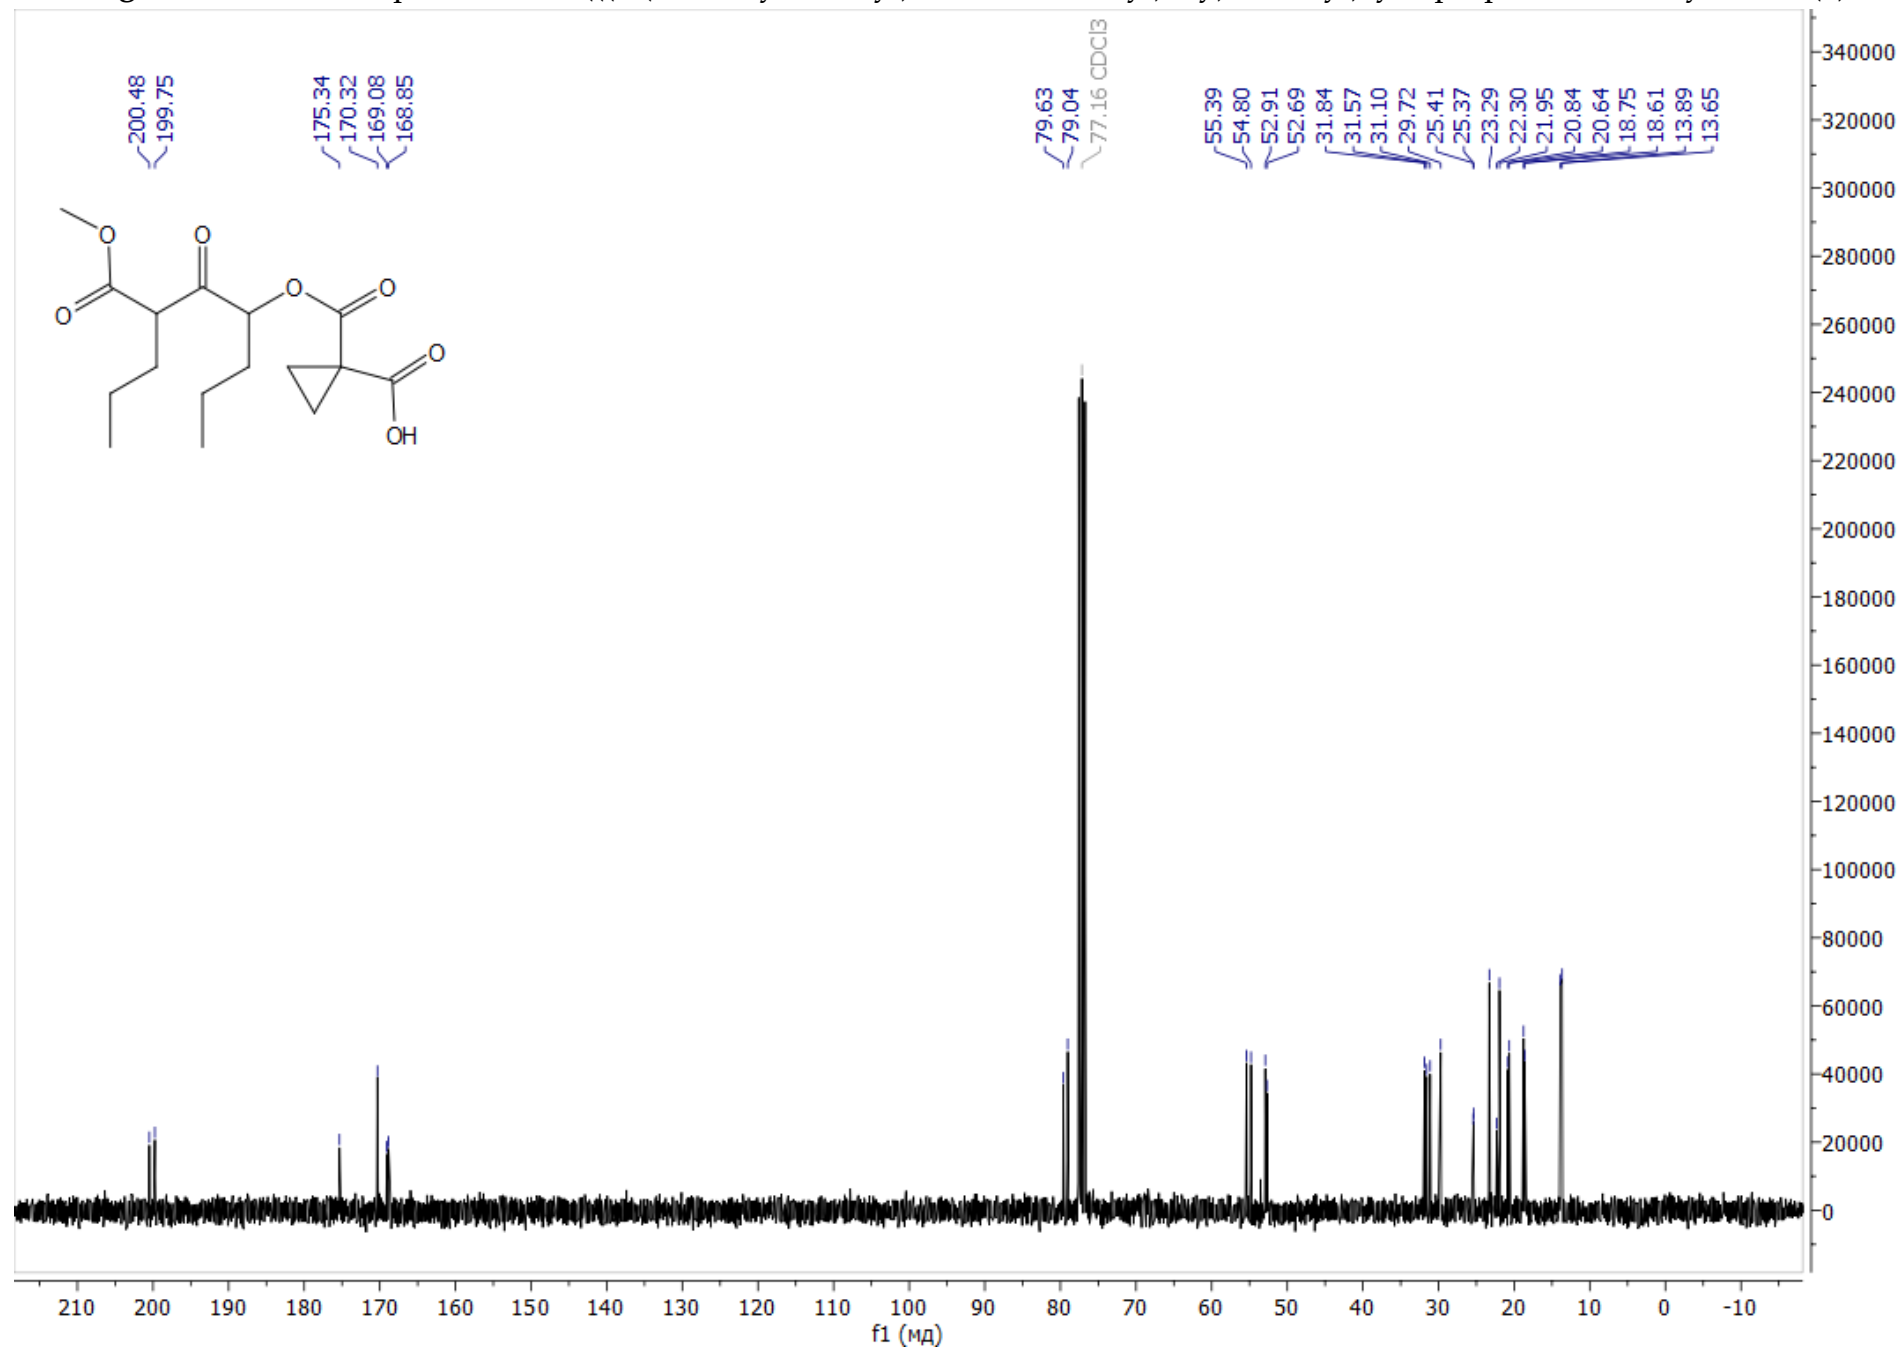


Figure S7. IR spectrum of 1-(((6-(methoxycarbonyl)-5-oxononan-4-yl)oxy)carbonyl)cyclopropane-1-carboxylic acid (**3**).

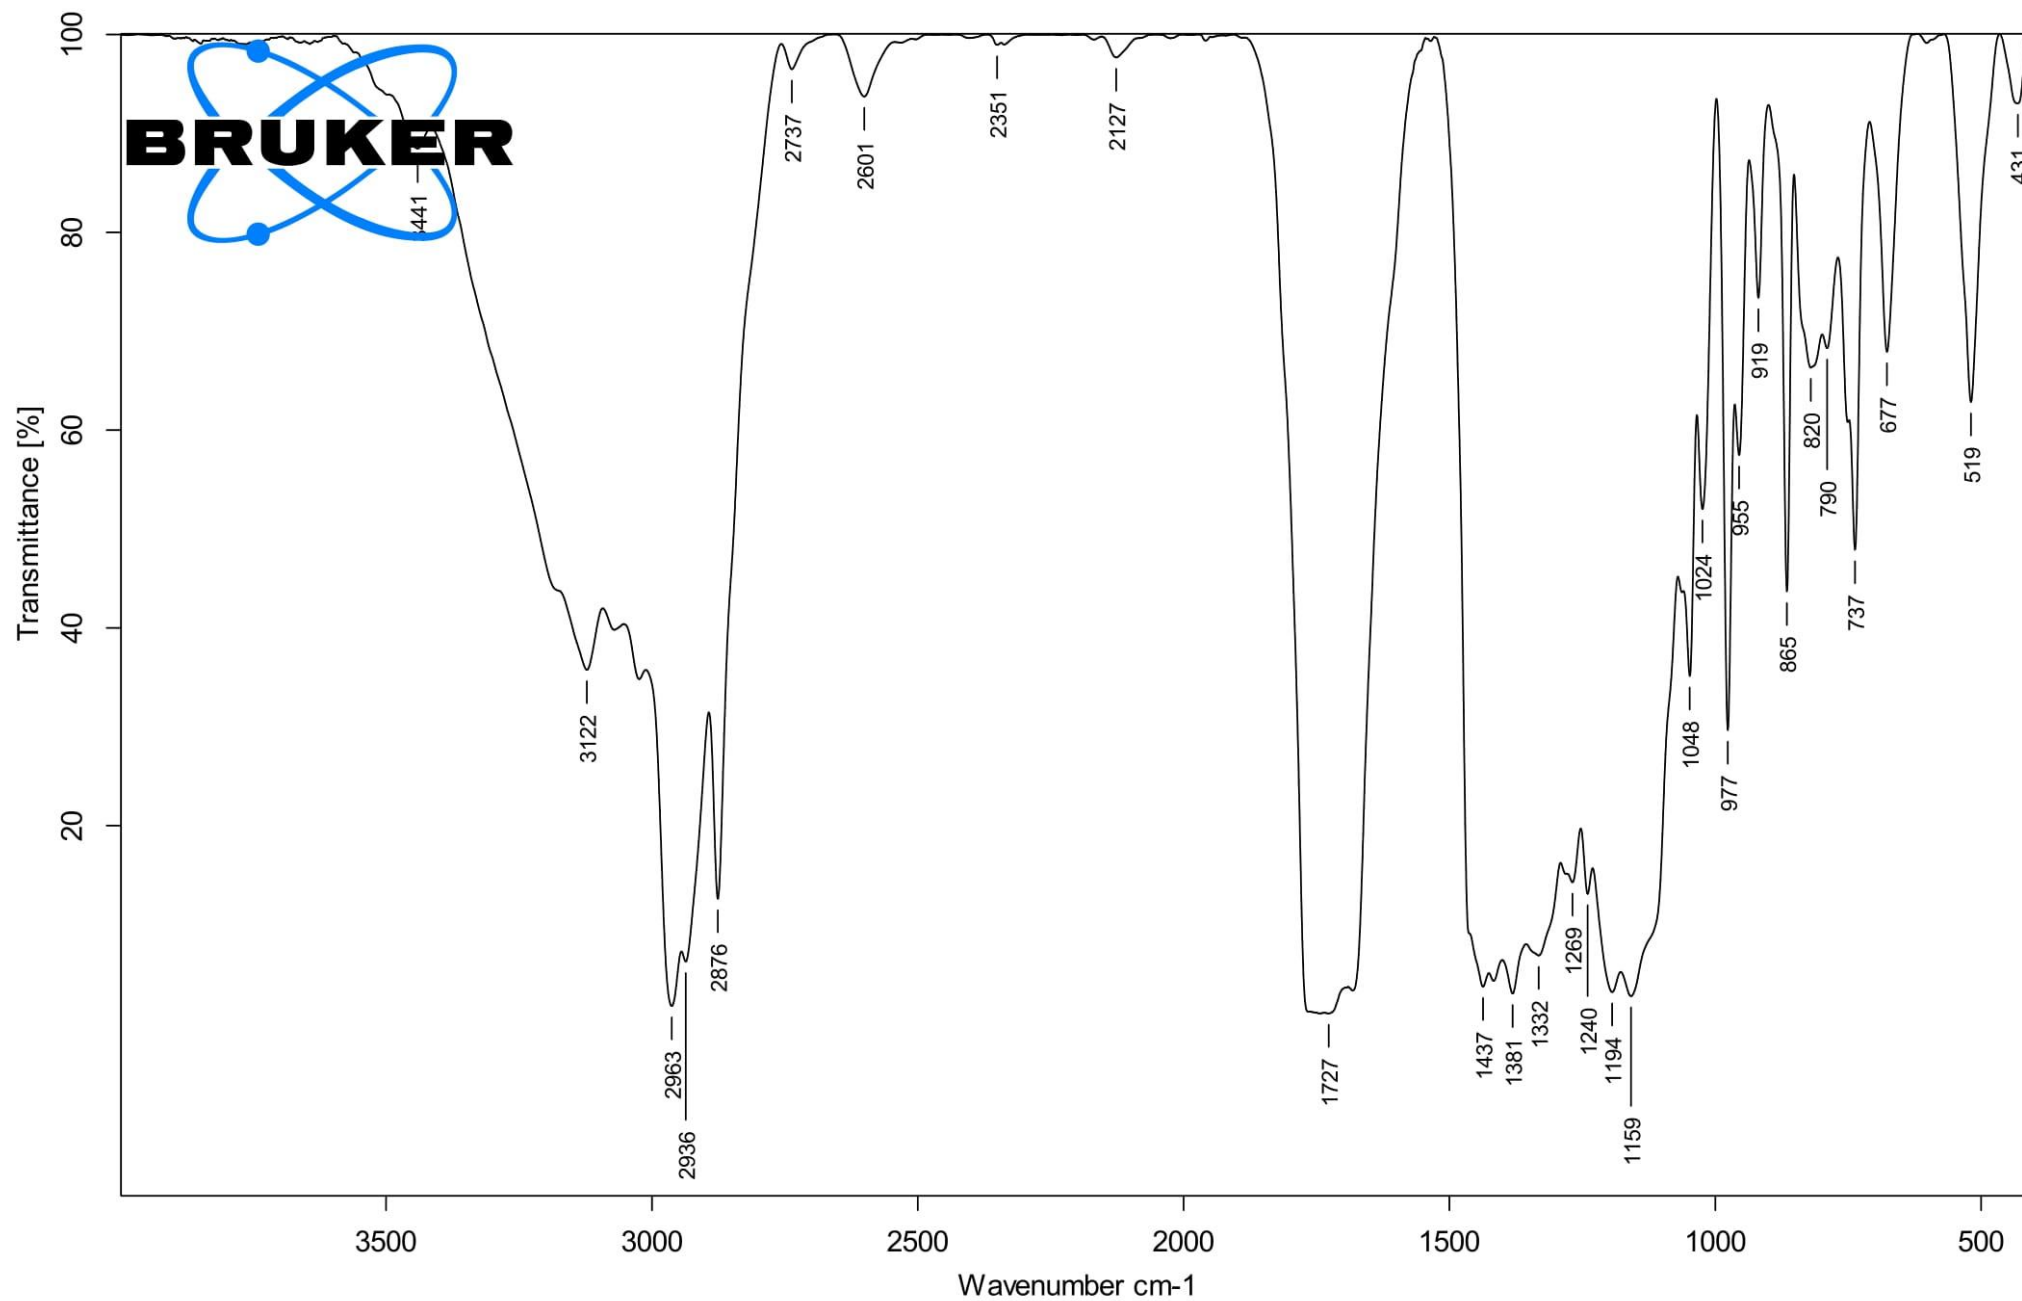


Figure S8. HRMS spectrum of 1-(((6-(methoxycarbonyl)-5-oxononan-4-yl)oxy)carbonyl)cyclopropane-1-carboxylic acid (**3**).

Display Report

Analysis Info

Analysis Name D:\Data\Chizhov\Terentiev\Wille962_&clblow.d
 Method tune_low.m
 Sample Name /TERN E962
 Comment CH3CN 100 %, dil. 2000, calibrant added

Acquisition Date 20.01.2023 17:30:51

Operator BDAL@DE
 Instrument / Ser# micrOTOF 10248

Acquisition Parameter

Source Type	ESI	Ion Polarity	Positive	Set Nebulizer	0.4 Bar
Focus	Not active			Set Dry Heater	180 °C
Scan Begin	50 m/z	Set Capillary	4500 V	Set Dry Gas	4.0 l/min
Scan End	3000 m/z	Set End Plate Offset	-500 V	Set Divert Valve	Waste

