

No syntax errors found.
Please wait while processing

[CIF dictionary](#)
[Interpreting this report](#)

Datablock: cua138

Bond precision: C-C = 0.0023 Å Wavelength=1.54184
Cell: a=17.9155(5) b=12.6121(3) c=8.4701(2)
alpha=90 beta=103.197(3) gamma=90

Temperature: 150 K

	Calculated	Reported
Volume	1863.29(8)	1863.29(8)
Space group	P 21/c	P 1 21/c 1
Hall group	-P 2ybc	-P 2ybc
Moiety formula	C20 H11 F6 N3 O4	C20 H11 F6 N3 O4
Sum formula	C20 H11 F6 N3 O4	C20 H11 F6 N3 O4
Mr	471.32	471.32
Dx, g cm ⁻³	1.680	1.680
Z	4	4
Mu (mm ⁻¹)	1.401	1.401
F000	952.0	952.0
F000'	956.20	
h,k,lmax	22,15,10	21,15,10
Nref	3711	3659
Tmin,Tmax	0.750,0.756	0.034,1.000
Tmin'	0.544	

Correction method= # Reported T Limits: Tmin=0.034
Tmax=1.000 AbsCorr = MULTI-SCAN

Data completeness= 0.986 Theta(max)= 72.811

R(reflections)= 0.0427(3110) wR2(reflections)=
0.1160(3659)

S = 1.037 Npar= 299

The following ALERTS were generated. Each ALERT has the format

test-name_ALERT_alert-type_alert-level.

Click on the hyperlinks for more details of the test.

Alert level B

[PLAT031_ALERT_4_B](#) Refined Extinction Parameter Within Range of ... 1.529 Sigma
[PLAT196_ALERT_1_B](#) No TEMP record and _measurement_temperature .NE. 293 Degree

Alert level C

[PLAT242_ALERT_2_C](#) Low 'MainMol' Ueq as Compared to Neighbors of C00P Check

Alert level G

[PLAT434_ALERT_2_G](#) Short Inter HL..HL Contact F001 ..F002 . 2.80 Ang.
x,3/2-y,-1/2+z = 4_575 Check
[PLAT720_ALERT_4_G](#) Number of Unusual/Non-Standard Labels 44 Note
[PLAT910_ALERT_3_G](#) Missing # of FCF Reflection(s) Below Theta(Min). 1 Note
[PLAT912_ALERT_4_G](#) Missing # of FCF Reflections Above Sth/L= 0.600 47 Note
[PLAT941_ALERT_3_G](#) Average HKL Measurement Multiplicity 3.6 Low
[PLAT978_ALERT_2_G](#) Number C-C Bonds with Positive Residual Density. 10 Info

- 0 **ALERT level A** = Most likely a serious problem - resolve or explain
- 2 **ALERT level B** = A potentially serious problem, consider carefully
- 1 **ALERT level C** = Check. Ensure it is not caused by an omission or oversight
- 6 **ALERT level G** = General information/check it is not something unexpected

- 1 ALERT type 1 CIF construction/syntax error, inconsistent or missing data
- 3 ALERT type 2 Indicator that the structure model may be wrong or deficient
- 2 ALERT type 3 Indicator that the structure quality may be low
- 3 ALERT type 4 Improvement, methodology, query or suggestion

0 ALERT type 5 Informative message, check

It is advisable to attempt to resolve as many as possible of the alerts in all categories. Often the minor alerts point to easily fixed oversights, errors and omissions in your CIF or refinement strategy, so attention to these fine details can be worthwhile. In order to resolve some of the more serious problems it may be necessary to carry out additional measurements or structure refinements. However, the purpose of your study may justify the reported deviations and the more serious of these should normally be commented upon in the discussion or experimental section of a paper or in the "special_details" fields of the CIF. checkCIF was carefully designed to identify outliers and unusual parameters, but every test has its limitations and alerts that are not important in a particular case may appear. Conversely, the absence of alerts does not guarantee there are no aspects of the results needing attention. It is up to the individual to critically assess their own results and, if necessary, seek expert advice.

Publication of your CIF in IUCr journals


A basic structural check has been run on your CIF. These basic checks will be run on all CIFs submitted for publication in IUCr journals (*Acta Crystallographica*, *Journal of Applied Crystallography*, *Journal of Synchrotron Radiation*); however, if you intend to submit to *Acta Crystallographica Section C* or *E* or *IUCrData*, you should make sure that [full publication checks](#) are run on the final version of your CIF prior to submission.

Publication of your CIF in other journals

Please refer to the *Notes for Authors* of the relevant journal for any special instructions relating to CIF submission.

PLATON version of 06/07/2023; check.def file version of 30/06/2023

Datablock cua138 - ellipsoid plot

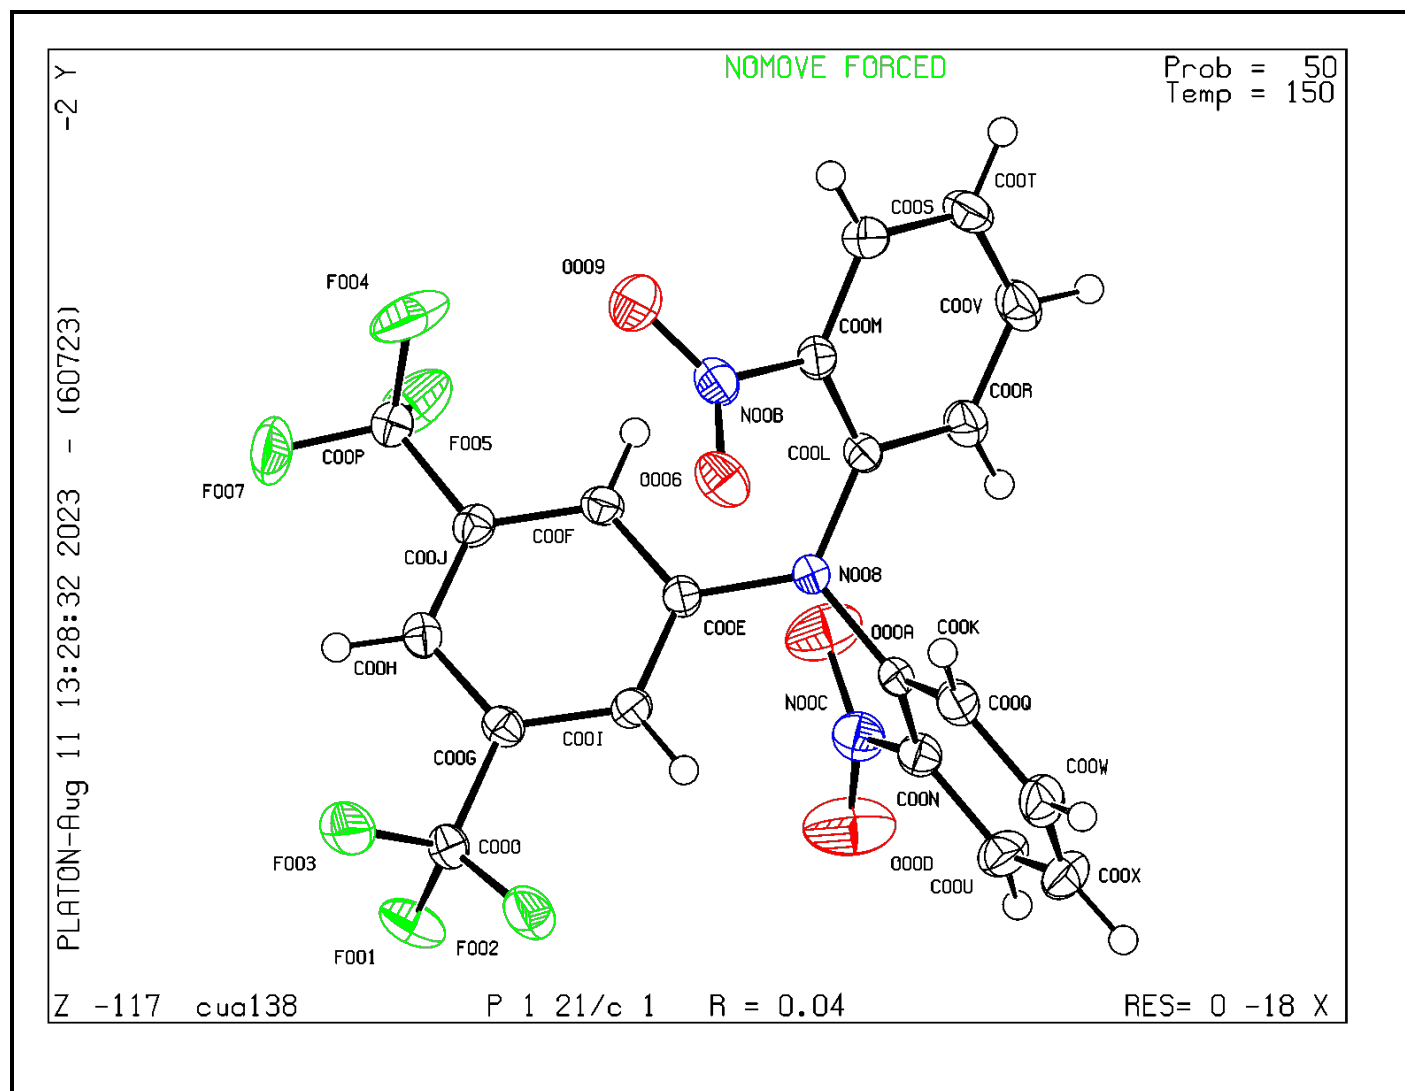

[Download CIF editor \(publCIF\) from the IUCr](#)
[Download CIF editor \(enCIFer\) from the CCDC](#)
[Test a new CIF entry](#)