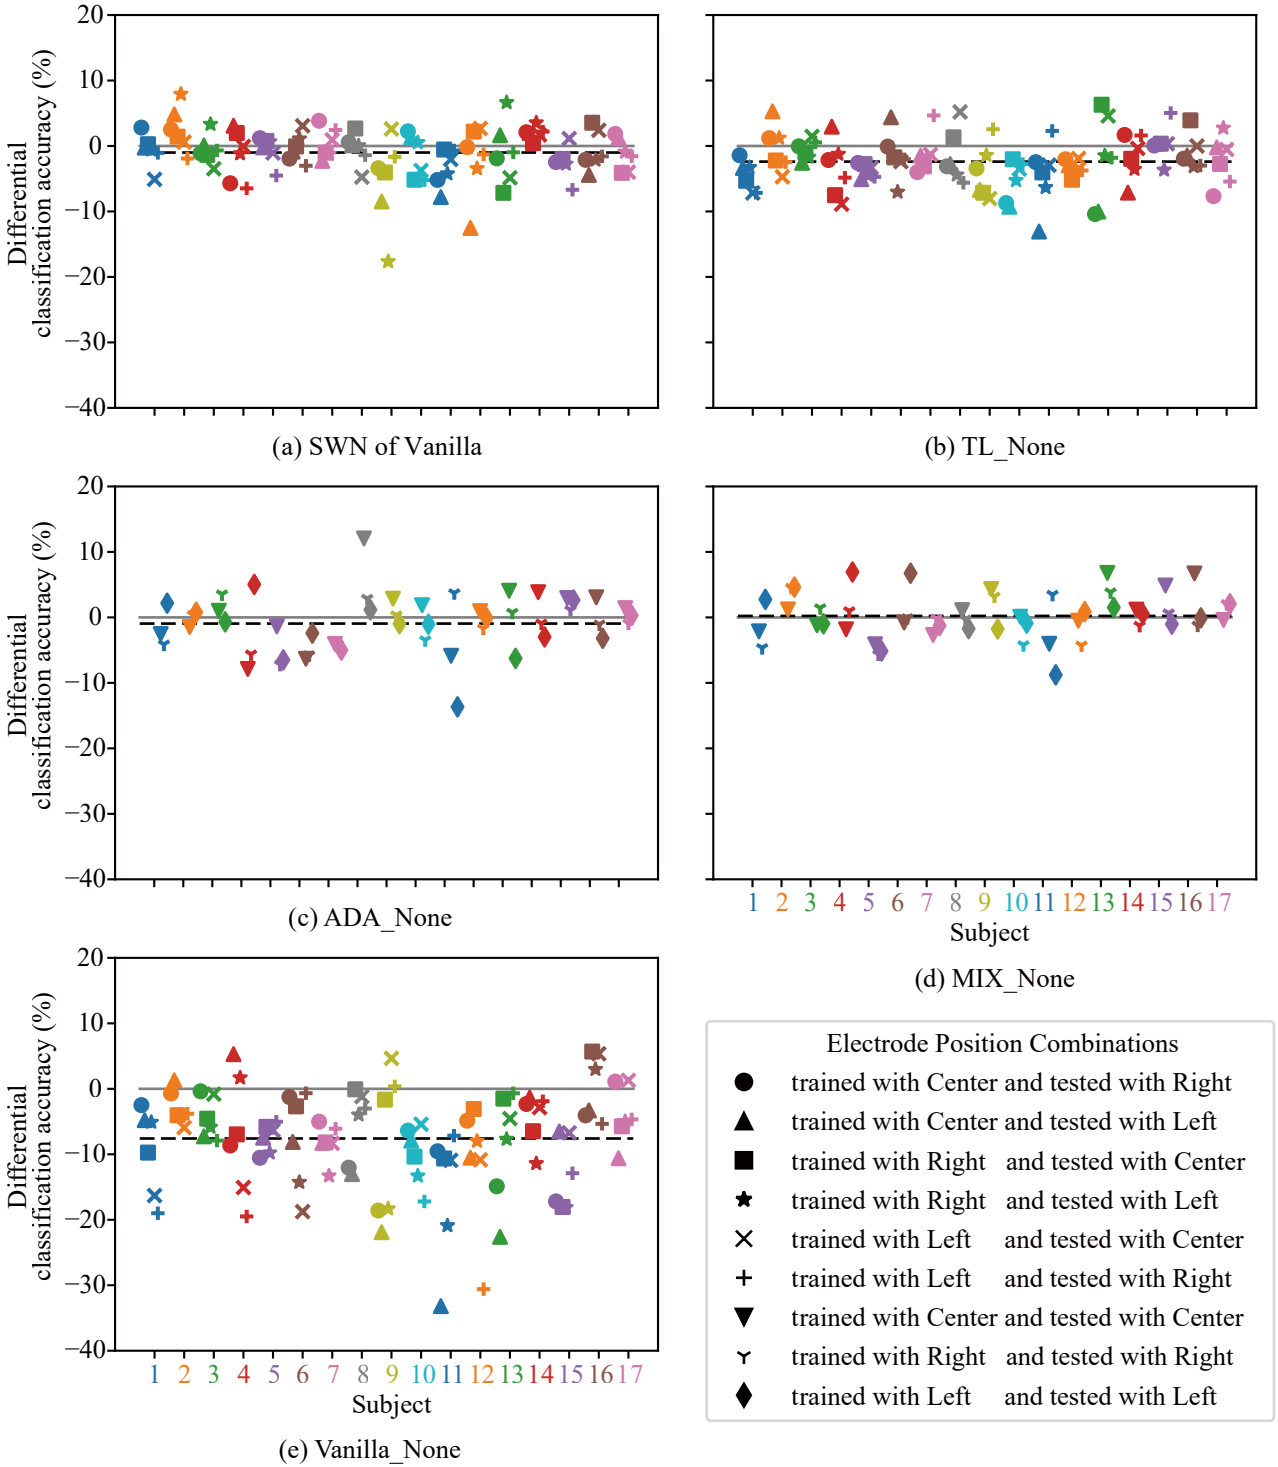

Differential classification accuracy (%)
20
10
0
−10
−20
−30
−40
(a) SWN of Vanilla
(b) TL_None
(c) ADA_None
(d) MIX_None
(e) Vanilla_None
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17
Subject
Electrode Position Combinations
trained with Center and tested with Right
trained with Center and tested with Left
trained with Right and tested with Center
trained with Right and tested with Left
trained with Left and tested with Center
trained with Left and tested with Right
trained with Center and tested with Center
trained with Right and tested with Right
trained with Left and tested with Left