

## Article

# Risk Analysis of Lightning and Surge Protection Devices for Power Energy Structures

Chien-Hsun Liu, Yirga Belay Muna, Yu-Tung Chen, Cheng-Chien Kuo \* and Hung-Yi Chang

Department of Electrical Engineering, National Taiwan University of Science and Technology 43, Sec. 4, Keelung Rd., Taipei 106, Taiwan; u019366@taipower.com.tw (C.-H.L.); besufikad@gmail.com (Y.B.M.); 100m05003@stud.sju.edu.tw (Y.-T.C.); boy4211@gmail.com (H.-Y.C.)

\* Correspondence: cckuo@mail.ntust.edu.tw; Tel.: +886-920881490; Fax: +886-227376688

Received: 31 May 2018; Accepted: 27 July 2018; Published: 1 August 2018



**Abstract:** This paper studies the risk data and protection measurements of lightning based on the IEC62305 standard. In addition, Visual Basic (VB) is used to build a lightning risk calculation program with a Graphical User Interface (GUI). The data structure, including environment data, line data, zone data, economic data, and protection measures is designed to simulate risk of loss of human life (R1) and risk of loss of economic value (R4). To achieve the most economical protection structure design, additional protection measurements and annual savings are considered. In the practical application, the main purpose is to discuss effective protection distances of surge protective devices (SPDs) for low-voltage power distribution. This paper takes advantage of Electromagnetic Transients Program (EMTP) to simulate the voltage of equipment with different types of loads and length of the cable. After using the protection measures, the value of risk of human life reduces from  $21.299 \times 10^{-5}$  to  $0.439 \times 10^{-5}$  and the value of risk of economic value reduces from  $2696.754 \times 10^{-5}$  to  $98.062 \times 10^{-5}$ . The results mean that the protection measures let the values of the risk below the tolerance. By considering the annual cost saving. Assume the cost of protection measures, the interest rate, the depreciation rate, and the maintenance rate are 150,000 \$, 4%, 5%, and 1%, respectively. The annual cost before using protective measures, the annual cost after using protective measures, the annual cost of protective measures, and the annual cost saving are \$925,000, \$33,635, \$15,000 and \$876,365, respectively. Consequently, it is feasible that the simulation result can provide users with great suggestions to choose the best installation location and achieve the most effective protection design.

**Keywords:** lightning risk; protection measures; surge protective device

## 1. Introduction

So far there is no equipment, technology or method that can change the weather to prevent the occurrence of lightning. Buildings, devices, wiring and humans or animals can be damaged by lightning no matter whether it strikes directly or indirectly. In order to reduce the risk of loss, lightning protection measures have become an important issue [1]. The voltage–current characteristics influence the current sharing and the residual voltages, in an effort to improve, the lightning performance of a distribution substation and careful selection of the electrical characteristics of the arresters to be connected is of great importance to achieve an adequate sharing of the lightning current and reduce the failure probability of the arresters [2]. The installation position of surge arresters and the length of the underground cables influence significantly the lightning performance of high-voltage/medium-voltage (HV/MV) substations [3].

According to the statistics by Taiwan Power Company in 2016, the average number of annual lightning strikes is 26,105. If the principles of lightning damage and the lightning risk factors can be known, some methods can be used to reduce the losses, for example, installing lightning receiving

devices (the types of protector include lightning straps, lightning rods, and meshes), grounding grids, grounding devices, surge protective devices, metal shielding, fire protection measures, and warning signs. In order to ensure the safety of humans, devices, and buildings, the economic efficiency and the feasibility need to be considered in the protection measures.

The new trends in lightning protection standardization and an introduction to the use of a new software (RISK Multilingual 3) to simply apply the IEC 62305-2 standard on the risk assessment in lightning protection (Protection against lightning—Part 2: Risk management) in its next version is introduced (edition 2, 2010) [4]. Failure risk of insulation and arresters at each region/node of the network, can be evaluated simultaneously, if the inputs are known using adaptive neural-fuzzy inference system (ANFIS). The inputs of ANFIS are the tower footing resistance, CFO and the rate of lightning occurrence [5]. IEC 62305-2 “Protection against lightning” gives the risk assessment method and its evaluation. It requires a risk assessment to be carried out to determine the characteristics of any lightning protection system to be installed [6].

There are studies that address related problems; Parametric studies using a procedure for the calculation of lightning flashover rates of transmission lines using a Monte Carlo method for lightning analysis of overhead transmission lines based on new Alternative Transients Program (ATP) capabilities has been performed to determine the sensitivity of the flashover rate with respect to some parameters of the transmission line and the return stroke [7]. The Lightning Performance Assessment Tool (LPAT) simulation tool has been used by electric power utilities as a useful tool for the design and lightning protection of electric power systems, especially in cases where the transmission lines cross dissimilar geographic areas [8], but there is no single one to solve the lightning protection problem.

Therefore, it is necessary to study lightning protection standards. The lightning protection standards include IEC, GB, IEEE, UL, NFPA, AS/NZS and so on. Moreover, the lightning information about Taiwan and abroad are shown in references [9–13], respectively. This paper aggregates the zone data, line data, environment data, and protection measures of lightning based on the IEC62305 standard [14]. In addition, a lightning risk calculation program with a Graphical User Interface is used to improve the efficiency in designing protection measurements. The paper is organized as follows: Section 2 describes the application of lightning risk and surge protective devices and the flow diagram of the lightning risk design process. Use of a calculation program simulation and analysis of lightning risks is provided in Section 3. SPD application and conclusions follow in Sections 4 and 5, respectively.

## 2. Application of Lightning Risk and Surge Protective Device


The study presents the lightning information from IEC62305-2 (Risk management), IEC62305-3 (Physical damage to structures and life hazard), and IEC62305-4 (Electrical and electronic systems within structures) and proposes suitable protection measures, which include a lightning protection system (LPS), and lightning protection measures (LPMs), to divide lightning protection zones and to calculate gaps. Figure 1 shows the introduction of IEC62305.

### *Types of loss*

- L1: Loss of human life
- L2: Loss of service to the public
- L3: Loss of cultural heritage
- L4: Loss of economic value

### *Risk types*

- The calculation of lightning risk about R1~R4 and Rx: Analyze the lightning location for each risk.
- (LPS) The protection measures about reducing the physical damage and human life, for example, installing lightning receiving devices, grounding grids, and grounding devices.
- The protection measures for reducing the lightning damage for electrical and electronic systems, for example, using metal shielding and installing SPD.

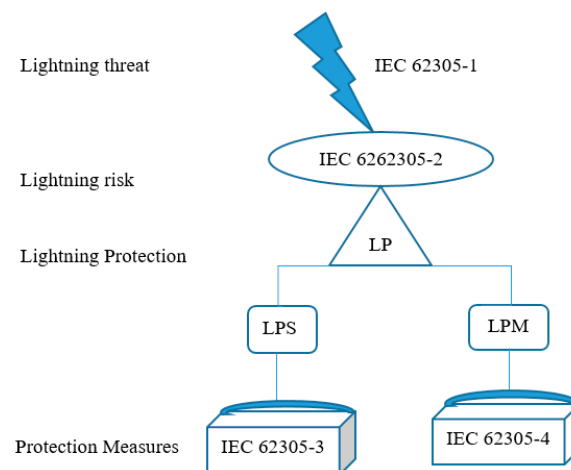

**Figure 1.** The introduction of IEC62305.

### 2.1. Lightning Risk

Lightning risk means the ratio of annual losses to the value of the protection. The formula is the multiplication of the number of annual lighting risks, the probability of structure damage, and the rate of lightning stroke loss. IEC62305-2 defines four types of risk and risk tolerances. The failure risk of a network component due to lightning stroke presents the probability that the lightning surge exceeds the withstood voltage [15]. Different lightning locations may cause different values of the risk, which includes touch voltage, step voltage, physical damage, and internal faults, as shown in Table 1. The types of lightning risk are as follows:

1. Risk of loss of human life in a structure (R1)
2. Risk of loss of service to the public in a structure (R2)
3. Risk of loss of cultural heritage in a structure (R3)
4. Risk of loss of economic value in a structure (R4)

The corresponding loss rates for various types of risks are as follows:

1. Loss of human life (L1)
2. Loss of service to the public (L2)
3. Loss of cultural heritage (L3)
4. Loss of economic value (L4)

The definitions of each lightning risk are as follows:

1. The lightning risk value of lightning striking the structure (S1):
  - a.  $R_A$ : Shock to living beings due to touch and step voltages (the distance from inside and outside of the structure is 3 m).
  - b.  $R_B$ : Fire and explosion effects inside the structure due to mechanical and thermal effects including dangerous sparking.
  - c.  $R_C$ : Failure of electrical and electronic systems due to LEMP on internal installations and incoming services.
2. The lightning risk value of lightning striking the ground near the structure (S2):
  - a.  $R_M$ : Failure of electrical and electronic systems due to LEMP on internal installations.
3. The lightning risk value of lightning striking services connected to the structure (S3):

- a.  $R_U$ : Injuries of living beings caused by touch voltage inside the structure due to lightning current injected into a line entering the structure.
  - b.  $R_V$ : Fire effects inside the structure due to mechanical and thermal effects including dangerous sparking between incoming lines and metal installations.
  - c.  $R_W$ : Failure of internal systems caused by overvoltage induced on incoming lines and transmitted to the structure.
4. The lightning risk value of lightning striking the ground near services connected to the structure (S4):
    - a.  $R_Z$ : Failure of electrical and electronic systems due to overvoltage induced on incoming lines and transmitted to the structure.

**Table 1.** The component of lightning risk value.

Lightning Strike Position		S1		S2		S3		S4		Tolerance
The Type of Risk		$R_A$	$R_B$	$R_C$	$R_M$	$R_U$	$R_V$	$R_W$	$R_Z$	
	R1	*	*	*	*	*	*	*	*	$10^{-5}$
	R2		*	*	*		*	*	*	$10^{-3}$
	R3		*				*			$10^{-3}$
	R4	*	*	*	*	*	*	*	*	$10^{-3}$

\*: lightning risk value for each type of risk.

## 2.2. The Principle of Risk Management

The risk management is the formula as follows:

$$R_X = N_X \times P_X \times L_X \quad (1)$$

where  $R_X$ : Lightning risk,  $N_X$ : Number of annual lightning risk,  $P_X$ : Probability of structure damage,  $L_X$ : Rate of lightning stroke loss

The rate of lightning stroke loss for the risk of human life and the risk of economic loss are different because the risk of human life considers time and number of people; the risk of economic loss considers animal considers the economic value, for example, animals, structures, and internal system. The comparison is shown in Table 2.

**Table 2.** The comparison of the rate of loss for R1 and R4.

Loss Type	Personal Injury Risk	Economic Loss Risk
$L_t$ (the percentage of the touch damage)		$\frac{c_a}{c_t}$
$L_f$ (the percentage of the physical damage)	$\left(\frac{n_z}{n_t}\right) \times \left(\frac{t_z}{8760}\right)$	$\frac{(c_a+c_b+c_c+c_s)}{c_t}$
$L_o$ (System failure loss rate)		$\frac{c_s}{c_t}$
$Lx = L_{(t,f,o)} \times r_a$ $r_a$ : revised coefficient	$n_z$ : the number of people in the zone. $n_t$ : the total number of people. $t_z$ : People at the place time	$c_a$ : the value for animal (\$) $c_b$ : the value for structure (\$) $c_c$ : the value for storage (\$) $c_t$ : the total value (\$) $c_s$ : the value for internal system (\$)

The data of lightning structure is complicated, which contains environment data, line data, zone data, and economic data.

## 2.3. Protective Measurements and Cost Saving

The tolerance is needed to be considered after calculating the risk, which is used to select the correct protective measures and saves cost. The introduction of protective measures and annual cost savings are as follows:

### 2.3.1. Protective Measures

If the risk value is higher than the tolerance, it may use the protective measures to reduce. The components of the risk value and the protective measures in IEC62305-2 are as shown in Table 3.

**Table 3.** The protective measures.

	Lightning Risk	Suggestions
S1	$R_A$ : (parameter definition has been mentioned before, please refer to Section 2.1)	Install LPS, Take protective measures (such as warning signs)
	$R_B$ : (ibid.)	Install LPS, Take protective measures (e.g., fire extinguishers)
	$R_C$ : (same as above)	Install SPD
S2	$R_M$ : (ibid.)	Install SPD, Improve circuit withstand voltage
	$R_U$ : (ibid.)	Install SPD, Take protective measures (such as warning signs)
S3	$R_V$ : (ibid.)	Install SPD, Modify line, shield, equipotential bonding
	$R_W$ : (ibid.)	Install SPD, Modify line, shield, equipotential bonding
S4	$R_Z$ : (ibid.)	Install SPD, Modify external line and entrance connections

### 2.3.2. Annual Cost Savings

The calculation process of the annual cost saving is as follows:

- (a) The annual cost before using protective measures (\$)

$$C_L = R4(\text{Before taking protective measures}) \times c_t \quad (2)$$

- (b) The annual cost after using protective measures (\$)

$$C_{RL} = R4(\text{After taking protective measures}) \times c_t \quad (3)$$

- (c) The annual cost of protective measures (\$)

$$C_{PM} = C_P \times (i + a + m) \quad (4)$$

- (d) The annual cost saving (\$)

$$S_M = C_L - (C_{RL} + C_{PM}) \quad (5)$$

where  $c_t$  is the total cost,  $C_P$  is the cost of protective measures,  $i$  is the percentage of the interest rate,  $a$  is the percentage of the depreciation rate,  $m$  is the percentage of the maintenance rate.


### 2.4. Design Process of the Lightning Risk

The flow diagram of design process of the lightning risk is shown in Figure 2 and the introduction is as follows:

- (1) Structure selection
- (2) Data collection

- (a) Structure diagram

- (b) Standard about the project
- (3) Parameter aggregation
  - (a) The environment data
  - (b) The structure data
  - (c) The line data
  - (d) The zone data
  - (e) The economic data
- (4) Input parameter of the risk
- (5) The computation of risk
  - (a) Risk of human life
  - (b) Risk of economic value
  - (c) Tolerance check
- (6) Protective measures selection
  - (a) Correct protective measures selection
  - (b) LPS and LPM conform to IEC Standard
  - (c) The structure is already protected

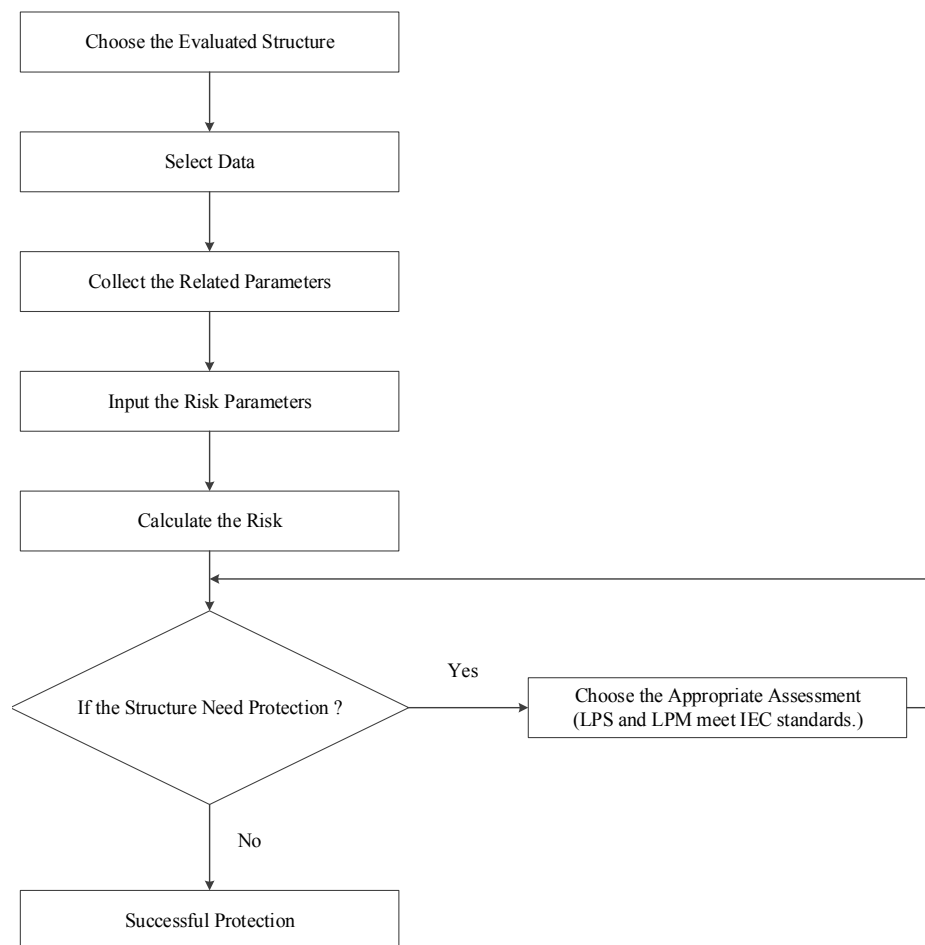

**Figure 2.** The flow diagram of design process of the lightning risk.

### 3. Simulation and Analysis for Lightning Risk

This paper evaluates the lightning risk based on the IEC62305 standard and uses Visual Basic (VB) to design a suitable graphical interface. For this simulation case, the length, width, and height of the building are 100 m, 50 m, and 15 m, respectively. There is another building, power line, and communication line around the building, as shown in Figure 3. This section will use the structure as an example to simulate the risk to human life and the risk to economic value. The setting values of the parameters refer to the data of IEC62305.

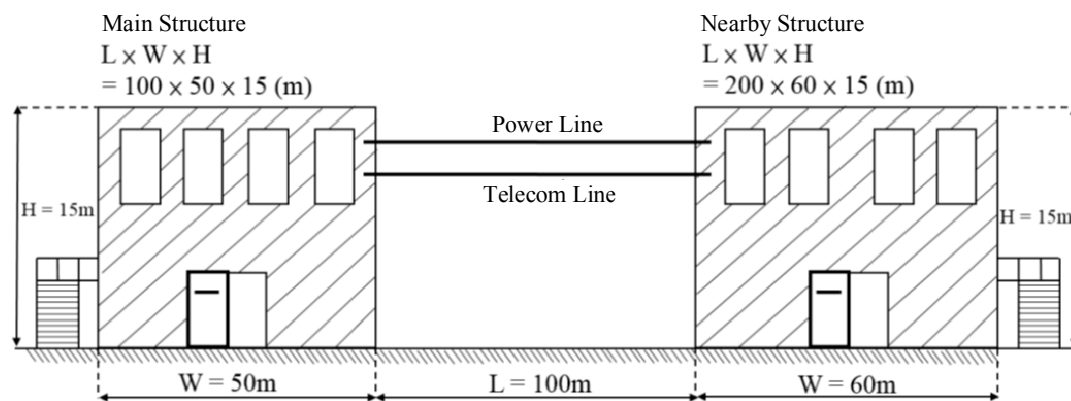


Figure 3. The simulation model.

#### 3.1. Risk Parameters Setting

Because the risk parameters are quite complicated, this paper uses Figures 4 and 5 to show the setting values of the risk parameters in the simulation.

1.Environment Data	2.Line Data	3.Zone Data	4.Economic Data	5.Loss	6.Protective Measures	7.Result
<b>Environment</b>						
$N_G$ (Lightning ground flash density)			4	1/km <sup>2</sup> /year		
<input checked="" type="checkbox"/> R1 <sub>T</sub> (Tolerable risk)			1	10 <sup>-5</sup>		
<input type="checkbox"/> R2 <sub>T</sub> (Tolerable risk)			1	10 <sup>-5</sup>		
<input type="checkbox"/> R3 <sub>T</sub> (Tolerable risk)			1	10 <sup>-5</sup>		
<input checked="" type="checkbox"/> R4 <sub>T</sub> (Tolerable risk)			100	10 <sup>-5</sup>		
$C_E$ (Environmental factor)			Urban			
<b>Structure</b>						
$L$ (Length of structure)			100	m		
$W$ (Width of structure)			50	m		
$H$ (Height of the structure)			15	m		
$L_J$ (Length of the adjacent structure)			200	m		
$W_J$ (Width of the adjacent structure)			60	m		
$H_J$ (Height of the adjacent structure)			15	m		
$K_{S1} \& K_{S2}$ (Screening effectiveness)			External & internal shields to the structure with $W_{m1}$ & $W_{m2}$		5	m
$C_D$ (Location factor)			Structure surrounded by objects of the same height or smaller			
$C_{DJ}$ (Location factor of an adjacent structure)			Structure surrounded by objects of the same height or smaller			

Figure 4. The environment data.

1.Environment Data	2.Line Data	3.Zone Data	4.Economic Data	5.Loss	6.Protective Measures	7.Result
<b>Power line</b>						
p(Ground resistivity)		2		$\Omega \cdot m$		
L <sub>L</sub> (Length of line section)		100		m		
U <sub>W</sub> (Withstand voltage of internal system)		4		kV		
C <sub>I</sub> (Installation factor)		Aerial				
C <sub>T</sub> (Line type factor)		HV power (with HV/LV transformer)				
C <sub>LD</sub> · C <sub>LI</sub> (External line type, Connectionat entrance)		Shielded aerial line, it not bonded to the same bonding bar as equipment				
P <sub>LD</sub> (Routing, shielding and bonding conditions)		Shield bonded to the same bonding bar as equipment and shield resistance RS ≤ 1Ω/km				
<b>Telecom or data line</b>						
p(Ground resistivity)		2		$\Omega \cdot m$		
L <sub>L</sub> (Length of line section)		100		m		
U <sub>W</sub> (Withstand voltage of internal system)		4		kV		
C <sub>I</sub> (Installation factor)		Aerial				
C <sub>T</sub> (Line type factor)		HV power (with HV/LV transformer)				
C <sub>LD</sub> · C <sub>LI</sub> (External line type, Connectionat entrance)		Shielded aerial line, it not bonded to the same bonding bar as equipment				
P <sub>LD</sub> (Routing, shielding and bonding conditions)		Shield bonded to the same bonding bar as equipment and shield resistance RS ≤ 1Ω/km				

Figure 5. The line data.

### 3.2. Result and Analysis

After inputting the risk parametera, the result of the simulation for risk to human life and risk to economic value are shown in Figures 6 and 7, respectively. In addition, the researchers verified the calculation program's accuracy with manual calculations, which gave the same results. Calculating the lightning risk using the IEC62305 standard is burdensome and takes time, and therefore to solve/simplify this for quick calculations we design this study as shown in Figures 4–10. The lightning risk calculation program with graphical user interface based on IEC62305 standard is discussed. A graphical user interface or calculation program can make work easy and save time because calculation lightning risk numerically or manually is complicated and takes time. It becomes easy and saves time when done with a calculation program.

1.Environment Data	2.Line Data	3.Zone Data	4.Economic Data	5.Loss	6.Protective Measures	7.Result
R1(Risk of loss of human life)		R2(Risk of loss of service to the public)		R3(Risk of loss of cultural heritage)		R4(Risk of loss of economic value)
R1	Value(10 <sup>-5</sup> )	Recommendations for improvement				
RA	0.066	None				
RB	19.889	PB(LPS) · rp(Fire protection)				
RC	0	None				
RM	0	None				
RU(P)	0.003	None				
RU(T)	0.003	None				
RV(P)	0.669	PEB(SPD at equipotential bonding)				
RV(T)	0.669	PEB(SPD at equipotential bonding)				
RW(P)	0	None				
RW(T)	0	None				
RZ(P)	0	None				
RZ(T)	0	None				
R1(Risk of loss of human life)	21.299					
R1 <sub>T</sub> (Tolerable risk)	1					
Need lightning protection?	Yes					

Figure 6. The risk of human life (R1).



1.Environment Data	2.Line Data	3.Zone Data	4.Economic Data	5.Loss	6.Protective Measures	7.Result
R1(Risk of loss of human life)	R2(Risk of loss of service to the public)	R3(Risk of loss of cultural heritage)	R4(Risk of loss of economic value)			
R4	Value(10 <sup>-5</sup> )	Recommendations for improvement				
RA	0	None				
RB	2486.173	PB(LPS) · rp(Fire protection)				
RC	40.591	PSPD(Coordinated SPDs)				
RM	0	None				
RU(P)	0	None				
RU(T)	0	None				
RV(P)	83.63	PEB(SPD at equipotential bonding)				
RV(T)	83.63	PEB(SPD at equipotential bonding)				
RW(P)	1.365	None				
RW(T)	1.365	None				
RZ(P)	0	None				
RZ(T)	0	None				
R4(Risk of loss of economic value)	2696.754					
R4 <sub>T</sub> (Tolerable risk)	100					
Need lightning protection?	Yes					

Figure 7. The risk of economic value (R4).

Parameter  $P$  means power line and  $T$  means communication line in the result of the simulation. Because the value of R1 is caused by  $R_B$  and  $R_V$ , and the value of R4 is caused by  $R_B$ ,  $R_C$ , and  $R_V$ , both are higher than the tolerance. Therefore, LPS and SPD are needed to install so as to reduce the value of the risk, as shown in Table 3. The protection measurements are as follows:

- (1) Corresponding with the lightning protection system of LPL I ( $P_B = 0.02$ ).
- (2) Corresponding with the lightning protection system of LPL III-IV ( $P_{EB} = 0.03$ ).

After using the protection measures, the value of risk to human life reduces from  $21.299 \times 10^{-5}$  to  $0.439 \times 10^{-5}$  and the value of risk of economic value reduces from  $2696.754 \times 10^{-5}$  to  $98.062 \times 10^{-5}$ , as shown in Figures 8 and 9. The results mean that the protection measures place the values of the risk below the tolerance.

This paper considers the annual cost savings. Assuming the cost of protection measures, the interest rate, the depreciation rate, and the maintenance rate are 150,000 \$, 4%, 5%, and 1%, respectively, by using Equations (2)–(5), the annual cost before using protective measures, the annual cost after using protective measures, the annual cost of protective measures, and the annual cost saving are \$925,000, \$33,635, \$15,000 and \$876,365, respectively.

1.Environment Data	2.Line Data	3.Zone Data	4.Economic Data	5.Loss	6.Protective Measures	7.Result
R1(Risk of loss of human life)		R2(Risk of loss of service to the public)		R3(Risk of loss of cultural heritage)		R4(Risk of loss of economic value)
R1		Value(10 <sup>-5</sup> )		Recommendations for improvement		
RA	0.001	None				
RB	0.398	None				
RC	0	None				
RM	0	None				
RU(P)	0	None				
RU(T)	0	None				
RV(P)	0.02	None				
RV(T)	0.02	None				
RW(P)	0	None				
RW(T)	0	None				
RZ(P)	0	None				
RZ(T)	0	None				
R1(Risk of loss of human life)	0.439					
R1 <sub>T</sub> (Tolerable risk)	1					
Need lightning protection?	No					

Figure 8. The R1 after using protection measures.

1.Environment Data	2.Line Data	3.Zone Data	4.Economic Data	5.Loss	6.Protective Measures	7.Result
R1(Risk of loss of human life)		R2(Risk of loss of service to the public)		R3(Risk of loss of cultural heritage)		R4(Risk of loss of economic value)
R4		Value(10 <sup>-5</sup> )		Recommendations for improvement		
RA		0		None		
RB		49.723		None		
RC		40.591		None		
RM		0		None		
RU(P)		0		None		
RU(T)		0		None		
RV(P)		2.509		None		
RV(T)		2.509		None		
RW(P)		1.365		None		
RW(T)		1.365		None		
RZ(P)		0		None		
RZ(T)		0		None		
R4(Risk of loss of economic value)		98.062				
R4 <sub>T</sub> (Tolerable risk)		100				
Need lightning protection?		No				

Figure 9. The R4 after using protection measures.

### 3.3. Summary

For the lightning risk, the selection of LPS, fire protection measures, and SPD are important. Because the protection measures are related to the cost, the main points for the calculation of the risk is as follows:

- (1) Main point for installation the lightning protection system (LPS)

LPS is associated with  $R_A$  and  $R_B$ , the functions are formulated as follows:

$$R_A = N_D \times (P_{TA} \times P_B) \times \left( \frac{r_t \times L_T \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (6)$$

$$R_B = N_D \times (P_B) \times \left( \frac{r_p \times r_f \times h_z \times L_F \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (7)$$

The functions show that the impact factor for  $R_A$  is  $P_{TA}$  (structure protection measure). If the frames of the structure are used to be the grounding grids, the value of  $P_{TA}$  is zero and the value of  $R_A$  is also zero. In addition, the impact factor  $R_B$  is  $r_f$  (the fire risk). If the structure is without fire load, the value of  $r_f$  and  $R_B$  is zero. Another case is when the fire load is below than 400 MJ/m<sup>2</sup>, the value of  $R_B$  will change to 0.001 so as to reduce the value of  $R_B$ . When the value of  $R_A$  and  $R_B$  are low, it means that the demand of LPS measure is not required.

- (2) Main point for installation the fire protection system

The fire protection measure is associated with  $R_B$  and  $R_V$ . The function of  $R_V$  is formulated as follows:

$$R_V = (N_L + N_{DJ}) \times (P_B \times P_{LD} \times C_{LD}) \times \left( \frac{r_p \times r_f \times h_z \times L_F \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (8)$$

For the value of  $R_V$ , the main point is  $C_{LD}$  (the type of external wire line and the factor of entrance connection) and  $r_f$ . If using lightning protected cable, equivalent potential connection or structure

without fire load, one of  $C_{LD}$  and  $r_f$  decrease to zero and  $R_V$  is also zero. When the value of  $R_B$  and  $R_V$  are low, it means that the fire protection measure demand is not required.

$$R_C = (N_D) \times (P_{SPD} \times C_{LD}) \times \left( \frac{L_O \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (9)$$

$$R_M = (N_M) \times (P_{SPD} \times P_{MS}) \times \left( \frac{L_O \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (10)$$

$$R_U = (N_L + N_{DJ}) \times (P_{TU} \times P_{EB} \times P_{LD} \times C_{LD}) \times \left( \frac{r_t \times L_T \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (11)$$

$$R_W = (N_L + N_{DJ}) \times (P_{SPD} \times P_{LD} \times C_{LD}) \times \left( \frac{L_O \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (12)$$

$$R_Z = (N_I) \times (P_{SPD} \times P_{LI} \times C_{LI}) \times \left( \frac{L_O \times \frac{n_Z}{n_t} \times t_z}{8760} \right) \quad (13)$$

### (3) Main point for installation SPD

The parameters associate SPD are  $R_C$ ,  $R_M$ ,  $R_U$ ,  $R_V$ ,  $R_W$ , and  $R_Z$ . The main point of  $R_V$  is discussed in Equation (2) and the other functions of risk are formulated as follows:

For the value of  $R_C$ ,  $R_U$ , and  $R_W$ , the main point is  $C_{LD}$ . If using lightning protected cable and equivalent potential connection,  $R_C$ ,  $R_U$ , and  $R_W$  can reduce to zero. For  $R_M$ , the main point is  $P_{MS}$ , which contains  $K_{S1}$  (the width of the external shielding),  $K_{S2}$  (the width of the internal shielding), and  $K_{S3}$  (the arrangement of internal wire). If the width of the shielding is decreased or the arrangement of wire uses shielding cable or let the wire in the metal tube, the value of  $R_M$  will reduce. For  $R_Z$ , the main point is  $C_{LI}$  (the type of internal wireline and the factor of entrance connection). If using shielded cable and has equivalent potential connection with the device, the value of  $R_Z$  can reduce to zero.

### (4) The Main point for lightning risk

Table 4 shows the condition that the value of risk parameter is zero. The demand of protection measure may decrease as the risk decreases.

**Table 4.** The main point for the lightning risk.

Main Factor	Lightning Risk	Improvement Results
$P_{TA}$ (Structure frame as a conductor)	$R_A = 0$	Reduced protection requirements for LPS
$r_f$ (No fire load)	$R_B = 0$	And fire protection measures reduce protection requirements for LPS
	$R_V = 0$	Reduced protection requirements for fire protection measures
$C_{LD}$ (Use lightning protection cables or wiring in lightning protection cable pipes, metal pipes, and equipotential bonding with equipment)	$R_C, R_U, R_V, R_W = 0$	Reduced protection requirements for SPD
	$R_V = 0$	Reduced protection requirements for fire protection measures
$C_{LI}$ (Use shielded cables and connect the device to the equipotential)	$R_Z = 0$	Reduced protection requirements for SPD

## 4. SPD Application

If a wireline connects SPD and device is too long, the voltage across the device may increase twice as originally due to overvoltage, electromagnetic oscillation, and effect of loop inductance so as to the device will damage. However, in response to the demand for increased the number of device installation, Taiwan Power Company hope to develop the smart grid and replace traditional E/M relay

by an intelligent electronic device (IED). This section uses EMTP to simulate and discuss the effect of loads and the connection distance on effective protection distance of SPD.

#### 4.1. Simulation Model

The simulation model is the low-voltage single-phase power system in this paper. The source, which is regarded as lightning surge current and SPD are in parallel. The surge current flows to load through the wireline, as shown in Figure 10. The model 1 is used to simulate case 1 to 3. Model 2, which adds the full-wave rectifier circuit, DC load, and capacitor  $6\mu\text{H}$ , used to simulate case 4, as shown in Figure 11.

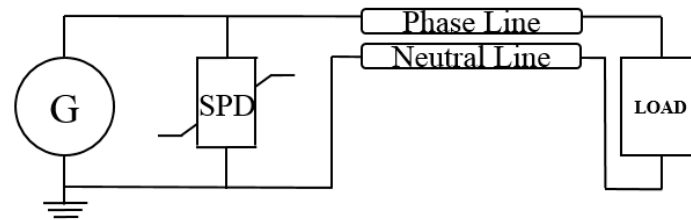


Figure 10. The low-voltage single-phase power system (Model 1).

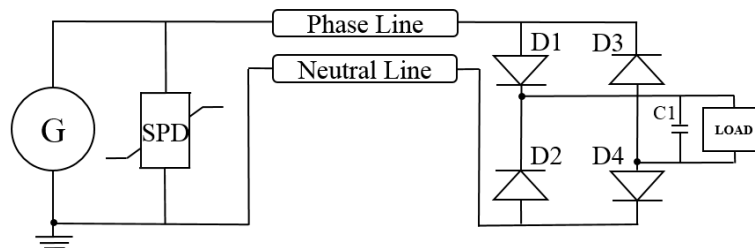


Figure 11. The low-voltage single-phase power system (Model 2).

The information of combination waveform to simulate lightning surge is that the open-circuit voltage is  $1.2/50\ \mu\text{s}$  and the short-circuit current is  $8/20\ \mu\text{s}$ . According to ANSI/IEEE Std. C62.41-2002 [16] and ANSI/IEEE Std. C62.42-2002 [17], the zone in the house can be divided into: (1) zone A contains all of the sockets and the distance from zone B is more than 10 m and from zone C is more than 20 m; (2) zone B contains feeders and the secondary switchboard; (3) zone C contains the main switchboard and the entrance wire. Zone A and B may be damaged by 6 kV voltage and zone C may be damaged by the voltage above 10 kV. Because this paper discusses an application for a house interior, the 6 kV/3 kA combination waveform is selected, as shown in Figures 12 and 13.


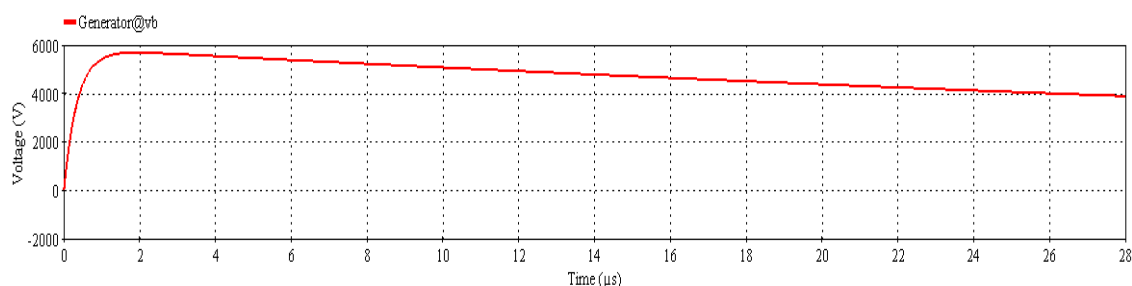


Figure 12. The open-circuit voltage waveform of 6 kV.

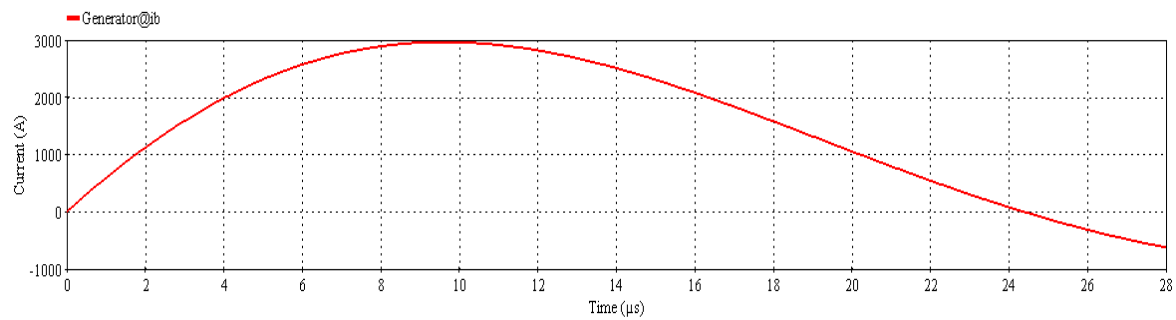

**Figure 13.** The short-circuit current waveform of 3 kA.

The wireline is a solid conductor and has no insulation tube. The diameter of metal-core is 1.6 mm and the thickness of metal layer 0.6 mm and the value of resistivity is  $1.724 \times 10^{-8} \Omega/\text{m}$ . The value of equivalent resistance, inductance and capacitance are  $0.008574 \Omega/\text{m}$ ,  $0.3145 \mu\text{H}/\text{m}$ , and  $42.069 \text{ pF}/\text{m}$ , respectively.

IEC60664-1 defines four types to correspond to the rated voltage ( $U_W$ ) of the device, as shown in Table 5: (1) class I is the location for the electronic equipment; (2) class II is the location for the residential appliances; (3) class III is the location for the distribution wires; (4) class IV is the location for the entrance wires. Above all,  $U_W$  is 1.5 kV and  $U_P$  of SPD is 1.2 kV in this simulation case.

**Table 5.** The withstand voltage of the device.

Type	IV	III	II	I
The value of tolerated voltage	6 kV	4 kV	2.5 kV	1.5 kV

#### 4.2. Test Cases

The load type in case 1 to three is a resistive load, capacitive load, and inductive load, respectively. The resistive load values include  $10 \Omega$ ,  $100 \Omega$ , and  $1000 \Omega$  and the open circuit. The value of inductive load contains  $1 \mu\text{H}$ ,  $10 \mu\text{H}$ , and  $100 \mu\text{H}$ . The value of inductive load includes  $1 \mu\text{H}$ ,  $10 \mu\text{H}$ , and  $100 \mu\text{H}$ . Using different distances between the load and SPD (1 m, 10 m, and 100 m) we examine whether the voltage exceeds the tolerated voltage. The results, in Table 6, show that the voltage will exceed the tolerated voltage. The load type in case 4 includes  $10 \Omega$ ,  $100 \Omega$ , and  $1000 \Omega$  and the open circuit. In addition, the discussion is same as the mentioned above. The results are shown in Table 7 and the values are all the maximum voltages of the load.

**Table 6.** The results in case 1 to 3 (Unit: V).

Case Load	Case 1 (Length of Wire = 1 m)	Case 2 (Length of Wire = 10 m)	Case 3 (Length of Wire = 100 m)
10 $\Omega$	1212.05	1193.49	992.28
100 $\Omega$	1216.17	1214.32	1195.81
1000 $\Omega$	1216.58	1453.3	1907.99
Open	1216.62	1730.47	2249.97
10 pF	1220.96	1968.07	2461.42
$10^3$ pF	1667.46	2175.54	2309.93
$10^5$ pF	1833.63	2239.96	2269.48
1 $\mu\text{H}$	516.38	176.06	134.42
10 $\mu\text{H}$	1111.55	984.73	933.4
100 $\mu\text{H}$	1204.96	1609.92	2308.85

**Table 7.** The results in case 4 (Unit: V).

Case Load	(Length of Wire = 1 m)	(Length of Wire = 10 m)	(Length of Wire = 100 m)
10 $\Omega$	1720.74	1926.53	669.13
100 $\Omega$	1763.44	2078.67	806.97
1000 $\Omega$	1767.82	2095.14	824.07
Open	1768.31	2096.98	826.19

#### 4.3. Results Comparison

The results in case 1 are as follows: for the resistive load, the length of the wire is too short so that the value of resistance is small and the changes in the load hardly effect the tolerated voltage of the device, which means the voltage of the device and SPD are same. For the capacitive load, the oscillation is found although the length of wire is only 1 m. As the value of capacitor increases, the amplitude of the oscillation increases but the frequency of the oscillation decreases. For the inductive load, the voltage of the device is equal to half of the residual voltage of SPD, when the value of inductance is small. The voltage of the device approaches the residual voltage of SPD (1200 V) only if the value of inductance increases.

The results in case 2 are as follows: for the resistive load, the oscillation is found when the value of resistance increases. The voltage of the device is 1453 V when the load is greater than 1000  $\Omega$ . If the voltage exceeds the tolerated voltage, the device will be broken. For the capacitive load, all the values of voltage are greater than the voltage limit. As the value of capacitor increases, the amplitude of the oscillation increases but the frequency of the oscillation decreases. For the inductive load, the oscillation is found when the value of inductance increases. The voltage of the device is 1609.92 V when the load is 100  $\mu\text{H}$ . If the voltage exceeds the rated voltage, the device will be broken.

The results in case 3 are as follows: for the resistive load, as the value of resistance increases, the amplitude of the oscillation increases but the frequency of the oscillation decreases. The voltage of the device is 1907.99 V when the load is 1000  $\Omega$ . For the capacitive load, the value of capacitance increases as the voltage of device decreases. For the capacitive load, as the value of inductance increases, the amplitude of the oscillation increases but the frequency of the oscillation decreases. The voltage of the device is 2308.85 V when the load is 100  $\mu\text{H}$ . If the voltage exceeds the tolerated voltage, the device will be broken.

After the comparison of each case, increasing the length of the wire may cause the results to change as follows: for the resistive load, the voltage of the device and the amplitude of the oscillation will increase but the frequency of the oscillation will decrease. For the capacitive load, when the voltage increases, the amplitude of the oscillation will decrease, but the voltage increases only if the inductance is 100  $\mu\text{H}$ .

The results in case 4 are as follows: when the value of the resistance increases, the voltage of the device only increases slightly. For 1 m length of the wire, the resistance of the load is 10  $\Omega$  can destroy the device. For 100 m length of the wire, the device can be protected by SPD. In addition, when the load is constant, when the length of wire increases, the voltage of the device will increase at first and then decrease.

## 5. Conclusions

The user interface in this paper offers a calculation of lightning risk and it based on the IEC62305 standard. To achieve the most economical protection design for a structure, additional protection measures and annual savings are considered. In order to improve the benefits of SPD installation, the low-voltage single-phase power system is simulated in this paper and the test cases are used to discuss the effective protection distance of SPD. The results indicate that the changes in the type

of loads and the connection distance will affect the effectiveness of SPD. Therefore, the correct SPD installation and the selection of the distance can protect the device and lower the cost.

The results show that after using the protective measures, the value of the risk to human life reduces from  $21.299 \times 10^{-5}$  to  $0.439 \times 10^{-5}$  and the value of the economic value risk reduces from  $2696.754 \times 10^{-5}$  to  $98.062 \times 10^{-5}$  meaning that the protection measures set the values of the risk below the tolerance. Considering the annual cost savings, we assume the cost of protection measures, the interest rate, the depreciation rate, and the maintenance rate are \$150,000, 4%, 5%, and 1%, respectively. The annual cost before using protective measures, the annual cost after using protective measures, the annual cost of protective measures, and the annual cost savings are \$925,000, \$33,635, \$15,000, and \$876,365, respectively. Consequently, it is feasible that the simulation result can provide users with good suggestions to choose the best installation location and achieve the most effective protection design.

Manually/analytically, calculating the lightning risk using IEC62305 standard is burdensome and takes time, so to address this problem we use Visual Basic (VB) to design a suitable Graphical user interface and a calculation program has been designed and it can make the task easy and save time.

**Author Contributions:** C.-H.L. and Y.B.M.; Software, Writing—original draft and review & editing, Investigation, Software validation, Data curation and Validation; Y.-T.C., Conceptualization, Software edition, Writing—graphical editing; C.-C.K.; Methodology, Writing—review & editing, Leading and commenting the team; H.-Y.C.; Software validation, Methodology, Data curation

**Funding:** This research received no external funding.

**Conflicts of Interest:** The authors declare no conflicts of interest.

## References

1. Mounir, M.M.; Mahmoud, A.E. Development of Lightning Risk Assessment Software in Accordance with IEC 62305-2. In Proceedings of the 2013 International Conference on Computing, Electrical and Electronic Engineering (ICCEEE), Khartoum, Sudan, 26–28 August 2013.
2. Christodoulou, C.A.; Vita, V.; Maris, T.I. Lightning protection of distribution substations by using metal oxide gapless surge arresters connected in parallel. *Int. J. Power Energy Res.* **2017**, *1*, 1–7. [\[CrossRef\]](#)
3. Trainba, M.; Christodoulou, C.A.; Vita, V.; Ekonomou, L. Lightning overvoltage and protection of power substations. *WSEAS Trans. Power Syst.* **2017**, *12*, 107–114.
4. Bouquegneau, C.; Lecomte, P. New Lightning Protection Standardization Trends for the Lightning Risk Assessment; Use of the Risk Multilingual 3 Software. In Proceedings of the 2010 Asia-Pacific International Symposium on Electromagnetic Compatibility, Beijing, China, 12–16 April 2010.
5. Shariatinasab, R.; Safar, J.G.; Mobarakeh, M.A. Development of an adaptive neural-fuzzy inference system based meta-model for estimating lightning related failures in polluted environments. *IET Sci. Meas. Technol.* **2014**, *8*, 187–195. [\[CrossRef\]](#)
6. Shariatinasab, R.; Vahidi, B.; Hosseini, S.H. Statistical evaluation of lightning-related failures for the optimal location of surge arresters on the power networks. *IET Gen. Transm. Distrib.* **2009**, *3*, 129–144. [\[CrossRef\]](#)
7. Martinez, J.A.; Castro-Aranda, F. Lightning performance analysis of overhead transmission lines using the EMTP. *IEEE Trans. Power Deliv.* **2005**, *20*, 294–300. [\[CrossRef\]](#)
8. Karampelas, P.; Ekonomou, L.; Panetsos, S.; Chatzarakis, G.E. LPAT: An interactive simulation tool for assessing the lightning performance of Hellenic high voltage transmission lines. *Appl. Soft Comput.* **2011**, *11*, 1380–1387. [\[CrossRef\]](#)
9. Orille-Fernández, Á.L.; Khalil, N.; Rodríguez, S.B. Failure Risk Prediction Using Artificial Neural Networks for Lightning Surge Protection of Underground MV Cables. *IEEE Trans. Power Deliv.* **2006**, *21*, 1278–1282. [\[CrossRef\]](#)
10. IEC. *Low-Voltage Surge Protective Devices: Surge Protective Devices Connected to Low-Voltage Power Distribution Systems—Selection and Application Principles*; IEC 61643-12; IEC: Geneva, Switzerland, 2008.
11. IEC. *Insulation Coordination for Equipment within Low-Voltage Systems—Principles, Requirements and Tests*; IEC 60664-1; IEC: Geneva, Switzerland, 2002.

12. IEC. *Testing and Measurement Techniques—Surge Immunity Test*; IEC61000-4-5; IEC: Geneva, Switzerland, 2010.
13. IEC. *Protection against Lightning—Part 1–4*; IEC 62305; IEC: Geneva, Switzerland, 1995.
14. Stefanescu, S.; Botezan, A. Overview of the Protection Lightning Standards Suite EN/IEC 62305. In Proceedings of the 2016 International Conference and Exposition on Electrical and Power Engineering (EPE), Iasi, Romania, 20–22 October 2016.
15. *IEEE Guide on the Surge Environment in Low-Voltage (1000 V and Less) AC Power Circuits*; ANSI/IEEE Std. C62.41.1-2002; IEEE Standard Association: Piscataway, NJ, USA, 2002.
16. *IEEE Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits*; ANSI/IEEE Std. C62.41.2-2002; IEEE Standard Association: Piscataway, NJ, USA, 2002.
17. *IEEE Guide for the Application of Surge-Protective Components in Surge Protective Devices and Equipment Ports—Part 2 Metal-Oxide Varistors (MOVs)*; ANSI/IEEE Std. C62.42.2-2002; IEEE Standard Association: New York, NY, USA, 2016.



© 2018 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).