

Article

Fire Test on Insulated Steel Beams with Fire-Protection Coating and Fiber Cement Board

Weihua Wang ¹, Tao Zhu ¹, Xian Gao ², Jingjie Yang ^{1,*}, Xilong Chen ² and Weiyong Wang ³

¹ College of Civil Engineering, Huaqiao University, Xiamen 361021, China; whwang@hqu.edu.cn (W.W.); ztyds8@126.com (T.Z.)

² State Grid Fujian Electric Power Co., Ltd., Economic and Technical Research Institute, Fuzhou 350011, China; groadx@126.com (X.G.); 17720765445@163.com (X.C.)

³ College of Civil Engineering, Chongqing University, Chongqing 400044, China; wywang@cqu.edu.cn

* Correspondence: jjyang@hqu.edu.cn

Abstract: Fire safety design for steel beams is crucial in the construction of steel structures. However, there remains a significant gap in the fire resistance testing of insulated steel beams. This study focuses on full-scale experimental research examining the fire resistance performance of steel beams with varying fire protection methods, cross-sectional dimensions, and heating curves. During the tests, the furnace temperature, specimen temperature, and deflection at mid-span were measured. The test results indicated that specimens mainly failed in lateral–torsional buckling. Additionally, a markedly non-uniform temperature distribution was observed across the cross-section, and the predictions made by GB 51249-2017 were found to be unsafe. The use of fiber cement board for fire protection may be ineffective, as it tends to become brittle at elevated temperatures, making it susceptible to breakage and detachment when the beams begin to bend. Furthermore, due to potential creep deformation, specimens subjected to longer heating durations exhibited lower critical temperatures compared to those with shorter heating durations. Finally, the design method outlined in BS EN 1993-1-2 and ANSI/AISC 360-22 was evaluated against the test results, indicating an accurate prediction of these methods for specimens with shorter heating durations, but an unconservative prediction for specimens with longer heating durations due to ignorance of creep deformation.



Academic Editor: Krishanu Roy

Received: 20 May 2025

Revised: 12 June 2025

Accepted: 16 June 2025

Published: 18 June 2025

Citation: Wang, W.; Zhu, T.; Gao, X.; Yang, J.; Chen, X.; Wang, W. Fire Test on Insulated Steel Beams with Fire-Protection Coating and Fiber Cement Board. *Buildings* **2025**, *15*, 2121. <https://doi.org/10.3390/buildings15122121>

Copyright: © 2025 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

Keywords: fire resistance; steel beams; fire-protection; fire tests; fire-safety design; creep deformation

1. Introduction

1.1. Research on the Fire-Resistance of Beams

The mechanical properties of steel are significantly reduced at elevated temperatures, so it is worth studying the fire performance of steel beams in a fire [1–5]. Burgess et al. [6] investigated the structural behavior of steel beams in a fire using the secant stiffness method and emphasized the importance of the shielding effect provided by concrete slabs. Liu et al. [7] conducted fire resistance tests on axially restrained steel beams and discovered that catenary action is more pronounced in scenarios with lower load levels and higher axial restraint. Yin and Wang [8] utilized ABAQUS to simulate the large deflection behavior of restrained steel beams in a fire, building on the tests conducted by Liu et al. [7]. Their numerical research [8] indicated that adequate axial restraint enables beams to endure indefinitely through catenary forces. Li and Guo [9] performed fire tests on restrained beams

during both the heating and cooling stages, demonstrating that restrained steel beams exhibit superior fire-resistant capabilities compared to isolated steel beams in both phases.

In addition to axial restraint, rotational restraint is a crucial factor that influences the fire resistance of steel beams. Tan and Huang [10,11] investigated the impact of semi-rigid connections on the fire resistance of steel beams through finite element (FE) analysis. Their findings indicated that rotational restraints increase critical temperatures, while axial restraints decrease them. Given the growing demand for fire-resistant design in steel structures, the design methodologies for restrained steel beams in fire scenarios are becoming increasingly significant. Dwaikat and Kodur [12] proposed a simplified method to predict internal forces and deflections in restrained beams at elevated temperatures, introducing a three-stage response model (elastic, elastoplastic, and catenary) that was validated against FE simulations. Creep deformation is another critical factor affecting the fire resistance behavior of steel beams. Kodur and Dwaikat [13] and Al-azzani et al. [14] analyzed the effects of high-temperature creep using ANSYS 12.0, demonstrating that neglecting creep results in unconservative predictions, as creep accelerates deflections and reduces restraint forces during rapid heating or under high stress.

In recent years, as steel structures have become increasingly complex, lightweight, and high-quality, there has been a growing body of research focused on the fire resistance of steel beams. Shakil et al. [15] simulated steel beams subjected to traveling fire and identified a five-stage failure mechanism, highlighting the roles of cyclic axial forces and catenary action. Nguyen et al. [16] examined the buckling behavior of I-beams under combined transverse loads and negative end moments during fire exposure. Lam and Rodrigues [17] and Couto et al. [18] investigated the fire resistance of cold-formed steel beams, emphasizing the impact of local buckling. Additionally, Xie et al. [19], Kucukler [20], Pournaghshband et al. [21], and Shaheen et al. [22] explored the fire resistance of stainless steel beams, noting the influence of material properties.

However, the aforementioned research primarily focuses on steel beams without fire protection, and there remains a significant gap in the study of fire-protected steel beams. In an engineering application, fire-retardant coating, intumescent coating, and fiber cement board are commonly used protection methods, as shown in Figure 1. The cost of intumescent coatings is slightly higher, and the service life of intumescent coatings is short (about 5–10 years), and renovation may produce discarded coatings; the service life of fire-retardant coatings is 15–20 years, but these types of coatings are difficult to remove. In the process of use, intumescent coatings are easily affected by humidity, and the integrity of the intumescent layer needs to be checked regularly, while fire-retardant coatings are highly weather-resistant and have a long maintenance cycle.

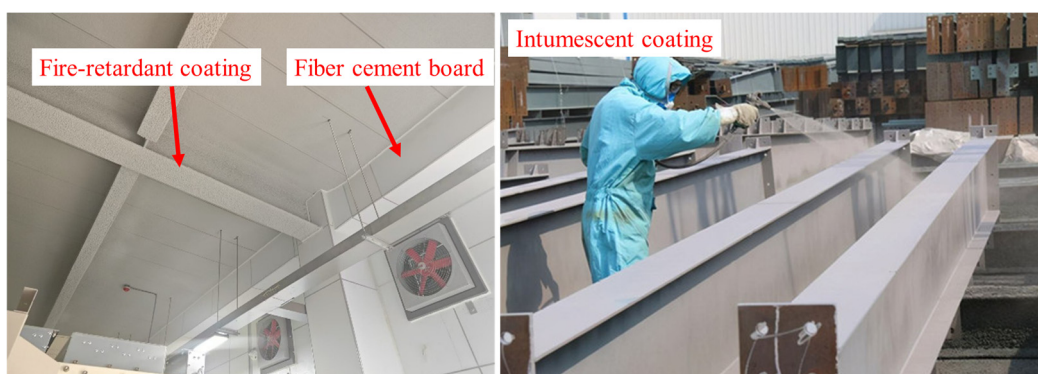


Figure 1. Application of fire protection methods.

Furthermore, due to the relatively high costs associated with full-scale fire tests, most research has concentrated on numerical simulations and analytical studies. This paper

focuses on full-scale fire tests on fire-protected steel beams, taking into account various cross-sectional dimensions, heating curves, and types of fire protection.

1.2. Calculation Method from GB 51249-2017

According to the Chinese specification (GB 51249-2017) [23] on the fire resistance of steel beams, the ultimate moment (M_T) of the steel beams at elevated temperatures can be calculated using the Load-Bearing Capacity Method, as described in Equation (1).

$$M_T = f_T \varphi_{bT} W \quad (1)$$

where f_T denotes the designed steel strength at T °C, φ_{bT} denotes the stability coefficient of beams at T °C, and W denotes the cross-section modulus. It should be noted that the φ_{bT} is a temperature-dependent coefficient, and can be calculated by GB 50017 [24] and GB 51249 [23]. Thus, the ultimate moment (M_T) versus temperature curves can be determined by Equation (1), and the critical temperature (T_{cr}) can be calculated. Equations (2) and (3) show the reduction factors of the yield strength (η_{sT}) and elastic modulus (χ_{sT}) at elevated temperatures, as specified in GB 51249-2017 [23].

$$\eta_{sT} = \begin{cases} 1.0 & 20^\circ\text{C} \leq T_s \leq 300^\circ\text{C} \\ 1.24 \times 10^{-8} T_s^3 - 2.096 \times 10^{-5} T_s^2 + 9.228 \times 10^{-3} T_s - 0.2168 & 300^\circ\text{C} < T_s < 800^\circ\text{C} \\ 0.5 - T_s/2000 & 800^\circ\text{C} \leq T_s \leq 1000^\circ\text{C} \end{cases} \quad (2)$$

$$\chi_{sT} = \begin{cases} \frac{7T_s - 4780}{6T_s - 4760} & 20^\circ\text{C} \leq T_s < 600^\circ\text{C} \\ \frac{1000 - T_s}{6T_s - 2800} & 600^\circ\text{C} \leq T_s < 1000^\circ\text{C} \end{cases} \quad (3)$$

Since steel structures are typically insulated by various fire protection measures, it is essential to calculate the steel temperature while taking these protections into account. The Chinese specification GB 51249 [23] provides a method for evaluating the steel temperature during a fire, as indicated by Equation (4):

$$\Delta T_s = \alpha \frac{1}{\rho_s c_s} \frac{F_i}{V} (T_g - T_s) \Delta t \quad (4)$$

where ρ_s and c_s denote the density and specific heat of steel, respectively; F_i/V denotes the shape factor of the cross-section; T_s and T_g denote the steel and air temperature; ΔT_s and Δt denote the incremental temperature and time.

In Equation (4), the coefficient α represents the comprehensive heat transfer coefficient. If the steel structure was protected by an intumescent coating, α can be calculated by Equation (5):

$$\alpha = \frac{1}{R_i} \quad (5)$$

where R_i denotes the equivalent thermal resistance of the intumescent coating. In addition, if the steel structure was protected by a fire-retardant coating, α could be calculated by Equation (6):

$$\alpha = \frac{\lambda_p}{d_p} \quad (6)$$

where λ_p and d_p denote the equivalent thermal conductivity and thickness of the coating. Based on Equation (4), the relationship between the temperature of the steel and the heating time can be established, allowing for the determination of fire resistance (t_{cr}).

2. The Specimens

Q355 steel was utilized in the manufacturing of the beams, and the actual material properties of the steel were determined through tensile tests, as summarized in Table 1. It can be observed that, although different steel thicknesses were employed for the beams' web and flange, the variation in yield strength is minimal, ranging from 398 MPa to 410 MPa, with an average value of 404 MPa.

Table 1. Material properties.

Labels	Yield Strength /MPa	Average Yield Strength/MPa	Ultimate Strength /MPa	Average Ultimate Strength/MPa
C-8-1	401.6	401.7	549.4	549.6
C-8-2	402.5		549.6	
C-8-3	401.0		549.7	
C-12-1	403.0	406.0	542.6	539.6
C-12-2	410.3		538.2	
C-12-3	404.8		538.1	
C-20-1	405.9	404.5	564.6	563.8
C-20-2	398.2		563.9	
C-20-3	409.3		562.8	

The steel beams were fabricated from hot-rolled H-sections, and their nominal dimensions are presented in Figure 2. The full length, effective length, and heating length of the specimens are 6000 mm, 5600 mm, and 4500 mm, respectively, as illustrated in Figure 2. Two concentrated loads (F) are applied at the mid-span of the beam, with a spacing of 1200 mm. According to Chinese standards for steel structures (GB 50017-2017 [24]), the load-bearing capacities of the steel beams with cross-sections of HN 400 $\times$ 200 $\times$ 8 $\times$ 12 and HN 588 $\times$ 300 $\times$ 12 $\times$ 20 are 108 kN and 360 kN, respectively. Assuming an identical load ratio of 0.3 for the steel beams, the loads applied to specimen D-1 and the other specimens were 36 kN and 120 kN, respectively.

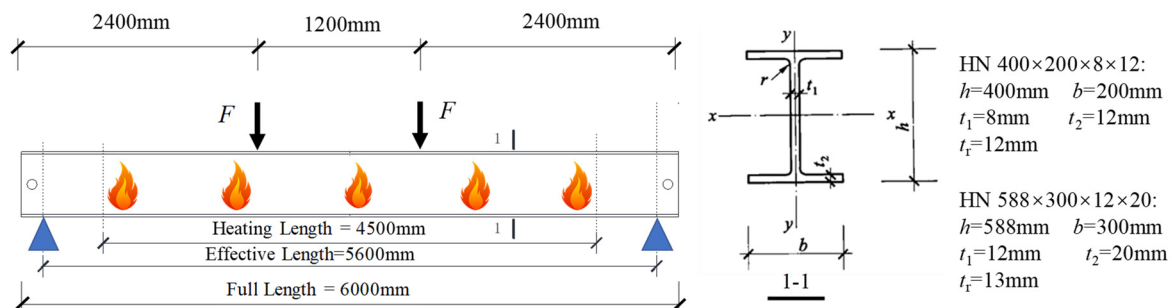


Figure 2. Dimension of the cross-section.

Different fire protection methods were employed, including fire-retardant coatings, fiber cement boards, and intumescent coatings, as illustrated in Table 2. According to information provided by the fire protection supplier, the equivalent thermal conductivity (λ_i) of the fire-retardant coating and fiber cement board is 0.08 and 0.12 W/(m·K), respectively. Additionally, the equivalent thermal resistance (R_i) of the intumescent coating is approximately 0.08 and 0.14 m²·K/W for coating thicknesses of 1.5 mm and 2.5 mm, respectively. To achieve specific fire resistance ratings, such as t_{cr} = 60 min or t_{cr} = 120 min, the required thickness of the fire protection can be calculated using Equations (1)–(4), as summarized in Table 2.

Table 2. Specimen labels.

Labels	Dimensions /mm	Heating Curves	Fire Protections	Thickness /mm	Applied Load /kN	T_{cr} /°C	t_{cr} /min
D-1	HN 400 × 200 × 8 × 12	EFC	FRC	20	36	676	120
D-2	HN 588 × 300 × 12 × 20	EFC	FRC	15	120	661	120
D-3	HN 588 × 300 × 12 × 20	EFC	FCB	20	120	661	120
D-4	HN 588 × 300 × 12 × 20	EFC	IC	1.5	120	661	60
ISO-1	HN 588 × 300 × 12 × 20	ISO-834	FRC	12	120	661	120
ISO-2	HN 588 × 300 × 12 × 20	ISO-834	IC	2.5	120	661	120

Note: EHC means “electrical heating curve”, FRC means “fire-retardant coating”, FCB means “fiber cement board”, and IC means “intumescent coating”.

Concerning the purpose of the test parameters, specimens D-1 and D-2 are compared to investigate the influence of shape factors on fire resistance; specimens D-2, D-3, and D-4 are compared to investigate the protective effectiveness of the different fire protection methods; specimens D-3 with ISO-1 are compared to investigate the influence of the heating curves; and specimens D-4 with ISO-2 are compared to investigate the influence of heating duration (i.e., creep deformation).

(1) Implementation of the fire-retardant coating

Before applying the fire-retardant coating, the surface of the steel beam was de-rusted and polished. Subsequently, a primer for the fire-retardant coating, approximately 2–3 mm thick, was initially sprayed onto the surface to enhance adhesion. Given that the heating length of the beams is 4500 mm, the length of the fire-retardant coating was set to 5000 mm to ensure that the heated section is adequately protected. Although the steel beam was exposed to fire on three sides, the coating was also applied to the upper surface of the steel beam. After the base coating was completely dry, subsequent layers were applied until the target thickness was achieved, with each layer measuring between 5 and 10 mm. An interval of no less than 24 h was maintained between each application to ensure that the fire-retardant coating was fully dry. Once the total thickness reached 10 mm, a layer of fiber mesh (Figure 3a) was added to enhance the adhesion of the fire-retardant coating. When the target thickness was achieved, the surface was scraped flat to prevent variations in fire resistance caused by uneven coating, as illustrated in Figure 3b.

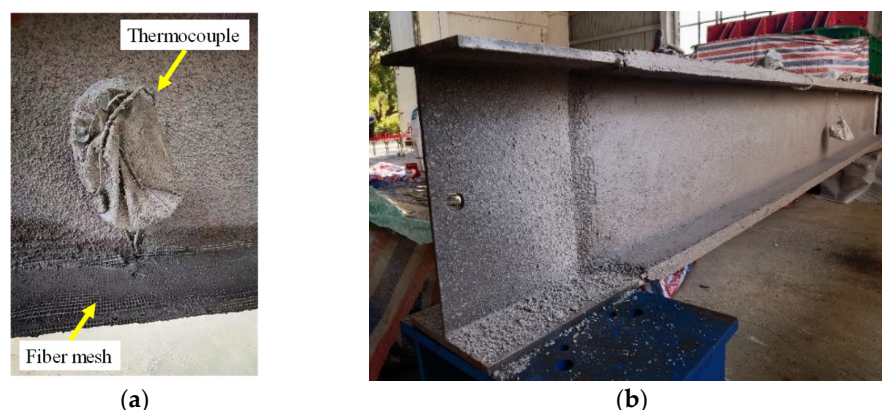


Figure 3. Construction for the fire-retardant coating: (a) fiber mesh and (b) finished specimens.

(2) Implementation of the cement fiber fireproof board

Two cement fiber fireproof boards measuring 340 × 2500 × 20 mm and four boards measuring 620 × 2500 × 20 mm were utilized for fire protection construction, as indicated in Figure 4. First, thin-walled angle steel with dimensions of 30 × 30 mm was welded to the flange of the steel beam to create a longitudinal frame keel. Next, transverse keels were

installed every 1 m on the outer side of the lower flange, secured to both the longitudinal frame keels and the steel beam through welding. The longitudinal keels were employed to secure the fireproof boards on the left and right sides of the steel beam, while the transverse keels were used to anchor the fireproof panels at the bottom of the steel beam. As the steel beam was exposed to fire on three sides, the upper flange remained unprotected by fireproof boards. The fireproof boards and keels were connected using self-tapping screws. The self-tapping screw nuts were embedded into the board at approximately 1 cm, and the fire-retardant coating was applied to the screw holes to cover the nuts.

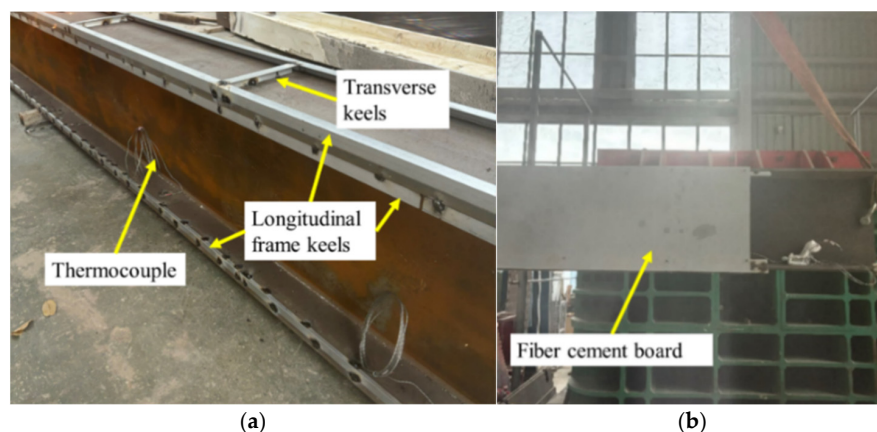


Figure 4. Construction for the cement fiber fireproof board: (a) installation of keels and (b) finished specimens.

(3) Implementation of the intumescent coating

First, the surface of the steel beam must be de-rusted and polished, ensuring that any dust, floating rust, oil stains, and other contaminants are removed to prevent interference with the adhesion of the intumescent coating. Prior to applying the intumescent coating, a layer of anti-rust primer compatible with the intumescent coating should be applied, and the primer must be allowed to dry completely for at least 12 h, as indicated in Figure 5a. During the application of the intumescent coating, the thickness of each coat should not exceed 0.2 mm, and the interval between coats must be greater than 24 h. The subsequent coat should only be applied once the surface of the previous coat is fully air-dried, until the target total thickness is achieved. Since the total coating thickness does not exceed 3 mm, there is no need to incorporate fiberglass mesh to enhance adhesion. After each layer of coating is applied and the surface is dry, an electronic thickness gauge should be used to measure the actual thickness of the intumescent coating at various locations, as indicated in Figure 5b. Any areas that do not meet the thickness requirements must be recoated to ensure a uniform distribution of the intumescent coating.

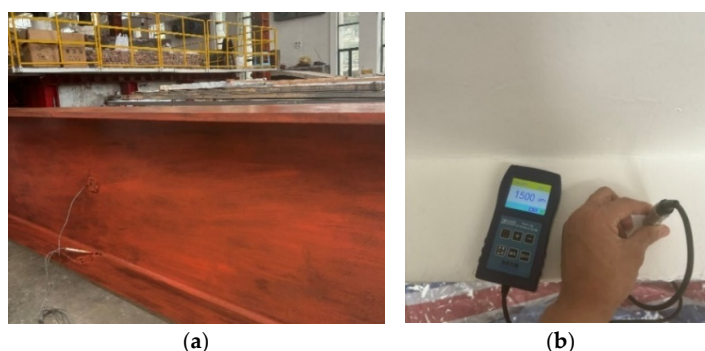


Figure 5. Construction for the intumescent coating: (a) anti-rust primer and (b) electronic thickness gauge.

3. Test Set-Up

Figure 6 illustrates the fire resistance test set-up for the steel beams, where elevated temperatures were generated through natural gas combustion. The beams were simply supported and torsion-restrained against the wall of the fire test furnace. Two concentrated loads were applied at the midpoint of the beam span, with a distance of 1200 mm between them. These concentrated loads were applied using hydraulic actuators, which were anchored to the reaction girder and connected to the upper flange of the beam via a connection stud. Since steel beams in engineering applications are typically exposed to fire on three sides, fireproof boards were necessary to shield the outer surface of the upper flange from direct heating. To enhance the reuse rate of the fireproof boards, high-temperature-resistant aluminum silicate fiber cotton was employed to repeatedly wrap the covers. Additionally, aluminum silicate fiber was utilized to fill the gap between the specimen and the furnace wall, ensuring that the high temperatures within the furnace do not escape.

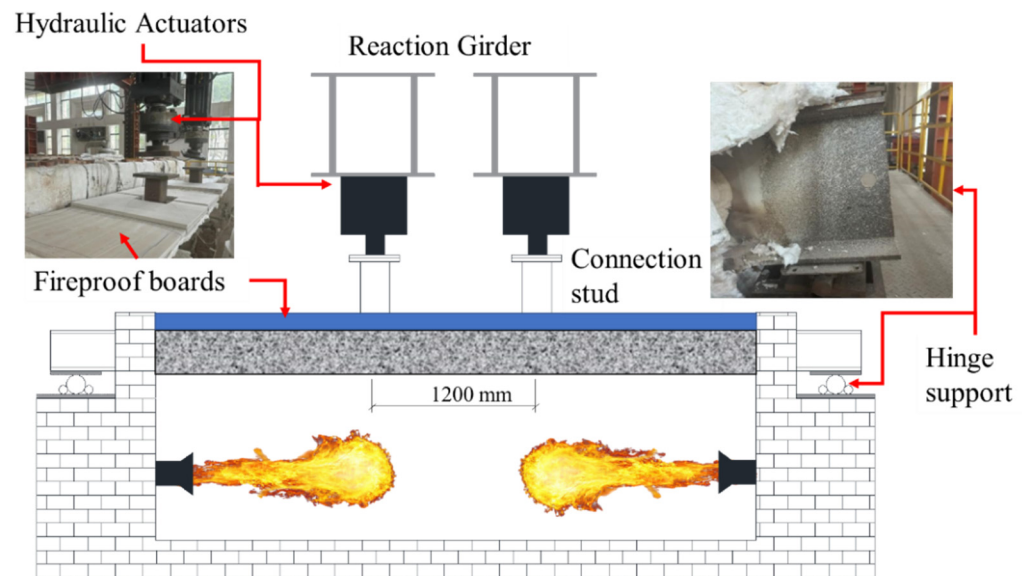


Figure 6. Test set-up.

Five thermocouples, labeled T_{F1} – T_{F5} , were arranged to record the temperatures within the furnace. These thermocouples were strategically fixed near the flame nozzle to prevent direct exposure to the flame, as illustrated in Figure 7. In addition to furnace temperature, specimen temperatures were measured at three distinct sections of the steel beam. In each section, four thermocouples were arranged to monitor the temperature of the upper flange, the mid-point of the web, the underside of the web, and the lower flange, as depicted in Figure 7. In the test, a linear variable displacement transducer (LVDT) was used to measure the deflection of the steel beam at mid-span. The LVDT was fixed on an independent scaffold and connected to the upper flange of the steel beam through a nickel–chromium alloy wire, as indicated in Figure 8.

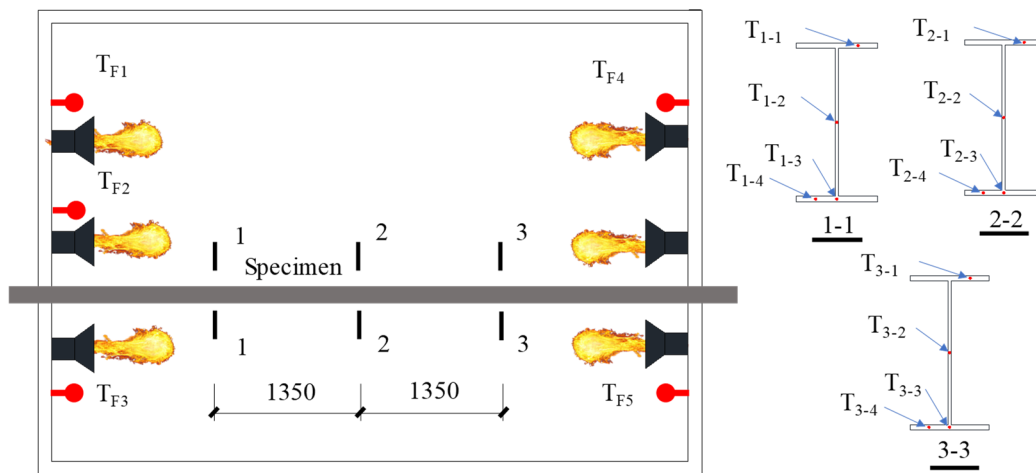


Figure 7. Arrangement of the thermocouples.



Figure 8. Arrangement of the LVDT.

4. Test Program

After the installation of the specimens and measurements, the two concentrated loads at mid-span were gradually applied to the steel beams. Since both actuators shared the same hydraulic oil source, the hydraulic pressure they generated remained constant. During the loading process, it was essential to monitor the stability of the connection between the loading device and the connecting components. A laser level was used to assess whether the connection between the loading device and the steel beam was horizontal and balanced. If it was not, the steel beam was readjusted after unloading, until it was positioned horizontally.

Two heating curves were utilized in the tests: one is the ISO-834 [25] standard heating curve, and the other is the electrical heating curve [26]. The temperature evolution methods for these two curves are presented in Equations (5) and (6):

$$T - T_0 = 345 \lg(8t + 1) \quad (7)$$

$$T - T_0 = 1030 \times \left(1 - 0.325e^{-t/6} - 0.675e^{-2.5t}\right) \quad (8)$$

where T_0 (°C) denotes the ambient temperature, t (min) denotes the heating duration, and T (°C) denotes the elevated temperatures.

Assuming an ambient temperature of $T_0 = 0\text{ }^{\circ}\text{C}$, the comparison of these heating curves is illustrated in Figure 9. It is evident that the electrical heating curve exhibits a faster heating rate during the initial heating stage, reaching $1000\text{ }^{\circ}\text{C}$ in just 15 min, whereas the ISO834 [25] heating curve takes 100 min to achieve the same temperature. However, the electrical heating curve [26] ceases to increase after reaching approximately $1000\text{ }^{\circ}\text{C}$, while the ISO834 [25] heating curve continues to rise even at this temperature. This phenomenon occurs because electrical fires are typically caused by the combustion of organic polymer materials. In an electrical fire, the temperature increases rapidly during the early stages of combustion; however, due to limitations in fire density, the temperature cannot continue to rise indefinitely.

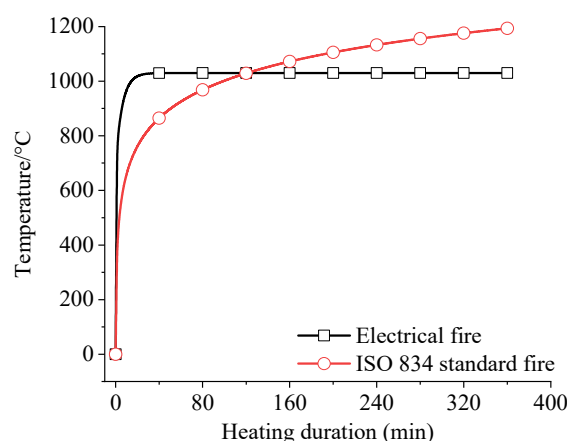


Figure 9. Heating curves [25].

5. Test Results

5.1. Temperature Results

Figure 10 shows the furnace temperature for each test. The location of the thermocouples is given in Figure 7. It is evident that the temperatures measured at various positions exhibit some deviation. This variation is attributed to the use of natural gas combustion during the tests, which creates a complex hot air flow within the furnace cavity, leading to temperature non-uniformity. Nevertheless, the average temperature aligns with the designed heating curve.

Figure 11 illustrates the temperature of the specimen at various positions, and the location of the thermocouples is given in Figure 7. It is evident that the temperature rise curves at identical locations on different cross-sections are similar, indicating that the specimens were uniformly heated along their length. However, the temperature distribution across the cross-section was found to be significantly non-uniform, with the web generally exhibiting the highest temperature, except for specimen D-3, which was protected by a fiber cement board. This phenomenon occurred because the web of the steel beams with contour protection schemes was directly heated on both sides, whereas the web of specimen D-3 was not directly exposed to the fire. The lowest temperature on the cross-section was observed at the upper flange of the beams, which was heated on only one side. The temperature difference between the upper flange and the web could reach $300\text{ }^{\circ}\text{C}$, which may significantly influence the fire resistance behavior of the beams, as the upper flange contributes more to the overall stability of the steel beams, which may cause the steel beam to transform from lateral–torsional buckling failure to cross-sectional strength failure. In Figure 11c, a sudden increase in the temperatures of specimens T_{2-4} and T_{2-2} was observed at approximately 25 min, which may be attributed to the partial failure of the fiber fireproof board, resulting in the steel beam being directly exposed to the fire.

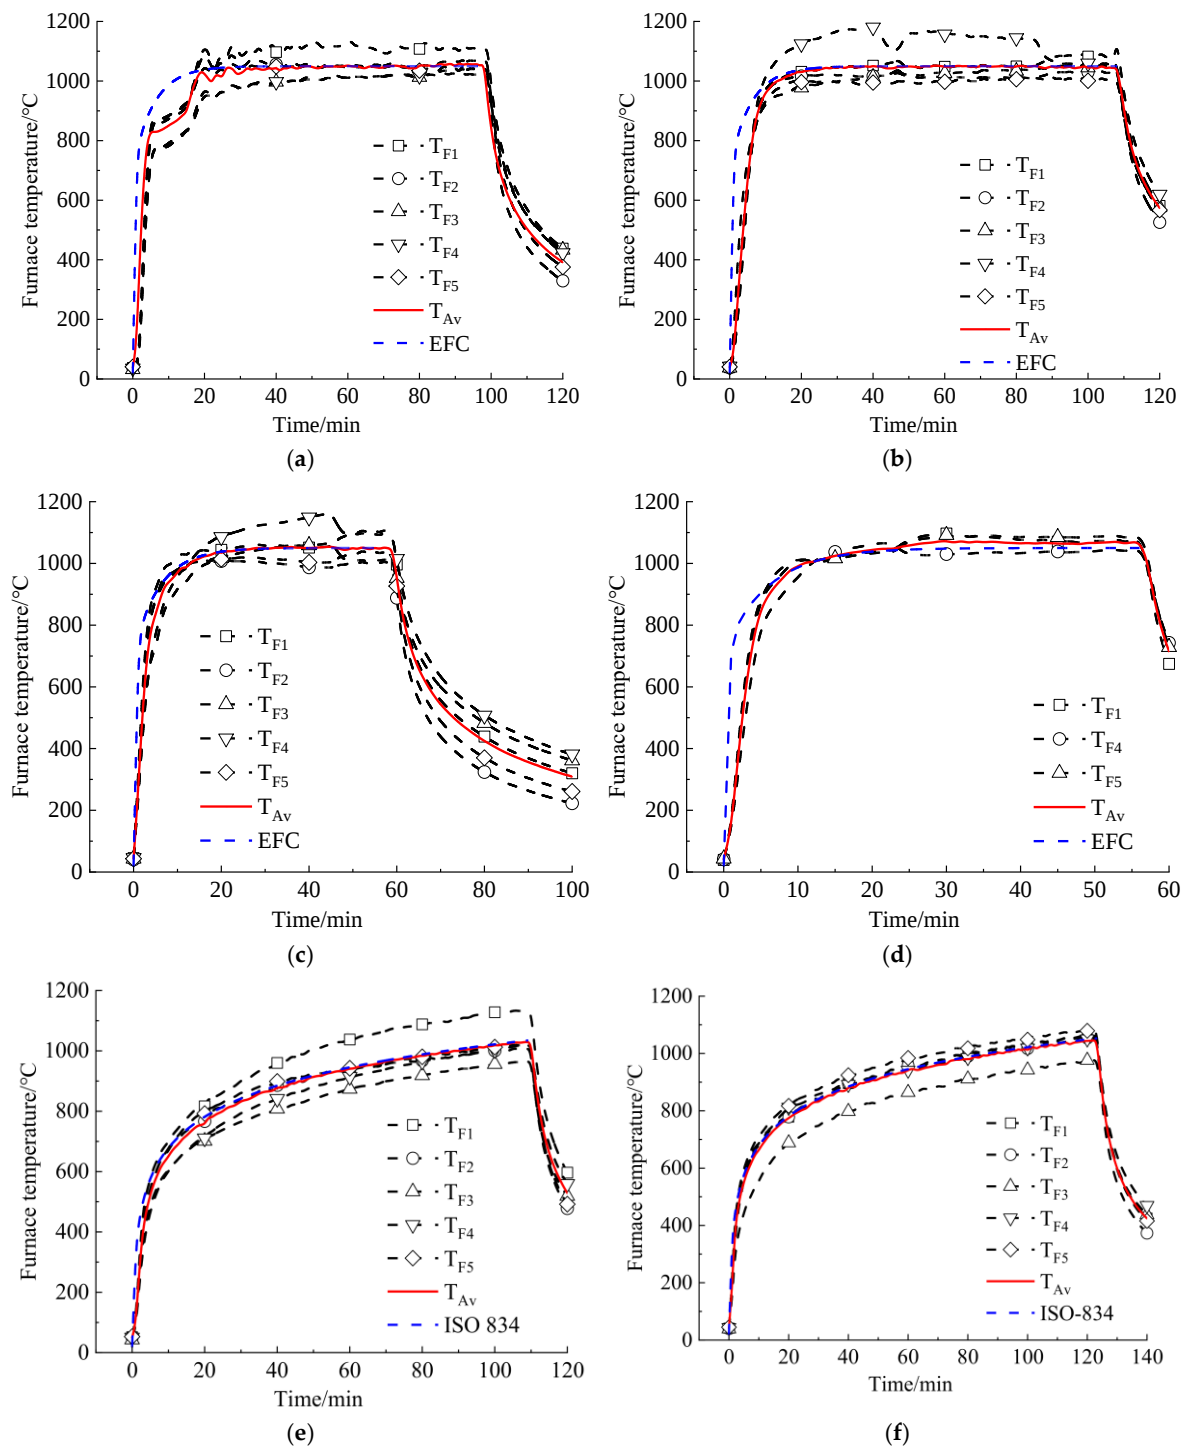


Figure 10. Furnace temperature: (a) D-1; (b) D-2; (c) D-3; (d) D-4; (e) ISO-1; and (f) ISO-2 [25].

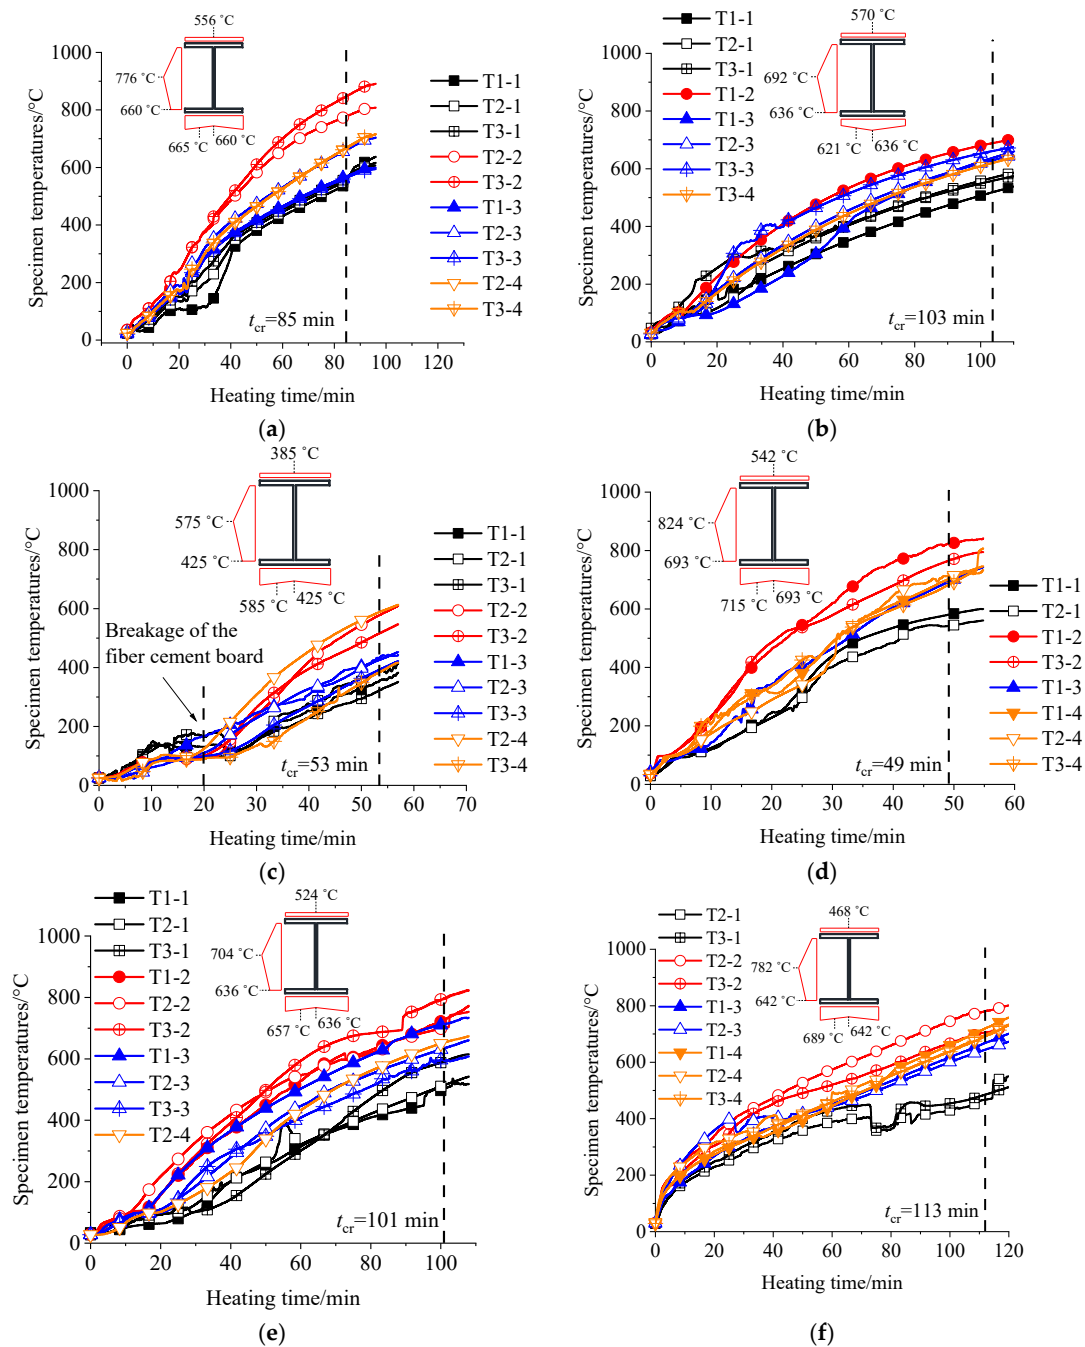


Figure 11. Specimen temperature: (a) D-1; (b) D-2; (c) D-3; (d) D-4; (e) ISO-1; and (f) ISO-2.

5.2. Displacement Results

According to the Chinese specification (GB 9978.1 [27]) regarding fire resistance tests for beams, the failure criterion is defined as the point at which the deflection reaches $L^2/(400d)$ mm or the deflection rate reaches $L^2/(9000d^2)$ mm/min. In this context, L and d represent the span length and web height of the beams, respectively. Consequently, the failure deflection and deflection rate of specimen D-1 are 196 mm and 8.71 mm/min, respectively, while the corresponding values for the other specimens are 134 mm and 5.93 mm/min.

Figure 12 illustrates the deflection curve and deflection rate for each specimen. It is evident that the deflection of each specimen progresses slowly during the initial stage, except for specimen D-1, whose deflection rate exceeds 0.5 mm/min, reaching up to 2 mm/min in the same period. The gradual increase in mid-span deflection is attributed to

a reduction in the elastic modulus; however, the steel beams remain in an elastic state. The faster deflection rate of specimen D-1 can be attributed to its higher temperature evolution rate. As depicted in Figure 11a, the average temperature evolution rate of its web reaches $10\text{ }^{\circ}\text{C}/\text{min}$, whereas specimen D-2, which employs the same fire protection method and is subjected to identical fire conditions, has a temperature evolution rate of only $7\text{ }^{\circ}\text{C}/\text{min}$.

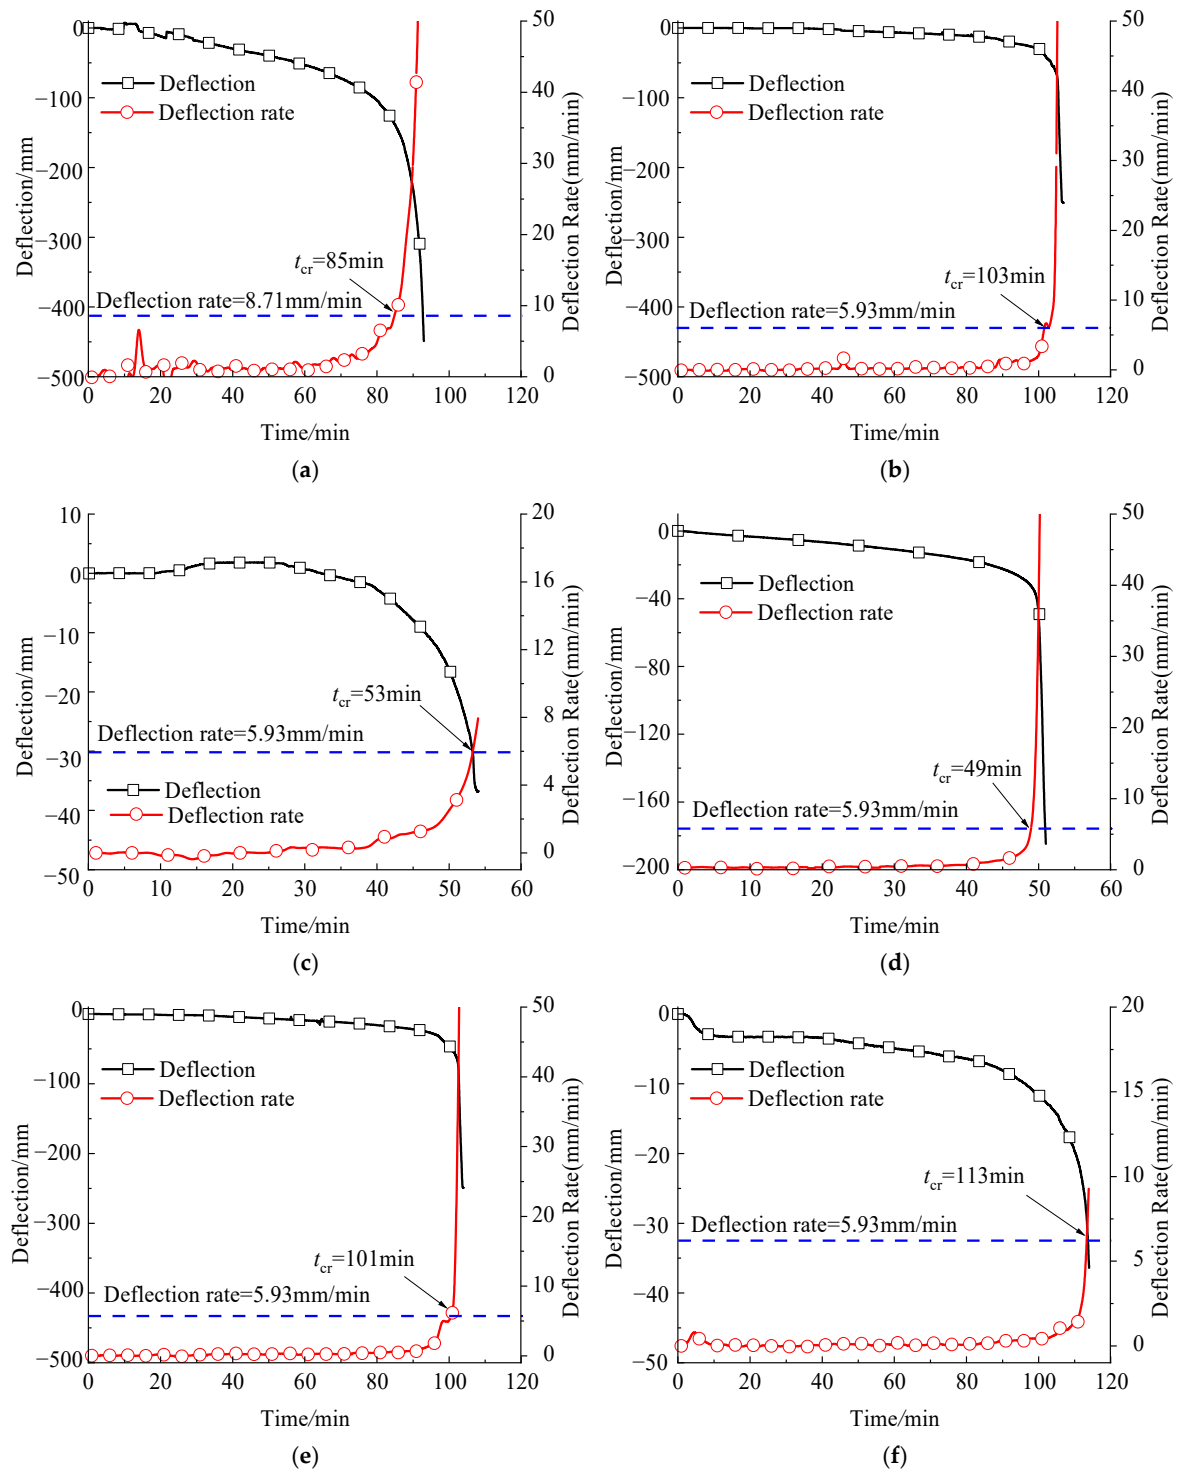


Figure 12. Deflection at the mid-span: (a) D-1; (b) D-2; (c) D-3; (d) D-4; (e) ISO-1; and (f) ISO-2.

Furthermore, it is observed that before the specimen reaches its fire resistance limit, at about 10 to 20 min, the deflection rate gradually increases, leading to a rapid rise in mid-span deflection. This phenomenon is caused by the reduction in yield strength of steel

at elevated temperatures, as certain areas of the beam progressively transition into a plastic state, resulting in a rapid decrease in its deformation stiffness.

5.3. Test Phenomenon

Figures 13 and 14 show the residual deformation and fire protection characteristics of the specimens. Specimen D-3 exhibited failure due to flexural buckling, while the other specimens failed due to lateral–torsional buckling. This phenomenon may have been triggered by the fiber cement board of specimen D-3 breaking at approximately 25 min, which caused a rapid increase in specimen temperature and a significant rise in the deflection rate. At this point, the mid-span deflection had not yet fully developed, as its deflection rate reached the critical threshold, resulting in a failure mode characterized by flexural buckling.



Figure 13. Failure mode of the specimens: (a) D-1; (b) D-2; (c) D-3; (d) D-4; (e) ISO-1; and (f) ISO-2.

Figure 13a,b,e illustrates the failure modes of the specimens protected by fire-retardant coatings. It was observed that the fire-retardant coating on specimen D-1 exhibited no significant peeling, whereas specimens D-2 and ISO-1 displayed extensive peeling over large areas. Figure 13c depicts the failure mode of specimen D-3, which was protected by fiber cement board. During the test, a substantial amount of water vapor was noted to escape from the steel beam supports, attributed to the evaporation of water within the fiber cement board due to the fire. At the bottom of specimen D-3, approximately 43% of the fiber cement board area detached, and numerous cracks along with localized peeling were simultaneously observed on the sides of the specimen. The cracks and peeling of the fiber cement board occurred as the moisture within the board evaporated, leading to increased brittleness. Figure 13d,f presents the failure modes of the specimens protected by intumescent coatings. It is evident that the intumescent coating expanded fully and uniformly, demonstrating excellent adhesion. Although the upper surface of the steel beam is also protected by an intumescent coating, it is covered by a fireproof board, which has not expanded and remains in a black gelatinous state. In contrast, the remaining heated areas have completely foamed and are in a white granular state.

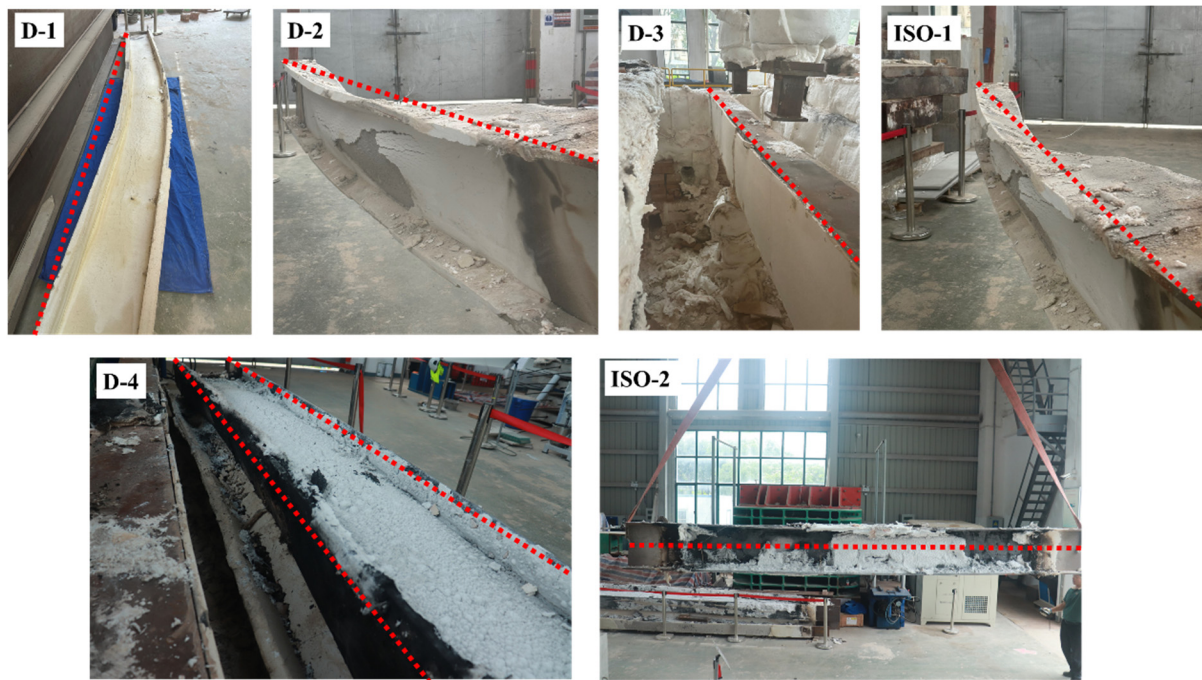


Figure 14. Torsional deformation of the beams.

5.4. Discussion of the Test Results

(1) Determination of the fire resistance and critical temperature

Based on the deflection curves and deflection rates of the specimens, the fire resistance (t_{cr}) of the specimens was determined, as indicated in Figure 12 and Table 3. Additionally, the failure temperature corresponding to the fire resistance was obtained from Figure 11. Since the largest deflection occurred at the mid-span of the beams, the temperatures at the mid-span cross-section (i.e., T_{2-1} , T_{2-2} , T_{2-3} , and T_{2-4}) were selected to represent the failure temperature of the beams, as summarized in Table 3. In some instances, due to the failure of the thermocouples at the mid-span cross-section, such as T_{2-2} of specimen D-2, the thermocouple data from the same location on adjacent sections were utilized. Assuming a linear temperature distribution between the measured points, as illustrated in Figure 15, the temperature distribution of each specimen was determined, as indicated in Figure 11. It can be observed that the temperature on the lower flange of the specimens was almost uniformly distributed, with T_{2-4} being slightly higher than T_{2-3} , except for specimen D-2. The mid-point of the web exhibited the highest temperature, while the upper flange displayed the lowest temperature. The average temperature of the specimens at fire resistance was calculated using Equation (7) and is denoted as the critical temperature (T_{cr}), as summarized in Table 3. In Equation (7), A_{flange} and A_{web} represent the flange and web areas of the beam, respectively.

Table 3. Critical temperature and fire resistance of the specimens.

Lables	$T_{cr,d}$ (°C)	T_{2-1} (°C)	T_{2-2} (°C)	T_{2-3} (°C)	T_{2-4} (°C)	$T_{cr,t}$ (°C)	$t_{cr,d}$ (min)	$t_{cr,t}$ (min)	$(T_{cr,d} - T_{cr,t})/T_{cr,t}$	$(t_{cr,d} - t_{cr,t})/t_{cr,t}$
D-1	676	556	776	660	665	648	120	85	4.3%	41%
D-2	661	570	692	636	621	610	120	103	8.3%	17%
D-3	661	385	575	425	586	487	120	53	35.7%	126%
D-4	661	542	824	693	715	663	60	49	−0.3%	22%
ISO-1	661	524	704	636	657	610	120	101	8.4%	19%
ISO-2	661	468	782	642	689	612	120	113	8.0%	6%

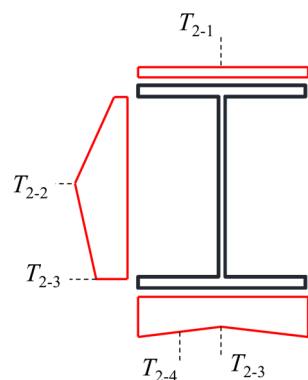


Figure 15. Temperature distribution mode.

(2) Influence of fire-protection method on critical temperature

Table 3 compares the designed critical temperature ($T_{cr,d}$) with the test results ($T_{cr,t}$). A good agreement was observed between the two, with an average discrepancy of less than 10%, except for specimen D-3. Additionally, the designed value, $T_{cr,d}$, was generally higher than the test results, $T_{cr,t}$. The $T_{cr,t}$ for specimen D-3, was significantly lower than that of the other specimens, which may be attributed to its fire protection method. The evaporation of water in the fiber cement board at elevated temperatures can lead to brittle failure, cracking, and peeling (Figure 16), resulting in the steel beam losing its fire protection. In addition, self-tapping screws were not observed to break in the tests, and it was found that fiber cement board is more susceptible to cracks and breaks at the locations of self-tapping screws. The direct heating of the steel beam caused its deflection rate to increase rapidly, reaching the critical point of failure before the deflection was fully developed. This phenomenon demonstrates that fiber cement boards are unsuitable for the fire protection of steel beams, as steel beams are prone to bending deformation under fire conditions. This bending deformation can cause the bottom fiber cement board to bend and the side fiber cement board to shear, ultimately leading to the premature failure of the fiber cement board. The test results ($T_{cr,t}$) of specimens also indicate that fire-retardant coating and intumescent coating had better protective behavior than fiber cement board, and the difference in $T_{cr,t}$ between fire-retardant coating and intumescent coating was relatively small.



Figure 16. Cracks and peeling of the fiber cement board.

(3) Influence of creep deformation on critical temperature

An interesting phenomenon was observed: the critical temperature ($T_{cr,t}$) of specimen D-4 was approximately 8.6% higher than that of the other specimens (D-2, ISO-1, and ISO-2). This difference may be attributed to creep deformation. It is difficult to measure the creep deformation that occurred during the test from the structural deformation characteristics. The consideration of creep deformation in this paper is based on the research results of

Kudor et al. [13], which shows that in the case of protected steel beams with typical 2-h fire-rated insulation, where the temperature rise is in the order of 3–7 °C/min, the effect of high-temperature creep becomes dominant and significantly reduces the critical temperature of the beams. Since specimen D-4 was heated for only 49 min, while specimens D-2, ISO-1, and ISO-2 were heated for approximately 100 to 110 min, the creep deformation in D-2, ISO-1, and ISO-2 would be more pronounced, resulting in lower critical temperatures for those specimens.

(4) Influence of heating curves on critical temperature

This study compares the critical temperature ($T_{cr,t}$) of D-2, D-4, ISO-1, and ISO-2. The results indicate that the difference among them was relatively small, suggesting that the heating curves have a limited impact on the critical temperature. However, this conclusion is predicated on the assumption that the beams are protected from fire and that the heating durations are comparable. In cases where beams are unprotected from fire and the heating durations vary, such as with D-4, the resulting creep deformations may differ significantly, leading to substantial variations in critical temperatures.

(5) Influence of fire protection on fire resistance

Table 3 compares the designed fire resistance ($t_{cr,d}$) with the test results ($t_{cr,t}$), revealing a discrepancy that was more significant than the critical temperature. Generally, except for specimens D-1 and D-3, the design values were higher than the test results, with differences ranging from 6% to 22%. This variation is primarily attributed to errors in the calculation of the critical temperature (T_{cr}). The results presented in Table 3 indicate that the designed critical temperatures ($T_{cr,d}$) for specimens D-2, ISO-1, and ISO-2 are approximately 8% higher than the corresponding test results. This overestimation of the critical temperature naturally leads to an inflated assessment of fire resistance. Notably, the $t_{cr,d}$ for specimen D-3 was 126% higher than its $t_{cr,t}$, which can be attributed to the premature failure of the fiber cement board.

(6) Influence of shape factors (F_i/V) on fire resistance

The shape factor (F_i/V) is a critical parameter in determining the steel temperature for fire-protected beams, as indicated in Equation (2). The shape factors (F_i/V) for specimens D-1 and D-2 were measured at 177 and 110 mm^{−1}, respectively. Consequently, during the fire protection design process, the thickness of the fire-retardant coating for D-1 should be proportionately greater than that for D-2. A comparison of the results between D-1 and D-2 reveals that the shape factor (F_i/V) significantly influences fire resistance ($t_{cr,t}$). Specimen D-1, which has a higher shape factor (F_i/V) and a thicker fire-retardant coating, was observed to reach T_{cr} earlier. This finding suggests that the temperature calculation method outlined in the Chinese specification GB 51249 [23] may not be effective in the context of an electrical fire.

$$T_{cr} = \frac{(T_{2-1} + T_{2-4}) \times A_{flange} + (T_{2-1} + T_{2-2} + T_{2-2} + T_{2-3}) \times A_{web} / 4}{2A_{flange} + A_{web}} \quad (9)$$

6. Evaluation of BS EN 1993-1-2

6.1. Critical Temperature of BS EN 1993-1-2

BS EN 1993-1-2 [28] provides a method for evaluating the critical temperature of the steel beams failing in lateral–torsional buckling. The buckling resistance moment ($M_{b,fi,t,Rd}$) at time t of a laterally unrestrained member with a Class 1 or Class 2 cross-section should be determined from Equation (10):

$$M_{b,fi,t,Rd} = \chi_{LT,fi} W_{pl,y} k_{y,\theta} f_y / \gamma_{M,fi} \quad (10)$$

where $\chi_{LT,fi}$ denotes the reduction factor for lateral–torsional buckling in the fire design situation, W_{ply} denotes the plastic section modulus, and k_y denotes the reduction factor for the yield strength of steel. In Equation (10), the value of $\chi_{LT,fi}$ should be determined according to the following equations:

$$\chi_{LT,fi} = \frac{1}{\phi_{LT,\theta} + \sqrt{(\phi_{LT,\theta})^2 - (\bar{\lambda}_{LT,\theta})^2}} \quad (11)$$

$$\phi_{LT,\theta} = \frac{1}{2} \left[1 + \alpha \bar{\lambda}_{LT,\theta} + (\bar{\lambda}_{LT,\theta})^2 \right] \quad (12)$$

$$\alpha = 0.65 \sqrt{235/f_y} \quad (13)$$

$$\bar{\lambda}_{LT,\theta} = \bar{\lambda}_{LT} (k_{y,\theta}/k_{E,\theta})^{0.5} \quad (14)$$

$$\bar{\lambda}_{LT} = \sqrt{\frac{W_{ply} f_y}{M_{cr}}} \quad (15)$$

where $k_{E,\theta}$ denotes the reduction factor for the elastic modulus, and M_{cr} is the elastic critical moment for lateral–torsional buckling at room temperature.

Figure 17a shows the key coefficient $\chi_{LT,fi}$ and buckling moment of the specimens at elevated temperatures, as per BS EN 1993-1-2 [28], and the critical temperature ($T_{cr,EC3}$) is determined and summarized in Table 4. It can be seen that the variation range of coefficient $\chi_{LT,fi}$ is limited in a temperature range from 200 to 700 °C, indicating that the buckling resistance moment at elevated temperatures was mainly determined by its reduced yield strength.

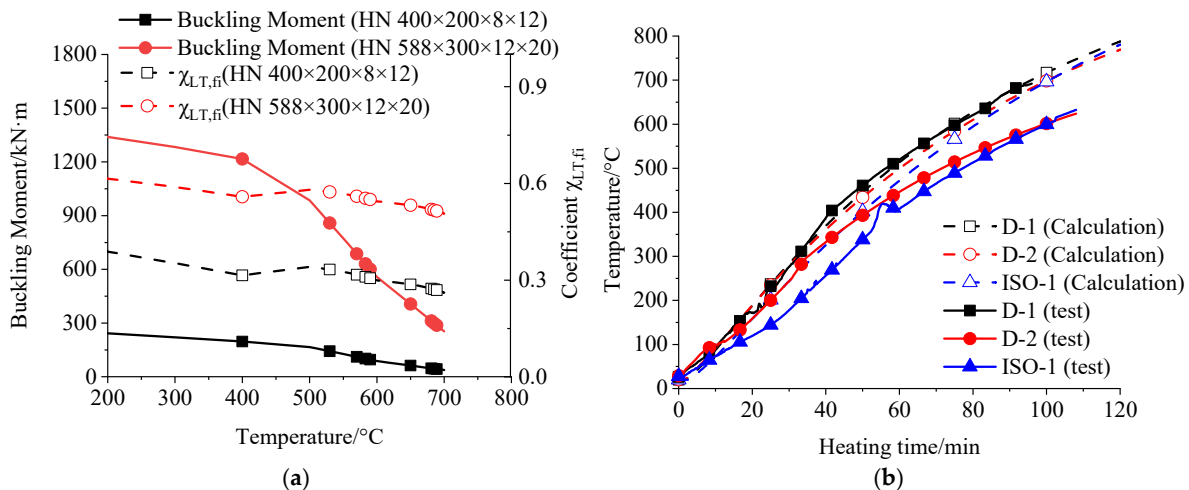


Figure 17. Assessment of the accuracy of BS EN 1993-1-2 [28]: (a) reduction in the load-bearing capacity and (b) temperature increase in the insulated beams.

The relative errors of $T_{cr,EC3}$ for D-1 and D-4 ranged within $\pm 5\%$, indicating high accuracy. However, the prediction of $T_{cr,EC3}$ for D-2, ISO-1, and ISO-2 was 14% higher than the test results. This discrepancy may be attributed to the calculation method outlined in BS EN 1993-1-2 [28], which does not account for creep deformation. Consequently, the predicted $T_{cr,EC3}$ values for specimens with shorter heating durations are relatively accurate, while those for specimens with longer heating durations are considered unsafe.

Table 4. Assessment of the accuracy of BS EN 1993-1-2 [28].

Lables	$T_{cr,t}$ (°C)	$T_{cr,EC3}$ (°C)	$t_{cr,t}$ (°C)	$t_{cr,EC3}$ (°C)	$(T_{cr,EC3} - T_{cr,t})/T_{cr,t}$	$(t_{cr,EC3} - t_{cr,t})/t_{cr,t}$
D-1	648	615	85	81	−5%	−5%
D-2	610	697	103	101	14%	−2%
D-3	487	-	53	-		
D-4	663	697	-	-	5%	
ISO-1	610	697	101	100	14%	−1%
ISO-2	612	697	-	-	14%	

Note: D-3 was not used to assess the calculation methods due to its premature failure.

6.2. Fire Resistance of BS EN 1993-1-2

In BS EN 1993-1-2 [28], the temperature increase $\Delta\theta_{a,t}$ of an insulated steel member during a time interval Δt should be obtained from Equations (16) and (17):

$$\Delta T_S = \frac{\lambda_p A_p}{d_p c_s \rho_s V} \frac{(T_g - T_S)}{(1 + \phi/3)} \Delta t - (e^{\phi/10} - 1) \Delta T_g \quad (16)$$

$$\phi = \frac{c_p \rho_p}{c_s \rho_s} d_p A_p / V \quad (17)$$

where A_p denotes the appropriate area of fire protection material per unit length; V denotes volume of the member per unit length; and c_p denotes temperature-independent specific heat of fire protection material.

It should be noted that Equations (16) and (17) are not applicable for intumescent coating, since the thickness (d_p), density (ρ_p), thermal conductivity (λ_p), and specific heat (c_p) of intumescent coating continuously change during the heating process. In addition, the values of λ_p , ρ_p , and c_p of the fire-retardant coating in our tests are 0.108 W/(m·K), 600 kg/m³, and 1500 J/(kg·K), respectively. Therefore, based on Equations (16) and (17), the steel temperature evolution could be calculated, as shown in Figure 17b, and the fire resistance $t_{cr,EC3}$ could be determined, as summarized in Table 4.

It can be seen from Figure 17b that the calculated temperature evolution curve of D-1 matches well with the test results, whereas the discrepancy of D-2 and ISO-1 is significant. The predictive fire resistance of specimens ranges from −1% to −5%, indicating a considerably high accuracy. In addition, the fire resistance predicted by BS EN 1993-1-2 [28] is on the safe side.

7. Evaluation of ANSI/AISC 360-22

7.1. Critical Temperature of ANSI/AISC 360-22

The American specification ANSI/AISC 360-22 [29] presents a method to evaluate the load-bearing capacity of beams at elevated temperatures. In the calculation process, the temperature over the depth of the member shall be taken as the temperature calculated for the bottom flange, and the calculation methods are given in Equations (18)–(24):

$$M_n(T) = C_b \left[F_L(T) S_x + (M_p(T) - F_L(T) S_x) \left(1 - \frac{L_b}{L_r(T)} \right)^{c_x} \right] \leq M_p(T) \quad L_b \leq L_r(T) \quad (18)$$

$$M_n(T) = F_{cr}(T) S_x \leq M_p(T) \quad L_b > L_r(T) \quad (19)$$

where

$$F_{cr}(T) = \frac{C_b \pi^2 E(T)}{\left(\frac{L_b}{r_{ts}} \right)^2} \sqrt{1 + 0.078 \frac{J_c}{S_x h_0} \left(\frac{L_b}{r_{ts}} \right)^2} \quad (20)$$

$$L_r(T) = 1.95r_{ts} \frac{E(T)}{F_L(T)} \sqrt{\frac{Jc}{S_x h_0} + \sqrt{\left(\frac{Jc}{S_x h_0}\right)^2 + 6.76 \left(\frac{F_L(T)}{E(T)}\right)^2}} \quad (21)$$

$$F_L(T) = F_y(k_p - 0.3k_y) \quad (22)$$

$$M_p(T) = F_y(T)Z_x \quad (23)$$

$$c_x = 0.6 + \frac{T}{250} \leq 3.0 \quad (24)$$

where $F_{cr}(T)$ denotes the critical lateral–torsional buckling load of the beam at T °C, $L_r(T)$ denotes the limiting unbraced length for the limit state of inelastic lateral–torsional buckling at T °C, L_b denotes the effective length ($L_b = 5600$ mm for our cases), $E(T)$ denotes the elastic modulus at T °C, $F_y(T)$ denotes the yield strength at T °C, S_x denotes the elastic section modulus, h_0 denotes the distance between the flange centroids, J denotes the torsional constant—the value of coefficient c for our cases is $c = 1$ — Z_x denotes the plastic section modulus, k_p and k_y denote the retention factor of the proportional limit and yield strength, and C_b denotes the lateral–torsional buckling modification factor for nonuniform moment diagrams ($C_b = 1.15$ for our cases).

In ANSI/AISC 360-22 [29], the key factor in calculating the $L_r(T)$ determines the failure mode of the beams. Figure 18a shows the variation of $L_r(T)$ with temperature, where it is seen that this value increases with the temperature, except for the range from 400 °C to 540 °C. In addition, the $L_r(T)$ of the specimens is always higher than 5600 mm, indicating inelastic lateral–torsional buckling of the beams. The load-bearing capacities of the beams at elevated temperatures are illustrated in Figure 18a, where an increase segment between 300 °C and 400 °C was found, which is due to the sudden increase in $L_r(T)$, since the ANSI/AISC 360-22 [29] adopted a lower flange temperature to conduct the calculation. Therefore, the T_{2-4} values of the test results were compared with the calculation results ($T_{cr,ANSI}$) from ANSI/AISC 360-22 [29], as summarized in Table 5.

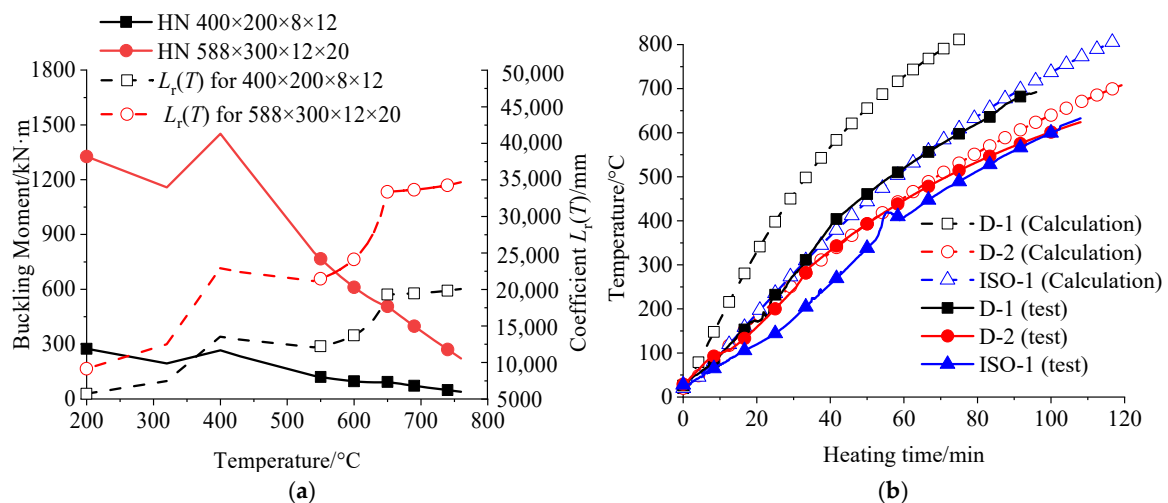


Figure 18. Assessment of the accuracy of ANSI/AISC 360-22 [29]: (a) reduction in the load-bearing capacity and (b) temperature increase in the insulated beams.

It has been observed that the relative errors of ANSI/AISC 360-22 [29] range from 1.5% to 19.6%, indicating potentially unsafe predictions. Additionally, a trend similar to that of BS EN 1993-1-2 [28] was observed, where predictions for specimens D-1 and D-4

were accurate, while predictions for other specimens were significantly unconservative. This discrepancy may also be attributed to potential creep deformation.

Table 5. Assessment of the accuracy of ANSI/AISC 360-22 [29].

Lables	$T_{cr,t}$ (°C)	T_{2-4} (°C)	$T_{cr,ANSI}$ (°C)	$(T_{cr,ANSI} - T_{2-4})/T_{2-4}$	$(T_{cr,ANSI} - T_{cr,t})/T_{cr,t}$
D-1	648	665	675	1.5%	4%
D-2	610	621	743	19.6%	22%
D-3	487	586	-		
D-4	663	715	743	3.9%	12%
ISO-1	610	657	743	13.1%	22%
ISO-2	612	689	743	7.8%	21%

Note: D-3 was not used to assess the calculation methods due to its premature failure.

7.2. Fire Resistance of ANSI/AISC 360-22

The calculation method for insulated steel members with contour protection schemes in ANSI/AISC 360-22 [29] is given in Equation (25):

$$\Delta T_s = \frac{\lambda_p}{d_p c_s} \frac{T_g - T_s}{\left(\frac{W}{F_i}\right) + \frac{c_p \rho_p d_p}{288}} \Delta t \quad (25)$$

where coefficient W denotes weight (mass) per unit length. Figure 18b compares the calculation results with the test results of the average temperature. It is seen that ANSI/AISC 360-22 [29] generates a considerably higher result for D-1 and ISO-1, but a slightly higher result for D-2; this phenomenon was attributed to the application range of ANSI/AISC 360-22 [29] for uniformly heated specimens. It was emphasized in ANSI/AISC 360-22 [29] that when applying this method to steel beams supporting floor and roof slabs, the approach will overestimate the temperature rise in the beam.

In ANSI/AISC 360-22 [29], only the temperature of the lower flange is used to calculate the load-bearing capacity of the steel beam. This method may underestimate the contribution of the unheated upper flange to the load-bearing capacity, making the calculation result safer for engineering design. However, this method has certain limitations, because it is difficult to directly calculate the temperature of the lower flange of the beam without the help of numerical simulation. Therefore, there is a significant gap between the temperature calculation and the load-bearing capacity calculation of the structure at elevated temperatures. It is better to consider using the average cross-section temperature to calculate the bearing capacity in future research. Figure 19 compares the calculation results of the codes, and it can be seen that the calculation of critical temperature in Chinese, European, and American codes is usually higher than the test results, which may cause unsafe fire resistance design.

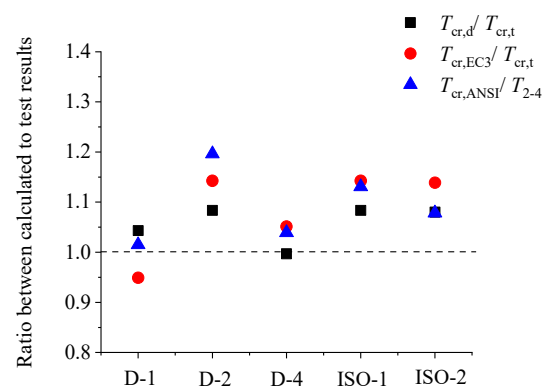


Figure 19. Comparison of the Chinese, European, and American design code.

8. Conclusions

This paper carried out full-scale fire resistance tests on simply supported insulated steel beams, and some conclusions could be obtained, as follows:

- (1) Test results indicated that the steel beams subjected to three-sided fire exhibited a non-uniform temperature distribution. The difference between the lowest temperature on the upper flange and the highest temperature at the midpoint of the web reached 300 °C when the average cross-sectional temperature was 600 °C. This non-uniform temperature distribution presents a challenge in engineering applications, as it complicates the prediction of the mechanical behavior and fire resistance of the beams.
- (2) It was found that the critical temperature (T_{cr}) and fire resistance (t_{cr}) of the specimens with fire-retardant or intumescent coatings were lower than the values predicted by GB 51249-2017. The discrepancies in GB 51249-2017 for T_{cr} and t_{cr} range from 0% to 8.4% and from 6% to 41%, respectively, indicating unsafe design methodology. Furthermore, fiber cement board should be used with caution in the fire protection of beams, as it can become brittle at elevated temperatures and is prone to breakage and detachment when the beams begin to bend.
- (3) Fire-retardant coatings and intumescent coatings exhibit superior protective properties compared to fiber cement boards, with only a minor difference in critical temperature between the two types of coatings.
- (4) Creep deformation can significantly reduce the critical temperature of steel beams. Research indicates that beams subjected to shorter heating durations exhibit a critical temperature that is 8.6% higher than that of specimens exposed to longer heating durations. Furthermore, heating curves have a limited impact on the critical temperature, provided that the beams are protected from fire and their heating durations are comparable. In contrast, if these conditions are not met, creep deformation will affect the critical temperature.
- (5) The accuracy of the design methods outlined in BS EN 1993-1-2 and ANSI/AISC 360-22 was evaluated based on the test results. It was found that both specifications provided accurate predictions on the critical temperatures for D-1 and D-4, which have shorter heating durations, but unconservative predictions for other specimens with longer heating durations. This phenomenon was attributed to the ignorance of creep deformation in both specifications, emphasizing the importance of considering creep deformation in the fire safety design of steel beams.

It should be noted that only a narrow set of steel beam sizes and protection types were investigated. The conclusions might not be suitable for other beam geometries, loading conditions, or insulation materials. However, the cross-sectional shape coefficients of several steel beams designed in this test are similar, and the influence of relevant differences on the fire resistance of steel beams is studied. Some conclusions can be obtained based on relevant test phenomena and measured data. In future work, the author will use finite element analysis to reproduce the tests and conduct parametric analysis to validate the obtained results.

Author Contributions: W.W. (Weihua Wang): Writing—Original Draft; T.Z.: Conceptualization; X.G.: Resources; J.Y.: Funding Acquisition; X.C.: Supervision; W.W. (Weiyong Wang): Validation. All authors have read and agreed to the published version of the manuscript.

Funding: This study was supported by the National Natural Science Foundation of China (52408531), the research project of the State Grid Fujian Economic Research Institute (SGFJJY00BDJS2400037), and the research project of the State Grid Fujian Economic Research Institute (SGFJJY00BDJS2310040). Any opinions, findings, and conclusions or recommendations expressed in this paper are those of the authors and do not necessarily reflect the views of the sponsors.

Data Availability Statement: The original contributions presented in the study are included in the article, and further inquiries can be directed to the corresponding author.

Conflicts of Interest: Authors Xian Gao and Xilong Chen were employed by the company State Grid Fujian Electric Power Co., Ltd. The remaining authors declare that the research was conducted in the absence of any commercial or financial relationships that could be construed as a potential conflict of interest.

References

1. Thongchom, C.; Bui, L.V.H.; Poonpan, N.; Phudtisarigorn, N.; Nguyen, P.T.; Keawsawasvong, S.; Mousa, S. Experimental and Numerical Investigation of Steel- and GFRP-Reinforced Concrete Beams Subject to Fire Exposure. *Buildings* **2023**, *13*, 609. [\[CrossRef\]](#)
2. Jiang, Y.; Hu, X.; Zheng, H.; Shuai, H. Flexural Behavior of Partially Encased Composite Beams with a Large Tensile Reinforcement Ratio. *Buildings* **2024**, *14*, 1606. [\[CrossRef\]](#)
3. Zhang, Z.; Lyu, J.; Shi, G.; Li, W.; Wang, C. Study on the Fire Resistance of Castellated Composite Beams with Semi-Rigid Restraints. *Buildings* **2025**, *15*, 1016. [\[CrossRef\]](#)
4. Rzeszut, K.; Goscinski, B. Load-Bearing Capacity of Klein's Ceiling Under Fire Conditions. *Buildings* **2025**, *15*, 323. [\[CrossRef\]](#)
5. Memarzadeh, A.; Shahmansouri, A.A.; Nematzadeh, M.; Gholampour, A. A review on fire resistance of steel-concrete composite slim-floor beams. *Steel Compos. Struct.* **2021**, *40*, 13–32.
6. Burgess, I.W.; Rimawi, J.E.; Plank, R.J. Studies of the Behaviour of Steel Beams in Fire. *J. Constr. Steel Res.* **1991**, *19*, 285–312. [\[CrossRef\]](#)
7. Liu, T.C.H.; Fahad, M.K.; Davies, J.M. Experimental investigation of behaviour of axially restrained steel beams in fire. *J. Constr. Steel Res.* **2002**, *58*, 1211–1230. [\[CrossRef\]](#)
8. Yin, Y.Z.; Wang, Y.C. A numerical study of large deflection behaviour of restrained steel beams at elevated temperatures. *J. Constr. Steel Res.* **2004**, *60*, 1029–1047. [\[CrossRef\]](#)
9. Li, G.; Guo, S. Experiment on restrained steel beams subjected to heating and cooling. *J. Constr. Steel Res.* **2008**, *64*, 268–274. [\[CrossRef\]](#)
10. Tan, K.; Huang, Z. Structural Responses of Axially Restrained Steel Beams with Semirigid Moment Connection in Fire. *J. Struct. Eng.* **2005**, *131*, 541–551. [\[CrossRef\]](#)
11. Huang, Z.; Tan, K. Structural response of restrained steel columns at elevated temperatures. Part 2: FE simulation with focus on experimental secondary effects. *Eng. Struct.* **2007**, *29*, 2036–2047. [\[CrossRef\]](#)
12. Dwaikat, M.; Kodur, V. Engineering Approach for Predicting Fire Response of Restrained Steel Beams. *J. Eng. Mech.* **2011**, *137*, 447–461. [\[CrossRef\]](#)
13. Kodur, V.K.R.; Dwaikat, M.M.S. Effect of high temperature creep on the fire response of restrained steel beams. *Mater. Struct.* **2010**, *43*, 1327–1341. [\[CrossRef\]](#)
14. Al-azzani, H.; Yang, J.; Sharhan, A.; Wang, W. A Practical Approach for Fire Resistance Design of Restrained High-Strength Q690 Steel Beam Considering Creep Effect. *Fire Technol.* **2021**, *57*, 1683–1706. [\[CrossRef\]](#)
15. Shakil, S.; Lu, W.; Puttonen, J. Behaviour of vertically loaded steel beams under a travelling fire. *Structures* **2022**, *44*, 1–17. [\[CrossRef\]](#)
16. Nguyen, T.Q.; Nguyen, X.T.; Nguyen, T.N.M.; Park, J.S. Buckling strength of steel I-beams subjected to simultaneous transverse loads and negative end moments under elevated temperature. *Structures* **2024**, *67*, 106934. [\[CrossRef\]](#)
17. Laím, L.; Rodrigues, J.P.C. Experimental and numerical study on the fire response of cold-formed steel beams with elastically restrained thermal elongation. *J. Struct. Fire Eng.* **2016**, *7*, 388–402. [\[CrossRef\]](#)
18. Couto, C.; Vila Real, P.; Lopes, N. Local-global buckling interaction in steel I-beams—A European design proposal for the case of fire. *Thin-Walled Struct.* **2025**, *206*, 112664. [\[CrossRef\]](#)
19. Xie, B.; Dai, W.; Zhang, S.; Guo, C.; Tan, Y.; Wang, M.; Xu, Z.; Liu, Q. Experimental and numerical investigation on fire resistance of stainless steel core plate beams. *Thin-Walled Struct.* **2023**, *190*, 110948. [\[CrossRef\]](#)
20. Kucukler, M. Stainless steel I-section beams at elevated temperatures: Lateral-torsional buckling behaviour and design. *Thin-Walled Struct.* **2025**, *208*, 112720. [\[CrossRef\]](#)

21. Pournaghshband, A.; Afshan, S.; Theofanous, M. Elevated temperature performance of restrained stainless steel beams. *Structures* **2019**, *22*, 278–290. [[CrossRef](#)]
22. Shaheen, M.A.; Afshan, S.; Foster, A.S. Performance of axially restrained carbon and stainless steel perforated beams at elevated temperatures. *Adv. Struct. Eng.* **2021**, *24*, 3564–3579. [[CrossRef](#)]
23. GB 51249-2017; Code for Fire Safety of Steel Structures in Buildings. China Planning Press: Beijing, China, 2017. (In Chinese)
24. GB 50017-2017; Standard for Design of Steel Structures. China Architecture & Building Press: Beijing, China, 2017. (In Chinese)
25. ISO-834; Fire-Resistance Tests-Elements of Building Construction. International Organization for Standardization: Geneva, Switzerland, 1975.
26. GB/T 26784-2011; Fire Resistance Test for Elements of Building Construction-Alternative and Additional Procedures. Standards Press of China: Beijing, China, 2011. (In Chinese)
27. GB9978.1-2008; Fire-Resistance Tests-Elements of Building Construction-Part 1: General Requirements. Standards Press of China: Beijing, China, 2008. (In Chinese)
28. BS EN 1993-1-2:2024; Eurocode 3-Design of Steel Structures. Part 1-2: Structural Fire Design. British Standards Institution: London, UK, 2024.
29. ANSI/AISC 360-22; Specification for Structural Steel Buildings. American Institute of Steel Construction: Washington, DC, USA, 2022.

Disclaimer/Publisher’s Note: The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.