

## Article

# Water Supply Pipeline Risk Index Assessment Based on Cohesive Hierarchical Fuzzy Inference System

Muhammad Fayaz, Shabir Ahmad, Lei Hang and DoHyeun Kim \*

Department of Computer Engineering, Jeju National University, Jeju City 63243, Korea; hamaz\_khan@yahoo.com (M.F.); shabir@jejunu.ac.kr (S.A.); hanglei@jejunu.ac.kr (L.H.)

\* Correspondence: kimdh@jejunu.ac.kr; Tel.: +82-64-754-3658

Received: 14 January 2019; Accepted: 26 March 2019; Published: 29 March 2019



**Abstract:** As populations grow, facilities such as roads, bridges, railways lines, commercial and residential buildings, etc., must be expanded and maintained. There are extensive networks of underground facilities to fulfil the demand, such as water supply pipelines, sewage pipelines, metro structures, etc. Hence, a method to regularly assesses the risk of the underground facility failures is needed to decrease the chance of accidental loss of service or accidents that endanger people and facilities. In the proposed work, a cohesive hierarchical fuzzy inference system (CHFIS) was developed. A novel method is proposed for membership function (MF) determination called the heuristic based membership functions determination (HBMFD) method to determine an appropriate MF set for each fuzzy logic method in CHFIS. The proposed model was developed to decrease the number of rules for the full structure fuzzy inference system with all rule implementation. Four very crucial parameters were considered in the proposed work that are inputs to the proposed CHFIS model in order to calculate the risk of water supply pipelines. In order to fully implement the proposed CHFIS just 85 rules are needed while using the traditional Mamdani fuzzy inference system, 900 rules are required. The novel method greatly reduces implementation time and rule design sets that are extremely time consuming to develop and difficult to maintain.

**Keywords:** fuzzy logic; water supply pipelines; leakage; risk index; rules reduction

## 1. Introduction

The idea of risk was first given in the field of economy in the last year of the 19th century; nowadays its use is common nearly in all fields. The fields where the concept of risk is frequently used are environmental sciences, natural disasters, architectural engineering and so forth. The risk is the probability of failures; risk and uncertainty are directly correlated with each other. There are a lot of underground facilities, which are severe threats to buildings, railways lines, bridges, roads and so forth. The most important among them are water supply pipelines. Immense research has been carried out by several scientists to propose an efficient risk assessment method for water supply pipelines, in order to avoid human and economic losses. Water supply pipelines are the most essential and more rapid growth is expected in the future, in terms of installation of underground water supply pipelines. These pipes are severe threats to roads, railways, bridges and so forth [1,2].

Numerous factors can cause pipelines failures, such as age, bridges, leakage, depth and height, water temperature and so forth [3–6]. In this paper, we have considered age, depth, length, and height because these are incredibly significant factors and due to which failures may occur to water supply pipelines. As the age of the pipeline increases the probability of failure increases, therefore we have considered this factor in the proposed work. The leakage of the pipeline is also a critical factor that can slowly damage the pipe as well as near buildings, roads and so forth [7]. The other two parameters depth and length also contribute to pipeline failures [8]. Many authors have proposed

different methods in order to assess water supply pipelines. An efficient risk assessment methodology is fundamental to take measures in time to escape from accidents.

Recently, the fuzzy logic (FL) method has grasped the consideration of various scholars and has been widely used in several areas for different purposes [9,10]. Fuzzy logic methods have been extensively used for risk index analysis and assessment. Fuzzy inference system (FIS) can be used to solve the problems related to the exact mathematical models. However, conventional fuzzy inference systems are not suitable due to its rules-explosion with every new entry of variables. For a fuzzy model having  $q$  input parameters, for each input parameters  $p$  MFs are defined. Then, for a full fuzzy inference system  $q^p$  fuzzy rules are required, such as in [11,12] a fuzzy inference system has been designed where there are 12 input variables and for each variable five MFs are allocated. Hence, the entire number of rules obligatory to completely implement the system are  $5^{12}$ . It is particularly difficult for an expert to incorporate that large number of rules with attention. Any abnormality in rule designing can cause casualties of people, wastage of money or both losses. Hence, the minimization of rules in rule-base is an issue of high concern. To overcome the issue of rule-explosion, a solution is to divide the fuzzy inference system in sub-modules in a hierarchical form. In this hierarchical fuzzy logic method, the low-level modules provide fractional solutions; these fractional solutions are then combined in the high-level modules to provide a complete result for a problem. In this way, the number of rules can be reduced significantly as compared to the conventional fuzzy logic (CFL) model [13,14]. Exponential increment occurs in rules using CFL models, hence rules-explosion makes designing of rules very hard, and it also increases the computational complexity. The greater number of rules means a greater possibility of errors and also designing is not an easy task because rules need utmost concentration. Hence to overcome the issue of rules-explosion in the CFL model, hierarchical fuzzy logic (HFL) models were designed in the proposed work to assess the water supply pipelines risk index. The focus of some efforts is the development of hardware boards, which are great platforms for expressing creativity in order to make and create novel things for developers. The most famous and initial efforts are the Raspberry Pi [15] and Arduino [16] boards. These boards have their own programming and it very necessary for the user to code in Python and Java because a user has these two options to write code on these boards.

In this paper, a cohesive hierarchical fuzzy inference system (CHFIS) model for water supply pipelines (WSPLs) risk index assessment was proposed. The purpose of the CHFIS model is dimensionality reduction because a large number of rules requires much effort from experts and also increases the probability of errors. The proposed CHFIS model can be applied for risk assessment where the number of input variables are larger because the proposed CHFIS takes fewer rules as compared to the traditional FL models. For MFs determination of each fuzzy logic in the CHFIS we suggested technique names as the heuristic based membership function determination (HBMFD) method in order to determine appropriate MFs to sub-fuzzy logics in CHFIS model. The risk index values of the proposed CHFIS system is represented through LED actuators using different colors. The caretaker can take measures according to the risk index level provided by the proposed model.

The organization of the remaining paper is carried out as: Section 2 represents the related work section, and in Section 3 the proposed work is explained in detail. The implementation, results and discussion are given in Section 4 in detail. The paper conclusion is given in Section 5.

## 2. Related Work

Subjective judgments from experts are required to assess water supply pipelines (WSPL) risk. However, experts having prospective knowledge are extremely difficult to find as well time-consuming and expansive. Therefore, the alternative way is to develop an efficient method to assess the water supply risk index. Many efforts have been carried out in this regard since the last few decades, the discussion of some of which are carried out here.

The most used and efficient method for risk assessment and management is fuzzy logic which has been extensively used in numerous fields to assess risks [17]. Li et al. [18] suggested a technique to

analyze the risk of long-distance water transmission pipelines. The fuzzy concepts were used in the suggested methodology. Tripathy et al. [19] suggested a technique to assess the safety risk index of coal mines. The proposed method was based on the fuzzy reasoning methodology and authors have used the fuzzy logic method despite the availability of other similar techniques. A case study was conducted to validate the applicability of the method. According to the results, fire has a high-risk index as compared to other risk parameters. Chen et al. [20] designed a decision-making approach based on FL for handling supplier chain selection proposed in a supply chain system. Gul et al. [21] applied the fuzzy logic concept in the aluminum industry. Zhao et al. [22] suggested an FL based method to assess risk in green projects. Zhang et al. [23] proposed a fuzzy comprehensive evaluation approach to assess underground risk index.

Different authors have developed different techniques based on hierarchical fuzzy logic (HFL) methods to overcome the rules-explosion problem that existed in the conventional FL method. Fayaz et al. [14] designed a model named as integrated, based on the HFL method for underground risk calculation. The integrated HFL method significantly reduce the rules with a larger number of input variables. Fayaz et al. [17] suggested another method for rule reduction based on HFL and Kalman methods for underground risk index calculation and prediction. Like the integrated HFL method, this method also decreases the number of rules. These two methods are suitable to be applied in a situation where the input variable parameters are greater in number. Chang et al. [24] designed a simple HFL system for rules reduction. In their proposed model, the fuzzification and defuzzification method was removed in order to make it as simple as possible.

### 3. Proposed Water Supply Pipeline Risk Index Methodology

The critical issue of traditional FL is rule-explosion when more parameters are added to the system. Two main drawbacks are associated with rules-explosion. First, it increases the computation complexity of the system and second, it is very challenging to design a large number of rules. In this paper, we designed an FL model based on HFL to solve the problems associated with conventional fuzzy logic. The conventional fuzzy logic is shown in Figure 1. The proposed model, named a cohesive model, is illustrated in Figure 2. The proposed model consisted of three layers; input layer, middle layer, and top-level layer. In the input layer, we have four inputs namely depth, length, height and age. The middle layer consisted of the two fuzzy inference systems (FISs) namely FIS\_1 and FIS\_2. Inputs to the FIS\_1 are depth ( $P_1$ ) and length ( $P_2$ ) parameters, and inputs to FIS\_2 are age ( $P_3$ ), and leakage ( $P_4$ ). The outputs of FIS\_1 and FIS\_2 are further inputs to the FIS\_3 of the top-level layer. The proposed model dramatically reduces the rules in FIS.


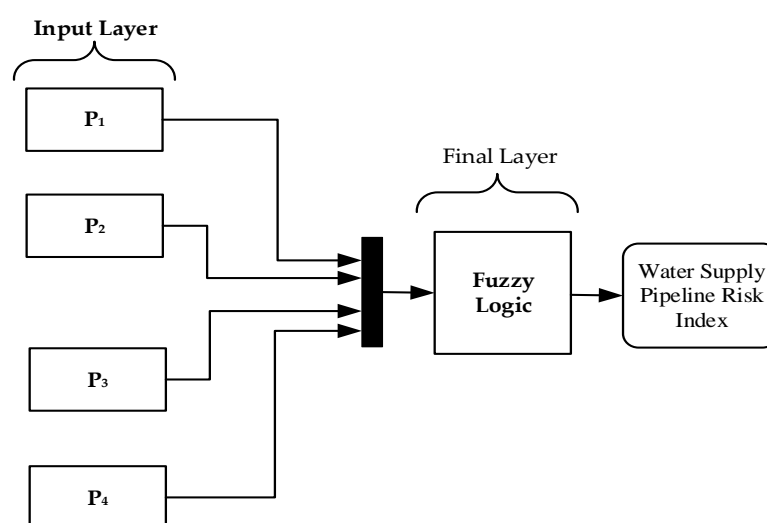


Figure 1. Conventional fuzzy inference model.

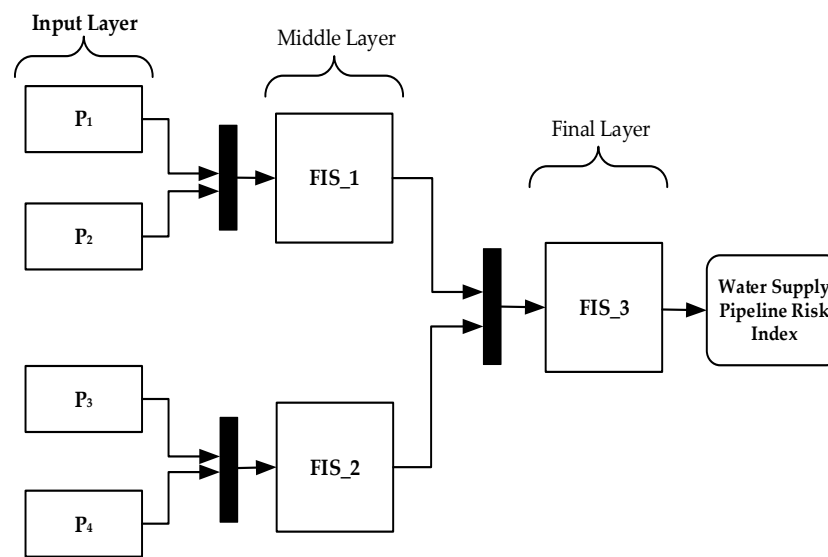

**Figure 2.** Proposed cohesive hierarchical fuzzy inference model.

Next, we applied the proposed cohesive model to real data supplied by the Electronics and Telecommunications Research Institute (ETRI) organization. The data was gathered from 1989 to 2010 for WSPLs installed at different points in Seoul, South Korea. In the future, we assume that more parameters would be entered into the system. Hence, we have designed the model a way that if more parameters enter into the system, rule-explosion would not occur.

The pseudo code of the proposed CHFIS model is shown in algorithm\_1. There are four inputs to the proposed CHFIS model which are presented as  $P_1$ ,  $P_2$ ,  $P_3$ , and  $P_4$ . The ML, RI, PR, FL, and WSPRI indicate the middle layer, risk index, partial risk, final layer and water supply pipeline risk index, respectively.

In the proposed CHFIS model we used the triangular MFs [25]. There is no standard way to determine MFs; hence we also proposed a heuristic based membership function determination (HBMFD) method. In this method, some membership function sets are defined and applied to the historical data. The best results are recorded using root mean absolute error (RMSE). The RMSE formula is given in Equation (1).

$$\text{RMSE} = \sqrt{\frac{1}{N} \sum_{k=0}^n (A - E)^2}, \quad (1)$$

where  $N$  indicates the entire number of instances,  $A$  illustrates real data, and  $E$  indicates the estimation values generated by the proposed HBMFD method.

---

**Algorithm\_1: Pseudo code for a cohesive hierarchical fuzzy inference system**


---

**Input** ( $P_1, P_2, P_3, X_4$ )**Output:** WSPRI**Begin:**

```


1.  $RI \leftarrow \emptyset$ ;
2.  $ML(P_1, P_2, P_3, X_4) \{$ 
    i.  $FIS\_1(P_1, P_2) \{$ 
        •  $\mu(P_1)$  // change the numeric input value to  $P_1$  to fuzzy value
        •  $\mu(P_2)$  // change the numeric input value to  $P_2$  to fuzzy value
        for  $j \leftarrow 1$  to 30 do
            ■ Rule inferencing
            ■  $\mu(z_j)$  // Rule implication
        od
        •  $\mu(y_1) \leftarrow \text{Aggregate}()$ : // Apply aggregation
        •  $b_1 \leftarrow \mu(y_1)$ 
        • return  $PR_1$ 
    ii.  $FIS\_2(P_3, P_4) \{$ 
        •  $\mu(P_3)$  // change the numeric input value to  $P_3$  to fuzzy value
        •  $\mu(P_4)$  // change the numeric input value to  $P_4$  to fuzzy value
        for  $j \leftarrow 1$  to 30 do
            ■ Inferencing of rules
            ■  $\mu(z_j)$  // implication of rules
        od
        •  $\mu(g_2) \leftarrow \text{Aggregate}()$ : // Aggregation
        •  $m_2 \leftarrow \mu(g_2)$ 
        • return  $PR_2$ 
    }  $[PR_1, PR_2] \leftarrow ML(P_1, P_2, P_3, P_4)$ 
3.  $FL(PR_1, PR_2)$ 
    iii.  $FIS\_3(PR_1, PR_2) \{$ 
        •  $\mu(PR_1)$  // change the numeric input value to  $PR_1$  to fuzzy value
        •  $\mu(PR_2)$  // change the numeric input value to  $PR_2$  to fuzzy value
        for  $j \leftarrow 1$  to 25 do
            ■ Inferencing of rules
            ■  $\mu(z_j)$  // implication of rules
        od
        •  $\mu(g_3) \leftarrow \text{Aggregate}()$ : // Aggregation
        •  $m_2 \leftarrow \mu(g_3)$ 
        • return WSPRI
    }
WSPRI =  $FL(PR_1, PR_2)$ 

```

**End**


---

The membership functions set is the value for the next data, considered having the minimum RMSE value. The structure diagram of the proposed membership functions determination method is presented in Figure 3. In the proposed diagram,  $P_1$  and  $P_2$  indicate the depth and length parameters of the  $FIS\_1$ . Similarly, for  $FIS\_2$  and  $FIS\_3$  the same proposed method was applied to determine the best membership functions set.

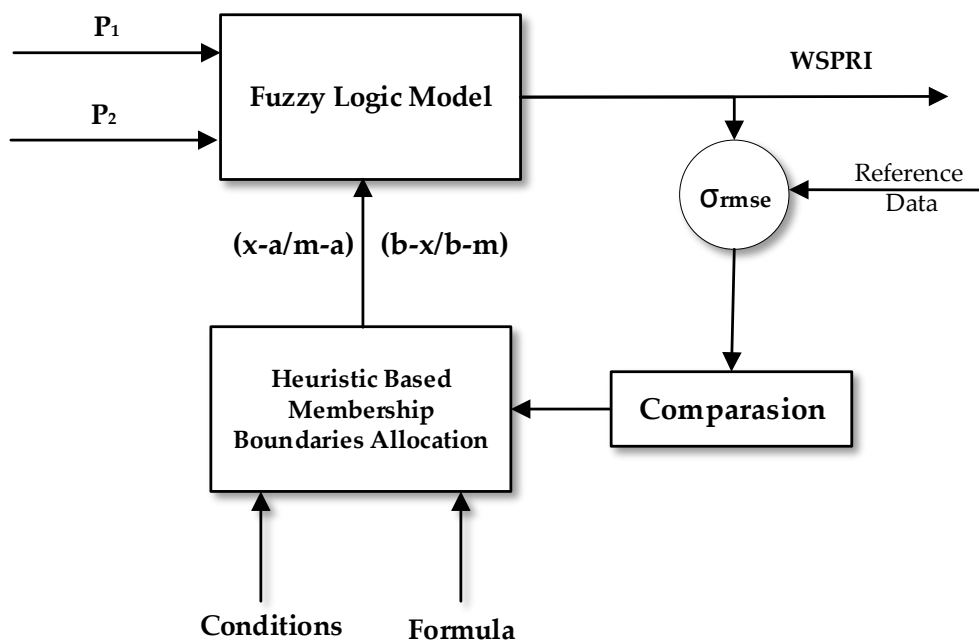

**Figure 3.** Heuristic-based membership functions (MFs) allocation scheme.

The number of rules in Mamdani fuzzy logic relies on input parameters, and MFs defined for input variables. For defining all potential rules of the proposed CHFIS model and CFL model. Equations (2) and (3) can be used respectively.

$$PR = \sum_{i=2}^n \sum_{k=1}^m (X_1 \times X_2), \quad (2)$$

$$CR = (X_1 \times X_2 \times \dots \times X_n), \quad (3)$$

where  $n$  indicates the number of input layers (input layer excluded),  $X$  represents the number of membership functions in a variable and  $m$  indicates the number of fuzzy inference systems in each layer.

In the proposed CHFIS model we defined six MFs for input variable  $P_1$  and five for input variable  $P_2$  of FIS\_1. Similarly, for FIS\_2, six and five MFs are defined for input variables  $P_3$  and  $P_4$  respectively. For output of FIS\_1 five MFs, and for FIS\_2 five output MFs are defined. The outputs of FIS\_1 and FIS\_2 are further inputs to FIS\_3 and for FIS\_3 output, five MFs are defined. Hence by putting these values in Equation (2) as shown below, we require 85 rules to fully implement the proposed CHFIS model.

$$PR = (6 \times 5) + (6 \times 5) + (5 \times 5) = 85.$$

The number of rules requires to implement the CFL entirely; we require 900 rules as illustrated below by putting the values in Equation (3).

$$CR = 6 \times 5 \times 6 \times 5 = 900.$$

Hence, it is proved that the proposed CHFIS model brings a reduction in rules while implementing the full structure of FL. The number of rules required to implement the proposed model is much less, as compared to the CFL model. In Table 1 we have made a short comparison of the proposed CHFIS in terms of the required number of rules to implement the full structure FL.

**Table 1.** Fuzzy logic with the number of rules.

Model	Number of Rules
Proposed Cohesive hierarchical fuzzy logic model	85
Conventional fuzzy logic model	900
Simplified hierarchical fuzzy logic model [17]	175

A total of 30 rules were defined in FIS\_1, as listed in Table 2. Similarly, 30 rules were defined for FIS\_2 in the same manner as listed in Table 3. The linguistic terms NG, N, ND, D, DR and DT were defined to MFs of variable depth which denote near to the ground, normal, near to deep, deep, deeper and deepest. In the same way, the labels assigned to each MFs of variable length are ST, S, M, L and LG which denote shorter, short, medium, long and longer, respectively. The linguistic terms for output variable FIS\_1 are defined as VLLR, LLR, MLR, HLR and VHRL which denotes very low-level risk, medium level risk, high-level risk and very high-level risk respectively.

**Table 2.** Rule designed for fuzzy inference system (FIS)\_1.

$P_2 \backslash P_1$	NG	N	ND	D	DR	VT
ST	VLLR	VLLR	LLR	MLR	MLR	VHRL
S	LLR	LLR	MLR	MLR	HLR	LLR
M	LLR	MLR	MLR	HLR	VHRL	LLR
L	MLR	MLR	HLR	VHRL	VHRL	MLR
LG	MLR	HLR	VHR	VHRL	VHRL	HLR

**Table 3.** Rule design for FIS\_2.

$P_4 \backslash P_3$	VLP	VHL	MLP	HLP	VHP	EHP
OD	VLLR	VLLR	LLR	MLR	MLR	VHRL
O	VLLR	LLR	MLR	MLR	HLR	VHRL
MA	LLR	MLR	MLR	HLR	VHRL	VHRL
N	MLR	MLR	HLR	VHRL	VHRL	VHRL
BN	MLR	HLR	VHRL	VHRL	VHRL	VHRL

Similarly, for input variable probability of leakage of the FIS\_2 modules, the linguistic terms, ELP, VLP, LP, MLP, HLP and VHP, EHP were defined. These terms are abbreviations of extremely low probability, very low probability, low probability, medium probability, high probability and very high probability. The labels assigned to the second input variable age of FIS\_2 module are OD, O, MA, N and BN which denote older, old, medium age, new and brand new. For the output variable of FIS\_2, the same number and linguistic terms of MFs were defined as for output variables of FIS\_2. The output of the FIS\_1 and FIS\_2 are further inputs to FIS\_3. The linguistic terms for the output variables of FIS\_3 are VLR, LR, MR, HR, and VHR which denote very low risk, low risk, medium risk, high risk and very high risk, accordingly. The rules for FIS\_3 are given in Table 4.


**Table 4.** Rule design for FIS\_3.

$PR_2 \backslash PR_1$	VLLR	LLR	MLR	HLR	VHRL
VLLR	VLR	VLR	LR	MR	MR
LLR	VLR	LR	MR	MR	HR
MLR	LR	MR	MR	HR	VHR
HLR	MR	MR	HR	VHR	VHR
VHRL	MR	HR	VHR	VHR	VHR

## 4. Implementation and Experimental Results

### 4.1. Implementation

The implementation of the CHFIS model was carried out in C#, but for visual graphical MFs and rules, we used MATLAB version 7.10.0.499 installed on an Intel (R) Core (TM) i5-3570 CPU@3.40 GHz computer system. In this work, we developed a CHFIS model for WSPL risk assessment. The determined MFs for FIS\_1 are shown in Figure 4.

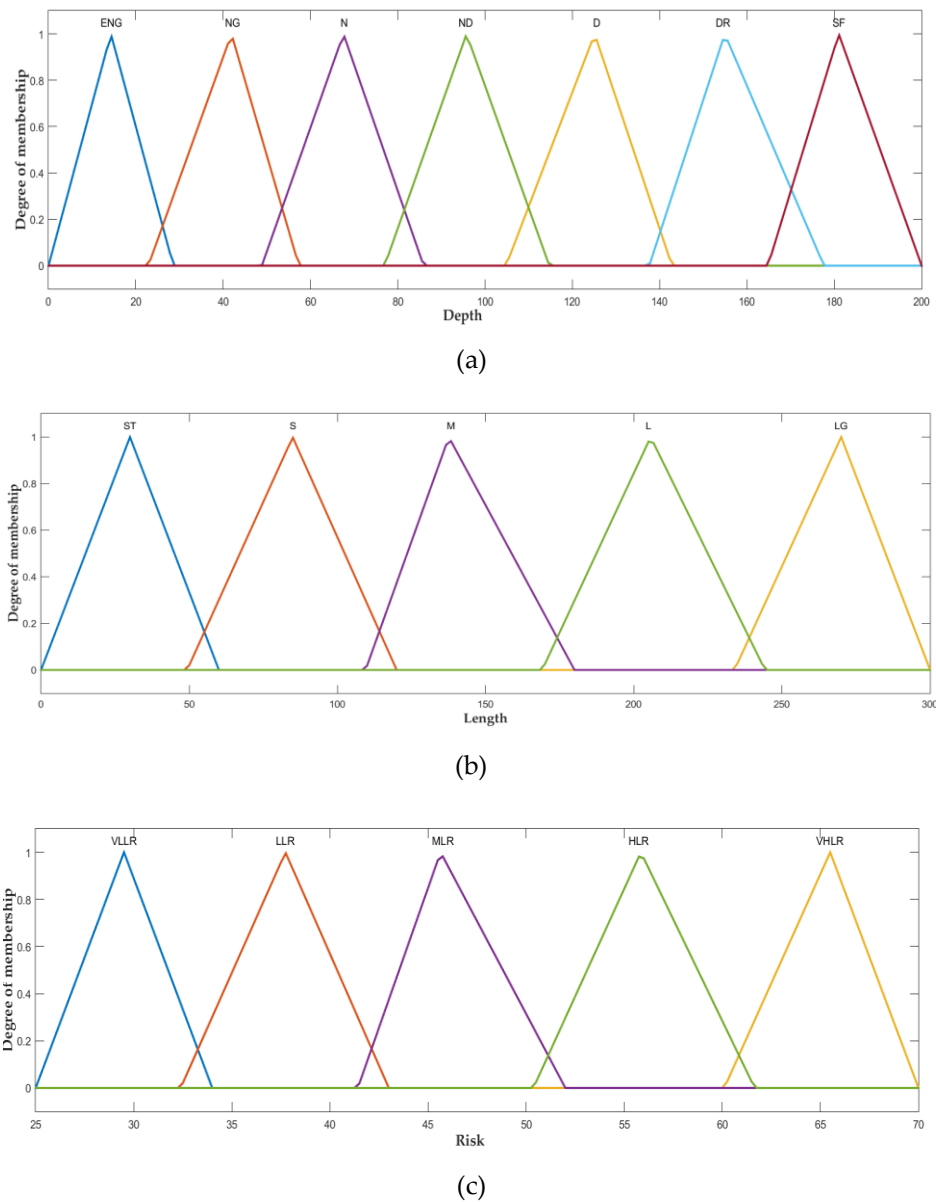

**Figure 4.** Input/output MFs for FIS\_1 of the proposed CHFIS model, (a) depth; (b) length; (c) risk.

The rule viewer using the above input and output MFS is illustrated in Figure 5 in order to demonstrate the operation of FIS\_1.



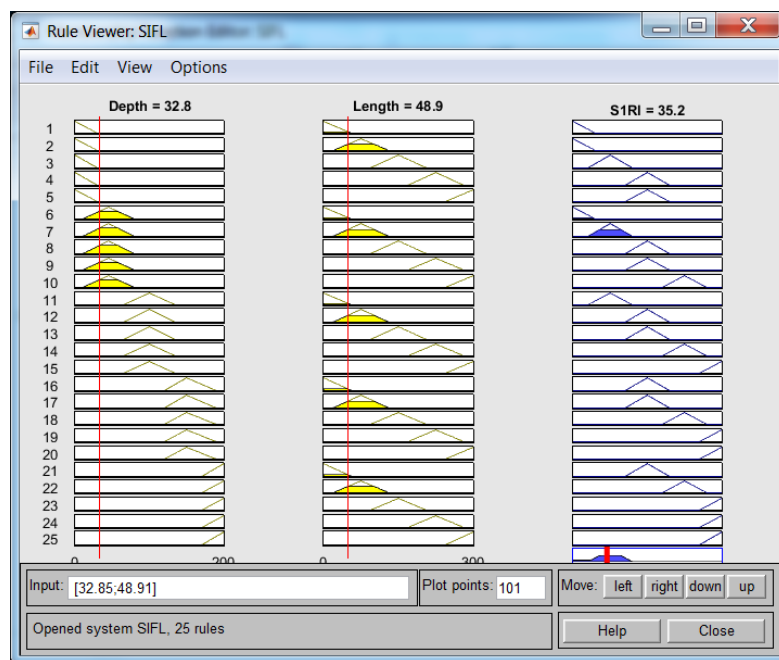


Figure 5. Rule viewer of FIS\_1.

The input/output MFS for FIS\_2 are illustrated in Figure 6. Figure 6a represents the MFs of the input variable leakage probability, and Figure 6b indicates the MFs of the input variable age and Figure 6c indicates the MFs of the output variable of FIS\_2.



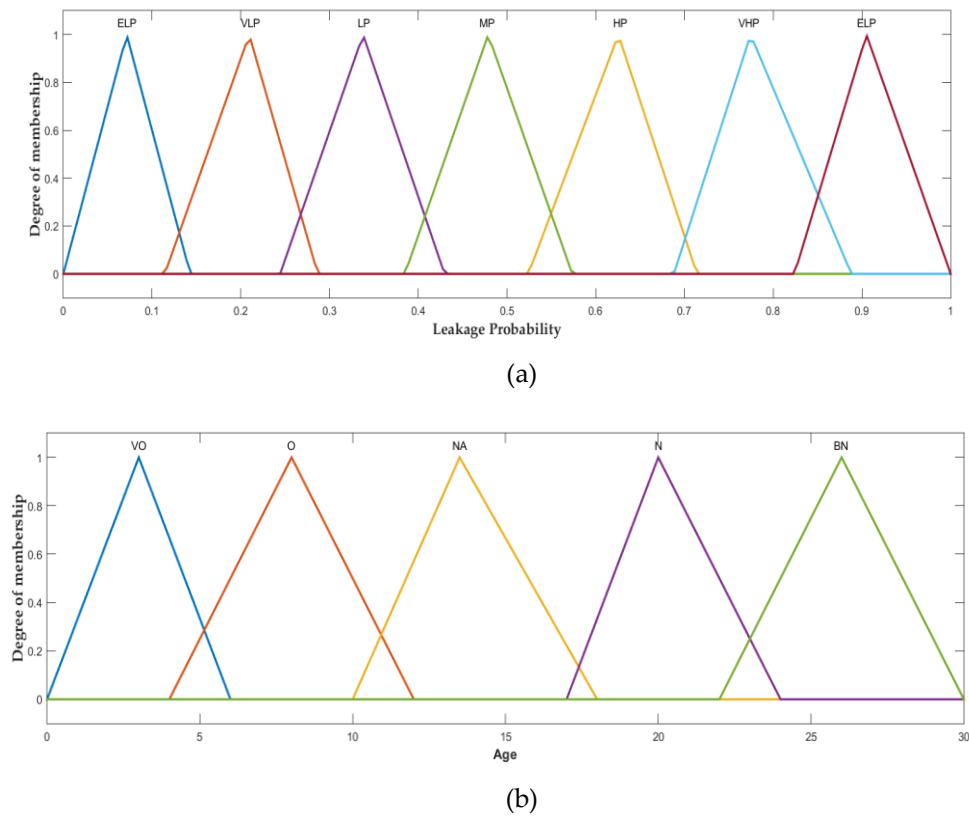


Figure 6. Cont.

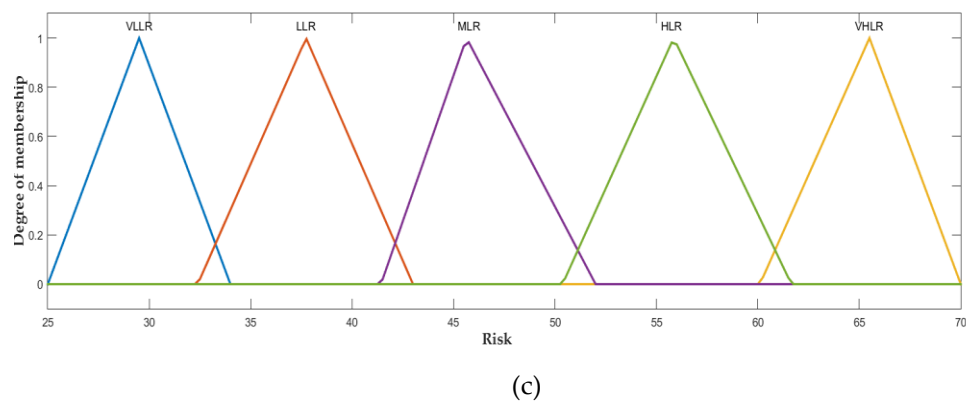


**Figure 6.** Input/output MFs for FIS\_1 of the proposed CHFIS model, (a) leakage probability; (b) age; (c) risk.

The rule viewer using the above input and output MFs is illustrated in Figure 7 in order to demonstrate the operation of FIS\_2.

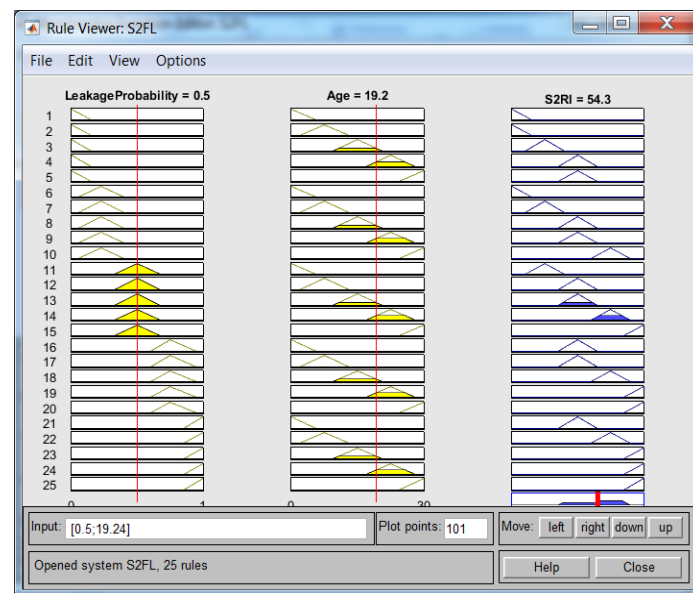


**Figure 7.** Rule viewer of S<sub>2</sub>\_FIS.

The outputs of the FIS\_1 and FIS\_2 were used as inputs to FIS\_3. Same MFs were defined for the input variable FIS\_3 as for the output variable of FIS\_1. The output membership functions for FIS\_1 and FIS\_2 are illustrated in Figures 4c and 6c respectively. For the output variable FIS\_3, the determined MFs are given in Figure 8.

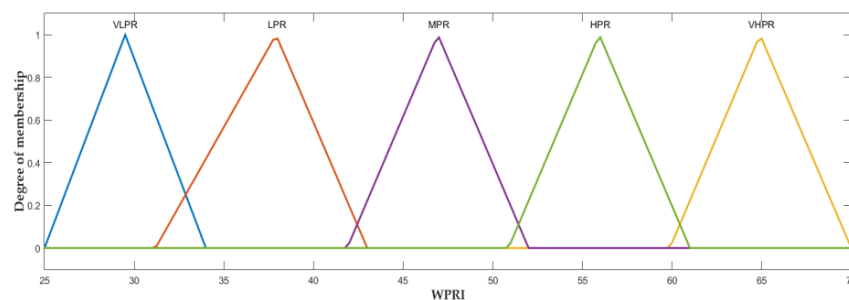

**Figure 8.** MFs for the output variable of FIS\_3.

The rule viewer using the above input and output MF<sub>S</sub> is illustrated in Figure 9 in order to demonstrate the operation of FIS<sub>3</sub>.

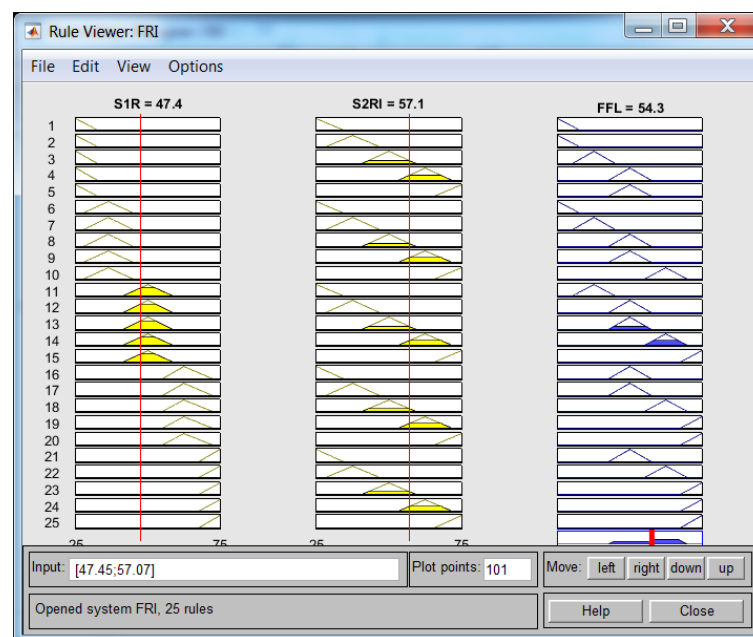

**Figure 9.** Rule viewer for the output variable of FIS<sub>3</sub>.


Table 5 overviews the implementation stack of the embedded hardware being used in the experiments. Raspberry PI 3 model B was utilized as a gateway on which Raspbian OS was installed. Furthermore, LEDs with different colors were connected with different general-purpose input/output (GPIO) ports of Raspberry PI to trigger one of them based on the risk index. Vim was used as a terminal editor whereas a full-fledged IDE named as PyCharm was used to access the Raspberry PI terminal remotely. For communication, CoAP protocol was used, and the CoAP server was installed on Raspberry PI to listen to the requests.

**Table 5.** Components description of the Raspberry PI.

Component	Description
Hardware	Raspberry PI 3 Model B
Operating System	Raspbian
Memory	1GB
Actuators	LEDs
IDE	Vim, PyCharm (Remote Access)
Programming Language	Python 3
Libraries	CoAP Server, GPIO


#### 4.2. Results of CHFIS Model

In this paper, we applied the CHFIS model on four input parameters namely depth, length, age and leakage probability. Only four parameters were considered for WSPRI because we have real data for these parameters supplied by the Electronics and Telecommunications Research Institute (ETRI) organization. The data was gathered from 1989 to 2010 of WSPLs located at different locations of Seoul, Republic of Korea. The input data for depth, length, age and leakage is given in Figure 10.

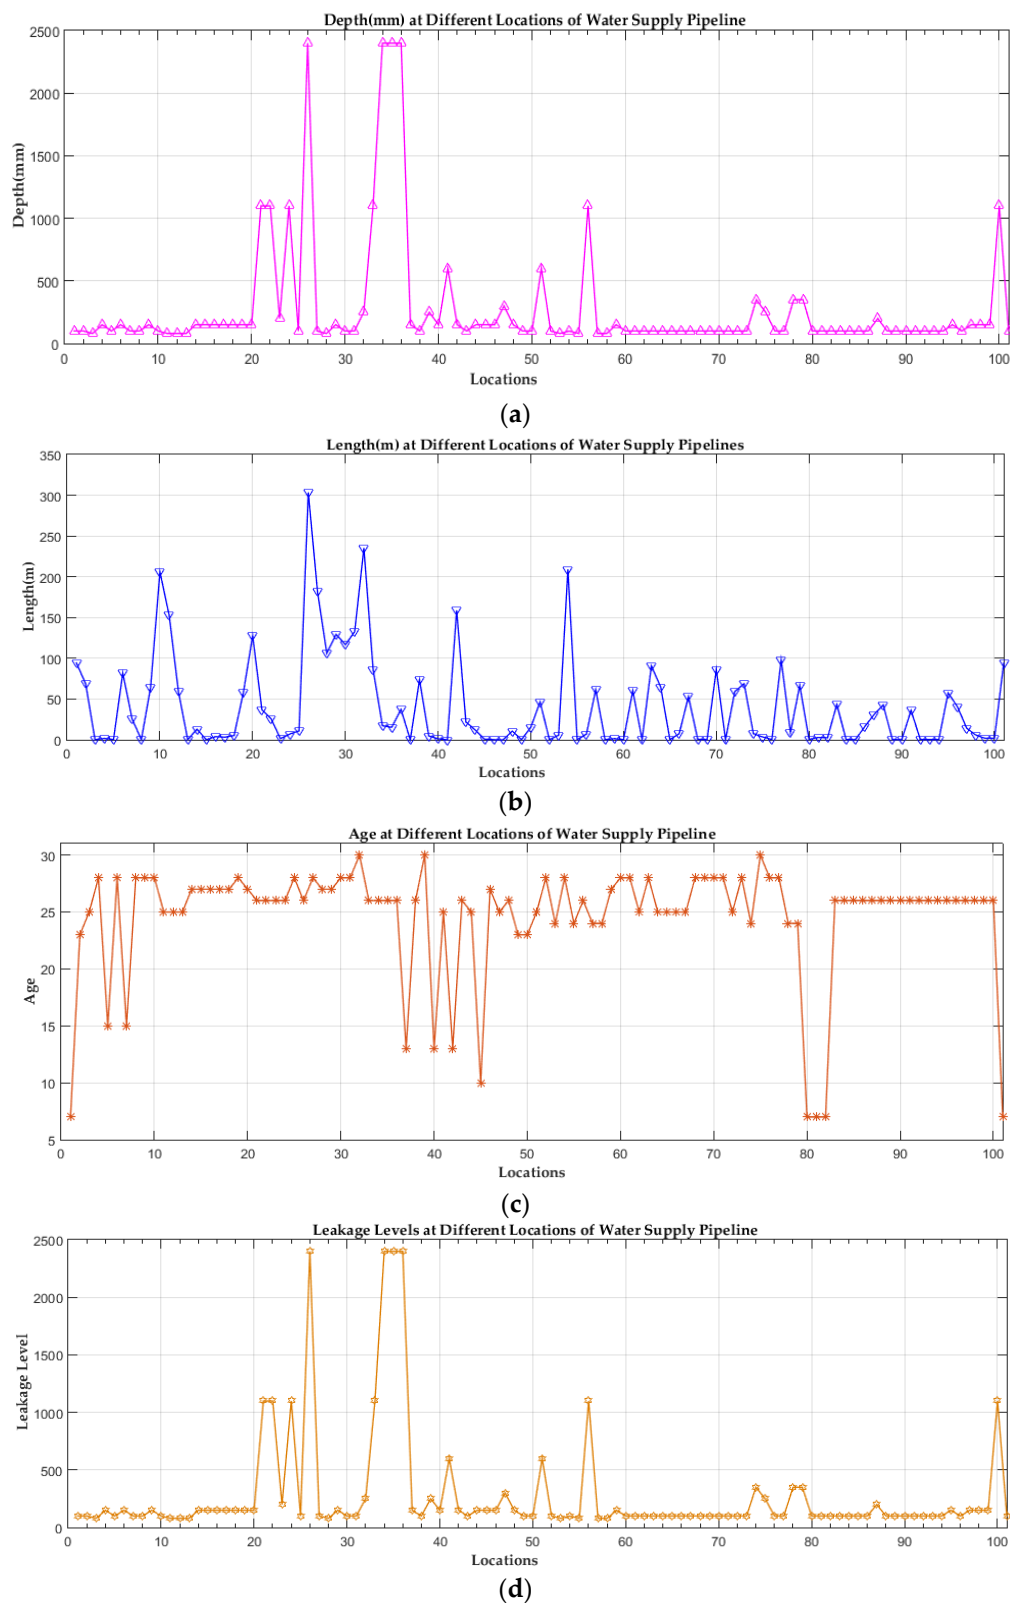


**Figure 10.** Input data of parameters: (a) depth; (b) length; (c) age; and (d) leakage.

The risk index values calculated by the proposed CHFIS method based on the given four parameters is illustrated in Figure 11. The red color lines represent the actual risk index values, and the blue color represents the estimated risk index values.

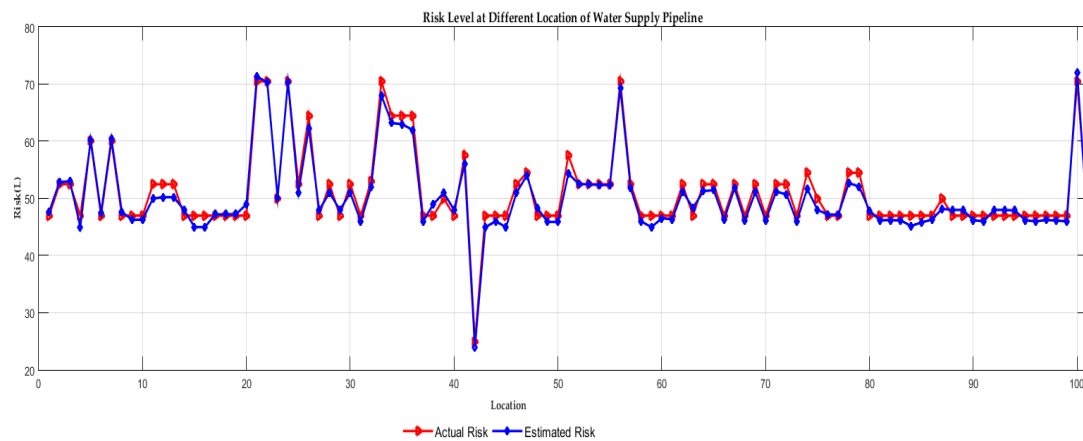

**Figure 11.** The real risk index values and the estimated risk index values calculated by the CHFIS method for water supply pipelines (WSPL).

Figure 12 shows the experimental setup for the proposed work. In this setup, Raspberry PI was used as an IoT gateway. It also hosts an IoT server which listens to the requests, processes them and takes action accordingly. For visualization of risk, six LED actuators were used; each of them represents a category of risk. For instance, in Figure 12, the red color LED is turned on which indicates the risk factor is high. The LED light indication can be useful in assessing risk index while deploying it in a real environment where actual lights represent the risk index in some locations. Six LEDs were used for different risk categories.

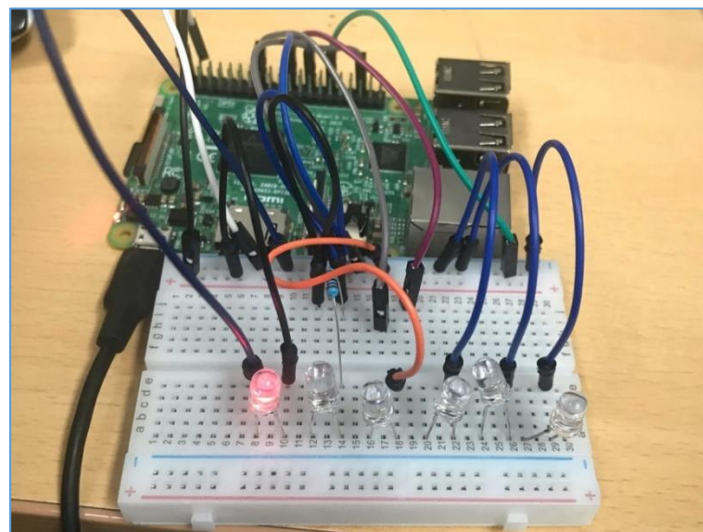

**Figure 12.** The experimental environment for the risk index of CHFIS model.

## 5. Conclusions and Future Work

In this paper, we proposed a new model based on the hierarchical structure for water supply pipeline risk index called the cohesive hierarchical fuzzy inference system (CHFIS). In the proposed CHFIS for MFs determination, we used a new method called the heuristic based MFs determination scheme in order to determinate accurate MFs for fuzzy logic modules. We used real data to calculate the risk index values for water supply pipelines risk index assessment. The risk indexes of WSPLs was categorized in different levels. Next, the risk index values calculated by CHF were shown by different LED light colors in order to assist the caretaker in taking measures accordingly. In the future, we would like to design different hierarchical fuzzy logic models and carry out their implementation in order to cover a different aspect of the data and different caretaker demands for the water supply

risk index. We will also add more parameters in order to improve the accuracy of the system and cover different reasons of failures of the water supply pipelines.

**Author Contributions:** M.F. conceived the idea for this paper, designed and performed the experiments and wrote the papers. S.A. helped in writing review and results analysis. L.H. helped to prepare the data and resources. D.K. conceived the overall idea of the paper, and supervised this work.

**Funding:** This research was supported by the MSIT(Ministry of Science and ICT), Korea, under the ITRC(Information Technology Research Center) support program(IITP-2017-2016-0-00313) supervised by the IITP(Institute for Information & communications Technology Promotion) and this work was supported by Institute for Information & communications Technology Promotion(IITP) grant funded by the Korea government(MSIT) (No.2018-0-01456, AutoMaTa: Autonomous Management framework based on artificial intelligent Technology for adaptive and disposable IoT) Any correspondence related to this paper should be addressed to DoHyeun Kim.

**Conflicts of Interest:** The authors declare no conflict of interest.

## References

1. Kleiner, Y.; Rajani, B. Considering time-dependent factors in the statistical prediction of water main breaks. In Proceedings of the American Water Works Association Infrastructure Conference, Baltimore, MD, USA, 12 March 2000; pp. 12–15.
2. Kleiner, Y.; Rajani, B. Forecasting variations and trends in water-main breaks. *J. Infrastruct. Syst.* **2002**, *8*, 122–131. [\[CrossRef\]](#)
3. Kiefner, J.; Rosenfeld, M. *The Role of Pipeline Age in Pipeline Safety*; INGAA: Worthington, DC, USA, 2012; Available online: <https://www.ingaa.org/File.aspx?id=19307> (accessed on 27 March 2019).
4. Christodoulou, S.E. Water network assessment and reliability analysis by use of survival analysis. *Water Resour. Manag.* **2011**, *25*, 1229–1238. [\[CrossRef\]](#)
5. Inanloo, B.; Tansel, B.; Shams, K.; Jin, X.; Gan, A. A decision aid GIS-based risk assessment and vulnerability analysis approach for transportation and pipeline networks. *Saf. Sci.* **2016**, *84*, 57–66. [\[CrossRef\]](#)
6. Christodoulou, S.; Aslani, P.; Deligianni, A. Integrated GIS-based management of water distribution networks. In Proceedings of the International Conference on Computing and Decision Making in Civil and Building Engineering, Montreal, QC, Canada, 14–16 June 2006; pp. 858–865.
7. Tang, X.; Liu, Y.; Zheng, L.; Ma, C.; Wang, H. Leak detection of water pipeline using wavelet transform method. In *International Conference on Environmental Science and Information Application Technology*, Wuhan, China, 4–5 July 2009; IEEE: Piscataway, NJ, USA, 2009; pp. 217–220.
8. Caley, F.; Velazquez, J.; Valor, A.; Hallen, J. Probability distribution of pitting corrosion depth and rate in underground pipelines: A monte carlo study. *Corros. Sci.* **2009**, *51*, 1925–1934. [\[CrossRef\]](#)
9. Zadeh, L.A. Fuzzy sets. *Inf. Control* **1965**, *8*, 338–353. [\[CrossRef\]](#)
10. Lee, M.-L.; Chung, H.-Y.; Yu, F.-M. Modeling of hierarchical fuzzy systems. *Fuzzy Sets and Syst.* **2003**, *138*, 343–361. [\[CrossRef\]](#)
11. Satıcı, A.C.; Poonawala, H.; Spong, M.W. Robust optimal control of quadrotor UAVs. *IEEE Access* **2013**, *1*, 79–93. [\[CrossRef\]](#)
12. Alexis, K.; Nikolakopoulos, G.; Tzes, A. Model predictive quadrotor control: Attitude, altitude and position experimental studies. *IET Control. Theory Appl.* **2012**, *6*, 1812–1827.
13. Fayaz, M.; Ullah, I.; Park, D.-H.; Kim, K.; Kim, D. An integrated risk index model based on hierarchical fuzzy logic for underground risk assessment. *Appl. Sci.* **2017**, *7*, 1037. [\[CrossRef\]](#)
14. Fayaz, M.; Ahmad, S.; Ullah, I.; Kim, D. A Blended Risk Index Modeling and Visualization Based on Hierarchical Fuzzy Logic for Water Supply Pipelines Assessment and Management. *Processes* **2018**, *6*, 61. [\[CrossRef\]](#)
15. What is Raspberry pi. Available online: <https://www.raspberrypi.org/help/what-is-a-raspberry-pi/> (accessed on 4 November 2018).
16. Available online: <http://www.arduino.cc/> (accessed on 5 November 2018).
17. Fayaz, M.; Ullah, I.; Kim, D.-H. Underground Risk Index Assessment and Prediction Using a Simplified Hierarchical Fuzzy Logic Model and Kalman Filter. *Processes* **2018**, *6*, 103. [\[CrossRef\]](#)

18. Li, D.; Yao, W. Risk assessment of long-distance water transmission pipeline based on fuzzy similarity evaluation approach. Proceedings of 12th International Conference on Natural Computation, Fuzzy Systems and Knowledge Discovery (ICNC-FSKD), Changsha, China, 13–15 August 2016; pp. 1096–1102.
19. Tripathy, D.P.; Ala, C.K. Risk assessment in underground coalmines using fuzzy logic in the presence of uncertainty. *J. Inst. Eng.* **2018**, *99*, 157–163. [[CrossRef](#)]
20. Chen, C.-T.; Lin, C.-T.; Huang, S.-F. A fuzzy approach for supplier evaluation and selection in supply chain management. *Int. J. Product. Econ.* **2006**, *102*, 289–301. [[CrossRef](#)]
21. Gul, M.; Guneri, A.F. A fuzzy multi criteria risk assessment based on decision matrix technique: A case study for aluminum industry. *J. Loss Prev. Process. Ind.* **2016**, *40*, 89–100. [[CrossRef](#)]
22. Zhang, J.; Gao, J.; Diao, M.; Wu, W.; Wang, T.; Qi, S. A case study on risk assessment of long distance water supply system. *Procedia Eng.* **2014**, *70*, 1762–1771. [[CrossRef](#)]
23. Zhao, X.; Hwang, B.-G.; Gao, Y. A fuzzy synthetic evaluation approach for risk assessment: A case of singapore's green projects. *J. Clean. Product.* **2016**, *115*, 203–213. [[CrossRef](#)]
24. Chang, C.-W.; Tao, C.-W. A simplified implementation of hierarchical fuzzy systems. *Soft Comput.* **2018**, 1–11. Available online: <https://link.springer.com/article/10.1007%2Fs00500-018-3111-3> (accessed on 27 March 2019).
25. Fayaz, M.; Ullah, I.; Kim, D. An optimized fuzzy logic control model based on a strategy for the learning of membership functions in an indoor environment. *Electronics* **2019**, *8*, 132. [[CrossRef](#)]



© 2019 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).