



# A Techno-Economic Study of a Hybrid PV–Wind–Diesel Standalone Power System for a Rural Telecommunication Station in Northeast Algeria <sup>†</sup>

Ahlem Zegueur , Toufik Sebbagh  and Abderrezak Metatla

LGMM, Mechanical Engineering Department, University of Skikda, Skikda 21000, Algeria;

t.sebbagh@univ-skikda.dz (T.S.); a.metatla@univ-skikda.dz (A.M.)

\* Correspondence: zegueurahlem@gmail.com

<sup>†</sup> Presented at the 4th International Electronic Conference on Applied Sciences, 27 October–10 November 2023;

Available online: <https://asec2023.sciforum.net/>.

**Abstract:** Telecommunication stations, particularly operating in rural areas, are usually powered by diesel generators due to the lack of access to the utility grid. However, the growing cost of energy due to the constantly increasing fuel prices and the related greenhouse gas emissions contributing to global warming have driven telecom companies to seek better energy management solutions. In this paper, we study the economic feasibility of an environmentally friendly power supply system for rural telecommunication station in the city of Skikda, northeast Algeria. The proposed system is a standalone hybrid PV–wind system with pre-existing diesel generators and battery storage. Different system configurations are considered in the study: (a) diesel generators only, (b) PV–diesel–battery, (c) wind–diesel–battery, (d) PV–wind–diesel–battery, and lastly (e) PV–wind–battery; this helps to select the optimal solution based on the lowest net present cost (NPC) and the cost of energy (COE) of each configuration. The optimization is performed using HOMER PRO software 3.14.2 version. The results showed that a hybrid system of 5 kW DG, 3.81 kW of PV capacity, three wind turbines, and a 14-battery bank is the best design for the proposed power system with an NPC of USD 85673 and a COE of USD 0.214. The greenhouse gas emissions were considerably reduced by more than half making the proposed system a technically, economically, and environmentally viable solution.

**Keywords:** telecommunication; hybrid system; PV; wind; renewable energy; optimal sizing; Homer



**Citation:** Zegueur, A.; Sebbagh, T.; Metatla, A. A Techno-Economic Study of a Hybrid PV–Wind–Diesel Standalone Power System for a Rural Telecommunication Station in Northeast Algeria. *Eng. Proc.* **2023**, *56*, 25. <https://doi.org/10.3390/ASEC2023-15250>

Academic Editor: Andrea Ballo

Published: 26 October 2023



**Copyright:** © 2023 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

## 1. Introduction

Industrial development and rapid population growth have resulted in increasing energy consumption in all sectors including telecommunications [1]. Most telecom stations operate in rural and remote areas using diesel generators (DGs) due to the unavailability of the utility grid or the high-cost investment of grid extensions. Although the initial cost of using generators is low, there are other issues related to their operation. On the one hand, DGs require high maintenance and fuel consumption, which results in high operating costs due to the increasing prices of fossil fuels. On the other hand, they have a huge environmental impact because of the significant greenhouse gas emissions related to their operation, which contribute to global warming [2,3]. Hence, searching for alternative power solutions that are reliable, cost-effective, and environmentally friendly is mandatory.

Renewable energy resources such as solar and wind are widely used as alternative energy solutions and are considered as a primary source for decarbonizing the energy sector. However, due to their intermittent nature, an energy storage system (ESS) is required to store the excess of electricity produced to enhance the system's reliability in meeting the load demand when there is no renewable power production [4]. For this end, batteries are commonly used as an ESS to store surplus energy during overflow periods.

Many studies in the literature have reported the problem of powering telecommunication stations and towers by implementing renewable energy as a main power source. R. Kaur et al. [5] assessed the techno-economic feasibility of a PV–wind-based DC micro-grid for a 3.5 kW telecom tower using the NSGA II algorithm to find the optimal size. The main objectives of the study were minimizing the cost of energy (COE), the loss of power supply probability (LPSP), and the excess of energy (EE). The results showed that a 100% reliable system ( $LPSP = 0$ ) had a 35% lower COE than the conventional DG system, and further increasing the LPSP value resulted in a COE lower than that of the grid power supply. In [6], the authors investigated the technical, economic, and environmental performance of multiple hybrid power systems to power a remote telecom station using HOMER Software in order to find the best configuration, which was the hybrid configuration of PV/wind/DG/FC and which corresponded to the lowest net present cost (NPC) and COE. Kusakana and Vermaak [7] investigated the feasibility and the environmental impact of four different combinations of a PV/wind/DG hybrid system as a primary source of energy to supply telecom base transceiver stations in three different rural regions of the Republic of Congo. In [8], the authors proposed a hybrid PV/FC power system for a telecom base station in India. The results showed that the proposed system has a very low cost compared to the conventional-power-based system. In a similar study [9], the author proposed the FC technology for the power supply of the Italian telecom stations as a sustainable and cost-effective solution. In [10], authors simulated three different renewable-based system configurations to find the optimal power system design for powering a base transceiver station (BTS) in Sudan. The winning case was PV/DG/battery with PV contributing to 97% of the power generation. In [11], the authors proposed a PV/wind/DG/battery system for powering a remote telecom tower in Nigeria. The study revealed that the PV/DG/battery system had the lowest NPC and COE with a renewable fraction of 78% making it an economically viable and sustainable solution.

This study aims to reduce the operating costs and environmental impact of a diesel-based operating telecom station by replacing pre-existing diesel generators with a hybrid renewable energy system and batteries as an energy storage system. HOMER Pro (hybrid optimization model for multiple energy Resources) software is used to perform the techno-economic study of multiple configurations with different renewable fractions from 0 to 100%: (a) diesel generators only, (b) PV–diesel–battery, (c) wind–diesel–battery, (d) PV–wind–diesel–battery, and lastly (e) PV–wind–battery to determine the optimal configuration that meets the technical, economic, and environmental needs.

## 2. Methodology and System Modeling

HOMER Pro software is used to assess the techno-economic feasibility of the proposed hybrid system. The software has a three-stage process: simulation in which different configurations are considered, optimization in which all the technically feasible solutions are sorted based on the lowest net present cost (NPC) and cost of energy (COE), and finally, sensitivity analysis, where different values for the same input parameter can be entered to see how the results can be affected. Homer is able to perform the simulation of one-year data and allows the evaluation of a large number of different design combinations using inputs such as technology options, power sources, unit costs, and so on and sort the results of the feasible configurations based on the lowest NPC. HOMER also displays the simulation results in a wide variety of tables and graphs, which helps to compare configurations and evaluate their economic and technical merits [12]. HOMER has been extensively used in literature for hybrid renewable energy system (HRES) optimization and various case studies due to its simple and quick analysis of the vast variety of different HRES. The main limitation of the software that it allows only one objective function for minimizing the NPC; as such, multiobjective problems cannot be formulated [13].

The total NPC (or lifecycle cost) is HOMER's main objective function. It is the value by which HOMER ranks all system configurations of the optimization results and the basis from which it calculates the total annualized cost and the levelized cost of energy (LCOE).

The NPC of a system is the present value of all costs incurred throughout its lifetime minus the present value of all revenues earned throughout the lifetime [14]. It can be expressed as:

$$C_{NPC, tot} = \frac{C_{ann, tot}}{CRF}, \quad (1)$$

where  $C_{ann, tot}$  is the total annualized cost (\$/year), and  $CRF$  is the capital recovery factor expressed as:

$$CRF = \frac{i(1+i)^N}{(1+i)^N - 1}. \quad (2)$$

$N$  is the number of years, and  $i$  is the annual real discount rate (%).

Another convenient economic metric by which systems can be compared in Homer is the levelized cost of energy (COE). However, Homer does not rank systems based on their COE, which is another drawback of the software. It can be calculated as follows [14]:

$$COE = \frac{C_{ann, tot}}{E_{served}}, \quad (3)$$

where  $C_{ann, tot}$  is the total annualized cost (\$/year), and  $E_{served}$  is the total electrical load served (kWh/year).

The upcoming section describes the location of the telecommunication station and the energetic potential of the site as well as the model of the proposed system.

### 2.1. Renewable Energy Potential and Telecom Load

The telecommunication station is situated in a rural area in the city of Skikda, in the Algerian northeast. The coordinates of the location are  $37^{\circ}0.8' N$ ,  $6^{\circ}33.8' E$ , based on which the weather data of the site were obtained from the NASA meteorology database [15].

#### 2.1.1. Solar and Wind Energy

The monthly average irradiation and wind speed at the studied site are depicted in Figures 1a and 1b, respectively. The location receives a yearly total radiation of approximately 1.74 MWh/m<sup>2</sup> with an annual average estimated at 4.75 kWh/m<sup>2</sup>/day and a peak of 7.176 kWh/m<sup>2</sup>/day in the month of July, while the annual wind speed is estimated at 5.58 m/s with the highest speed marked in December, estimated at 6.84 m/s.


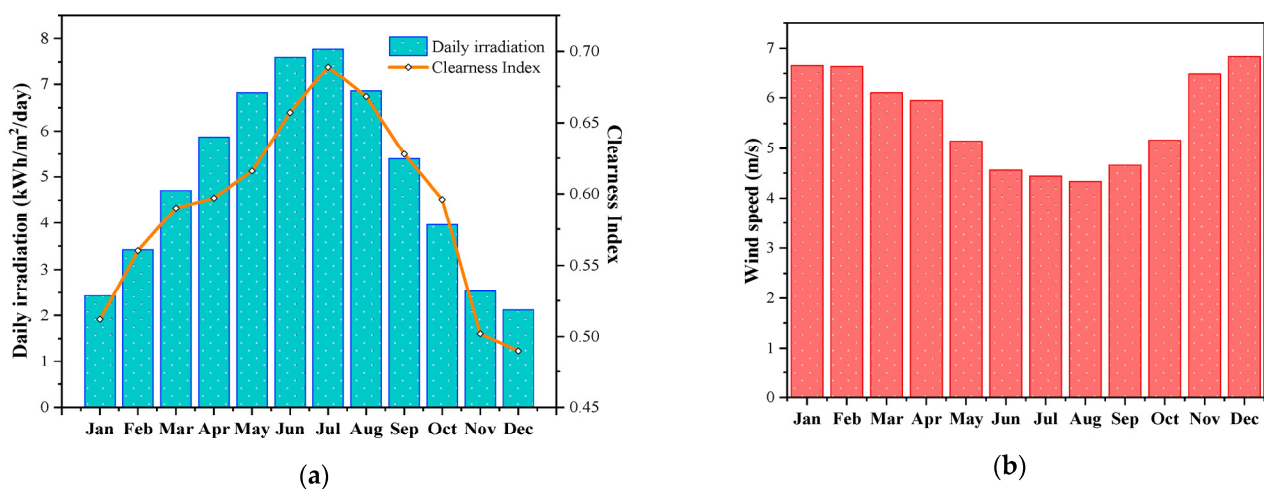


Figure 1. Cont.

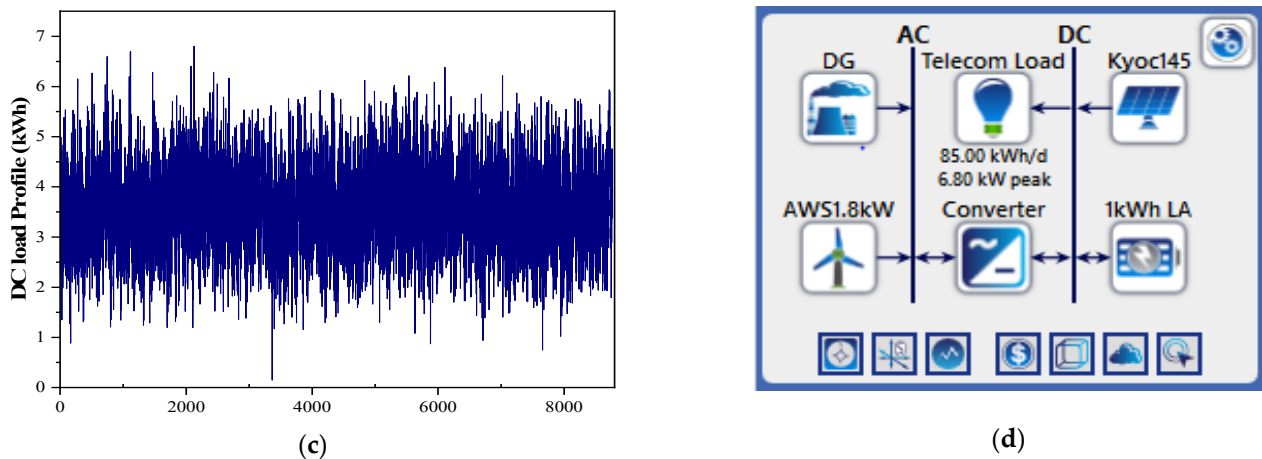

**Figure 1.** (a) Monthly average solar irradiation; (b) monthly average wind speed; (c) telecom load hourly profile; (d) schematic of the proposed system in Homer Pro.

### 2.1.2. Electric Load Profile

The hourly electric consumption of the studied telecommunication station is shown in Figure 1c. It is a DC primary load with an average consumption of 85 kWh/day.

## 2.2. System Modeling

### 2.2.1. PV Array

Solar photovoltaic is a key technology in energy transition. The PV array power output can be calculated using the following equation [14]:

$$P_{PV} = Y_{PV} f_{PV} \left( \frac{G_T}{G_{T,STC}} \right) (1 + \alpha_p (T_c - T_{c,STC})), \quad (4)$$

where the  $Y_{PV}$  is the rated power of the PV array (kW),  $f_{PV}$  is the derating factor (%),  $G_T$  and  $G_{T,STC}$  are, respectively, the solar radiation incident on the PV array and the standard incident radiation ( $W/m^2$ ).  $\alpha_p$  is the power temperature coefficient ( $^\circ C$ ).  $T_c$  and  $T_{c,STC}$  are the PV cell and the standard temperatures in ( $^\circ C$ ), respectively.

The PV panel chosen in this study is a flat plate Kyocera 145 SX-UFU series with a rated power of 145 W, a derating factor of 88%, and a temperature coefficient of  $-0.46$ . The lifetime of the panel is estimated to be 25 years for 80% output.

### 2.2.2. Wind Turbine

The wind turbine power output is calculated using a three-step process. Firstly, the wind speed at the hub height of the WT is calculated using the following power law [14]:

$$U_{hub} = U_{anem} \left( \frac{Z_{hub}}{Z_{anem}} \right)^\alpha, \quad (5)$$

where  $U_{hub}$  is the wind speed at the hub height (m/s), and  $U_{anem}$  is the speed at the anemometer height (m/s).  $Z_{hub}$  and  $Z_{anem}$  are the hub and the anemometer heights (m), respectively.  $\alpha$  is the power law exponent.

After determining  $U_{hub}$ , we refer to the WT's characteristic power curve to calculate the expected power output at that wind speed under standard conditions of temperature and pressure. Finally, to adjust to the actual conditions, the predicted power output is corrected through multiplying it by the air density ratio, as shown in the following equation:

$$P_{WT} = \left( \frac{\rho}{\rho_0} \right) P_{WT,STP}, \quad (6)$$

where  $\rho$  is the actual air density in ( $\text{kg}/\text{m}^3$ ), and  $\rho_0$  is the air density under standard conditions ( $\text{kg}/\text{m}^3$ ).  $P_{WT}$  and  $P_{WT,STP}$  are the wind turbine output power at actual conditions and at standard temperature and pressure (kW), respectively. For this study, the AWS HC wind turbine has a rated power of 1.8 kW.

### 2.2.3. Diesel Generator

The diesel generator is typically used as back-up power generation in off-grid power systems. The fuel consumption of the diesel generator is calculated assuming the following linear relationship [14]:

$$FC_{DIESEL} = \alpha P_{DG} + \beta P_{DG,r} \quad (7)$$

where  $\alpha$  is the generator fuel curve slope (L/kWh),  $\beta$  generator fuel curve intercept coefficient (L/kWh),  $P_{DG}$  is the power output of the diesel generator (kW), and  $P_{DG,r}$  is the rated power of the diesel generator (kW). The diesel generator used in the study has a 15,000 h operating lifetime.

### 2.2.4. Battery

Due to the intermittent nature of solar and wind energy, battery storage to ensure the reliability and stability of the energy is necessary. It is used to store the excess of electricity produced from PV and wind to be later used in shortfalls and peak loads. A generic 1 kWh lead–acid battery bank with 12 V nominal voltage and a 10-year lifetime was used in this study.

### 2.2.5. Converter

The wind and diesel generator outputs are AC, while the load is DC. Hence, a rectifier is required for the power transfer. A power converter with 95% efficiency and a 15-year lifetime was used in the system.

The proposed system model is shown in Figure 1d, while the economic input parameters of each component are found in Table 1. The diesel generator search space was set to 0 kW, 5 kW, and 10 kW with a fuel cost of 0.3 USD/L, while the Homer optimizer was used to determine the exact optimal size of the other components.

**Table 1.** Economic parameters for the proposed system components.

Component	Capital Cost	Replacement Cost	O&M Cost	Lifetime
Diesel generator	500 USD/kW	500 USD/kW	0.03 USD/op. hour	15,000 h
Kyocera KD 145	2500 USD/kW	2500 USD/kW	10 USD/kW	25 years
AWS HC 1.8 kW	USD 5500	USD 4800	50 USD/year	20 years
1 kWh Lead Acid	USD 300	USD 300	10 USD/year	10 years
Converter	300 USD/kW	300 USD/kW	0 USD/year	15 years

## 3. Results and Discussion

The main aim of this study is to reduce the dependence on DGs and replace them with renewable energy for a cost effective and sustainable power supply. Homer software was able to simulate different configurations with different renewable fractions in order to find the optimal configuration. Table 2 represents the main technical, economic, and environmental findings for each configuration. The base case where only generators are used has the lowest initial capital but a high NPC because of the high operating costs making it an unfavorable solution, especially with the high amounts of CO<sub>2</sub> emitted. The other hybrid systems were economically acceptable except for the 100% RES, which has the highest NPC due to the expensive installation cost. The winning configuration is PV–wind–DG–battery with an NPC of USD 85673 and a COE of USD 0.214 with a total electric production of 34,879 kWh/year, in which PV contributes 17.7% of the total production, 38.6% by WTs, and 43.7% by DGs. The fuel consumption was decreased to more than half that of the base


case. The optimal size of the different simulated configurations is represented in Table 3. It can be seen that the diesel capacity in the DG-combined configurations was reduced to half compared to the base case. The optimal size of the winning configuration was 3.81 kW of PV capacity, three wind turbines, 14 battery banks, and a 6.10 kW converter. Figure 2 shows how the pollutant emissions were considerably reduced in the optimal hybrid renewable energy system compared to the conventional one making it an environmentally friendly option. CO<sub>2</sub> emissions were reduced from 31,081 kg/year to 13,328 kg/year, which is the lowest amount among the other DG-combined renewable systems.

**Table 2.** Techno-enviro-economic comparative analysis for different configurations.

Configuration	NPC (USD)	COE (USD)	Initial Capital (USD)	Elec. Produced (kWh/Year)	Unmet Load (kWh/Year)	Fuel (L/Year)	CO <sub>2</sub> (kg/Year)	RF (%)
DGs	123,240	0.307	6830	32,901	3.95	11,873	31,081	0
PV/DG/Batt	87,359	0.218	24,585	32,921	0	7322	19,167	27.1
WT/DG/Batt	85,923	0.214	23,663	33,803	8.76	6731	17,621	34.4
PV/WT/DG/Batt	85,673	0.214	34,169	34,879	0	5091	13,328	50.8
PV/WT/Batt	169,349	0.423	115,111	57,353	20.3	0	0	100

**Table 3.** Optimal sizing for the base case, optimal case, and the rest of the configurations.

Component	DG	Kyocera KD 145	AWS HC 1.8 kW	1 kWh Lead Acid	Converter
Base case: DGs	10 kW	-	-	-	4.85 kW
Optimal case: PV/WT/DG/Batt	5 kW	3.81 kW	3	14	6.10 kW
PV/DG/Batt	5 kW	6.35 kW	-	16	4.71 kW
WT/DG/Batt	5 kW	-	3	10	5.54 kW
PV/WT/Batt	-	16 kW	7	116	5.93 kW

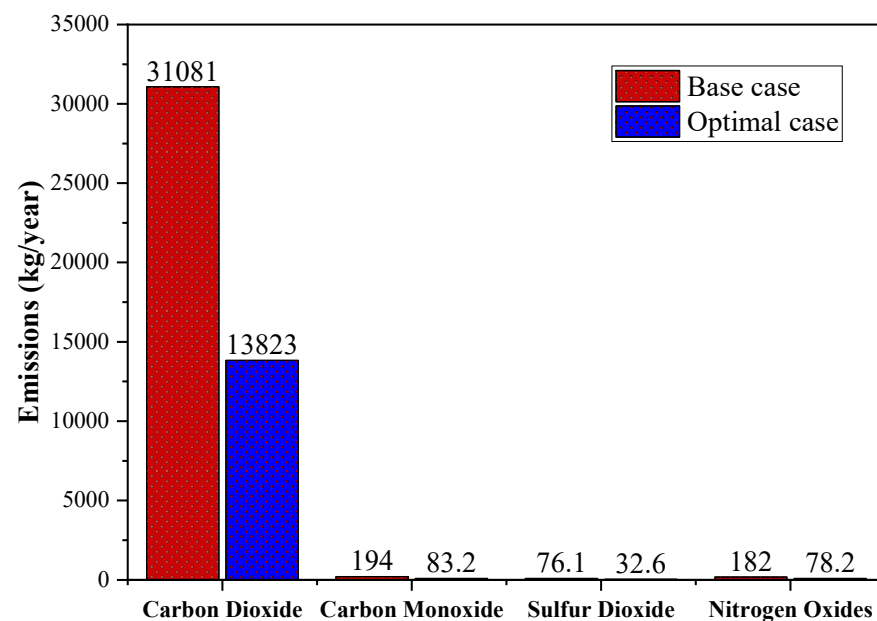

**Figure 2.** Pollutant emissions for the base and the optimal system.

The control strategy used in this study is the load-following strategy; this dispatch strategy is suitable for systems with high renewable penetration. The hourly energy



management for a representative day is clearly shown in Figure 3. The DC load is primarily supplied by the electricity produced from PV and wind turbines. The surplus is stored in batteries once there is an excess of power production. Whenever the renewable electricity produced is not enough to meet the load demand, the battery discharges to meet the deficiency. If the battery reaches its minimum state of charge, then the diesel generator operates to generate enough power output to meet the load.

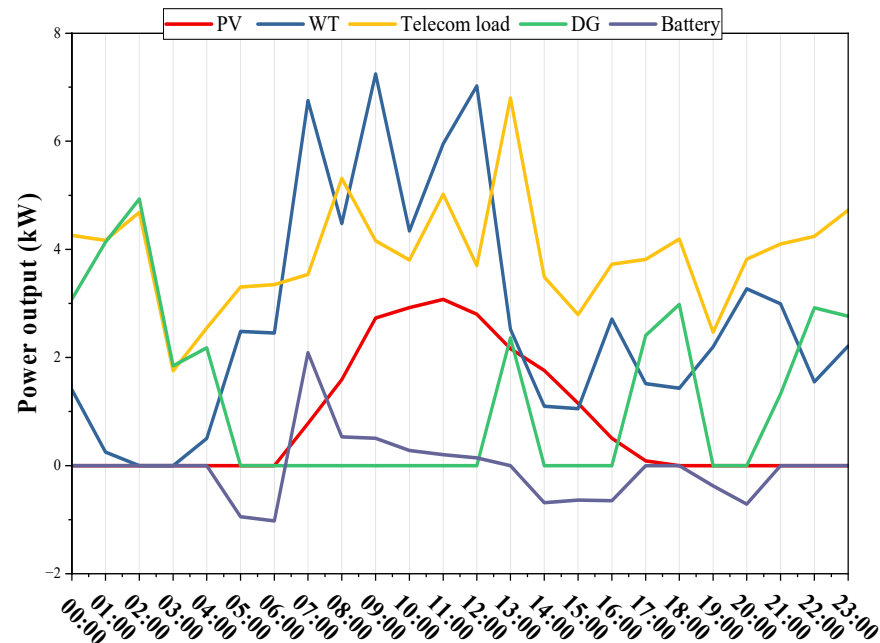


Figure 3. Hourly energy management of the optimal system.

#### 4. Conclusions

Telecommunication stations operating in rural areas present several technical, economic, and environmental issues that need to be addressed. This study investigated the feasibility of a hybrid PV–wind–diesel standalone system with battery storage to replace a DG-based power system for a rural telecommunication station located in the Algerian northeast. Homer software was used to perform the techno-economic and environmental analysis of the system. Different configurations were considered in the simulation in order to determine the optimal one, which was the PV–wind–diesel–battery hybrid system. Economically, the system had the lowest net present cost of USD 85673 and an LCOE of 0.214 USD/kWh, while the DG-based power system had an NPC of USD 123240 and an LCOE of 0.307%. Technically, the system to produce 34,879 kWh/year and was able to meet the annual load demand with 0 unmet load. Environmentally, greenhouse gas emissions were considerably reduced by more than half, since the dependence on DGs was reduced from 10 kW to 5 kW consuming 5091 L/year instead of 11,873 L/year. Overall, the proposed system was viable in every aspect, making the transition towards a RE-based system an attractive option economically and able to decarbonize the telecommunication sector while maintaining a high operating reliability.

**Author Contributions:** Conceptualization, A.Z. and T.S.; methodology, A.Z.; software, A.Z. and T.S.; validation, A.Z., T.S. and A.M.; resources, A.M.; writing—original draft preparation, A.Z.; writing—review and editing, T.S.; visualization, A.Z.; supervision, T.S. and A.M. All authors have read and agreed to the published version of the manuscript.

**Funding:** This research received no external funding.

**Institutional Review Board Statement:** Not applicable.

**Informed Consent Statement:** Not applicable.

**Data Availability Statement:** The data presented on this study are available on request from the corresponding author.

**Conflicts of Interest:** The authors declare no conflict of interest.

## References

1. Bahramara, S.; Moghaddam, M.P.; Haghighi, M.R. Optimal planning of hybrid renewable energy systems using HOMER: A review. *Renew. Sustain. Energy Rev.* **2016**, *62*, 609–620. [CrossRef]
2. Nema, P.; Nema, R. PV-solar/wind hybrid energy system for GSM/CDMA type mobile telephony base station. *Int. J. Energy Environ.* **2010**, *1*, 359–366.
3. Emad, D.; El-Hameed, M.A.; El-Fergany, A.A. Optimal techno-economic design of hybrid PV/wind system comprising battery energy storage: Case study for a remote area. *Energy Convers. Manag.* **2021**, *249*, 114847. [CrossRef]
4. Urs, R.R.; Chadly, A.; Al Sumaiti, A.; Mayyas, A. Techno-economic analysis of green hydrogen as an energy-storage medium for commercial buildings. *Clean Energy* **2023**, *7*, 84–98. [CrossRef]
5. Kaur, R.; Krishnasamy, V.; Kandasamy, N.K. Optimal sizing of wind–PV-based DC microgrid for telecom power supply in remote areas. *IET Renew. Power Gener.* **2018**, *12*, 859–866. [CrossRef]
6. Amutha, W.M.; Rajini, V. Techno-economic evaluation of various hybrid power systems for rural telecom. *Renew. Sustain. Energy Rev.* **2015**, *43*, 553–561. [CrossRef]
7. Kusakana, K.; Vermaak, H.J. Hybrid renewable power systems for mobile telephony base stations in developing countries. *Renew. Energy* **2013**, *51*, 419–425. [CrossRef]
8. Pachauri, R.K.; Chauhan, Y.K. Hybrid PV/FC stand alone green power generation: A perspective for Indian rural telecommunication systems. In Proceedings of the 2014 International Conference on Issues and Challenges in Intelligent Computing Techniques, ICICT 2014, Ghaziabad, India, 7–8 February 2014. [CrossRef]
9. Pizzuti, F.; Seguiti, C. Power supply to Telecom Stations through FC technology. In Proceedings of the INTELEC, International Telecommunications Energy Conference (Proceedings), Vancouver, BC, Canada, 28 September–2 October 2014.
10. Salih, T.; Wang, Y.; Adam, M.A.A. Renewable micro hybrid system of solar panel and wind turbine for telecommunication equipment in remote areas in Sudan. *Energy Procedia* **2014**, *61*, 80–83. [CrossRef]
11. Olatomiwa, L.J.; Mekhilef, S.; Huda, A.S.N. Optimal sizing of hybrid energy system for a remote telecom tower: A case study in Nigeria. In Proceedings of the 2014 IEEE Conference on Energy Conversion, CENCON 2014, Johor Bahru, Malaysia, 13–14 October 2014. [CrossRef]
12. Sinha, S.; Chandel, S.S. Review of software tools for hybrid renewable energy systems. *Renew. Sustain. Energy Rev.* **2014**, *32*, 192–205. [CrossRef]
13. Khan, T.; Yu, M.; Waseem, M. Review on recent optimization strategies for hybrid renewable energy system with hydrogen technologies: State of the art, trends and future directions. *Int. J. Hydrog. Energy* **2022**, *47*, 25155–25201. [CrossRef]
14. HOMER PRO Help Manual. Available online: [https://www.homerenergy.com/products/pro/docs/3.12/homers\\_calculations.html](https://www.homerenergy.com/products/pro/docs/3.12/homers_calculations.html) (accessed on 15 October 2023).
15. NASA Data Access Viewer. Available online: <https://power.larc.nasa.gov/data-access-viewer/> (accessed on 18 June 2023).

**Disclaimer/Publisher’s Note:** The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.