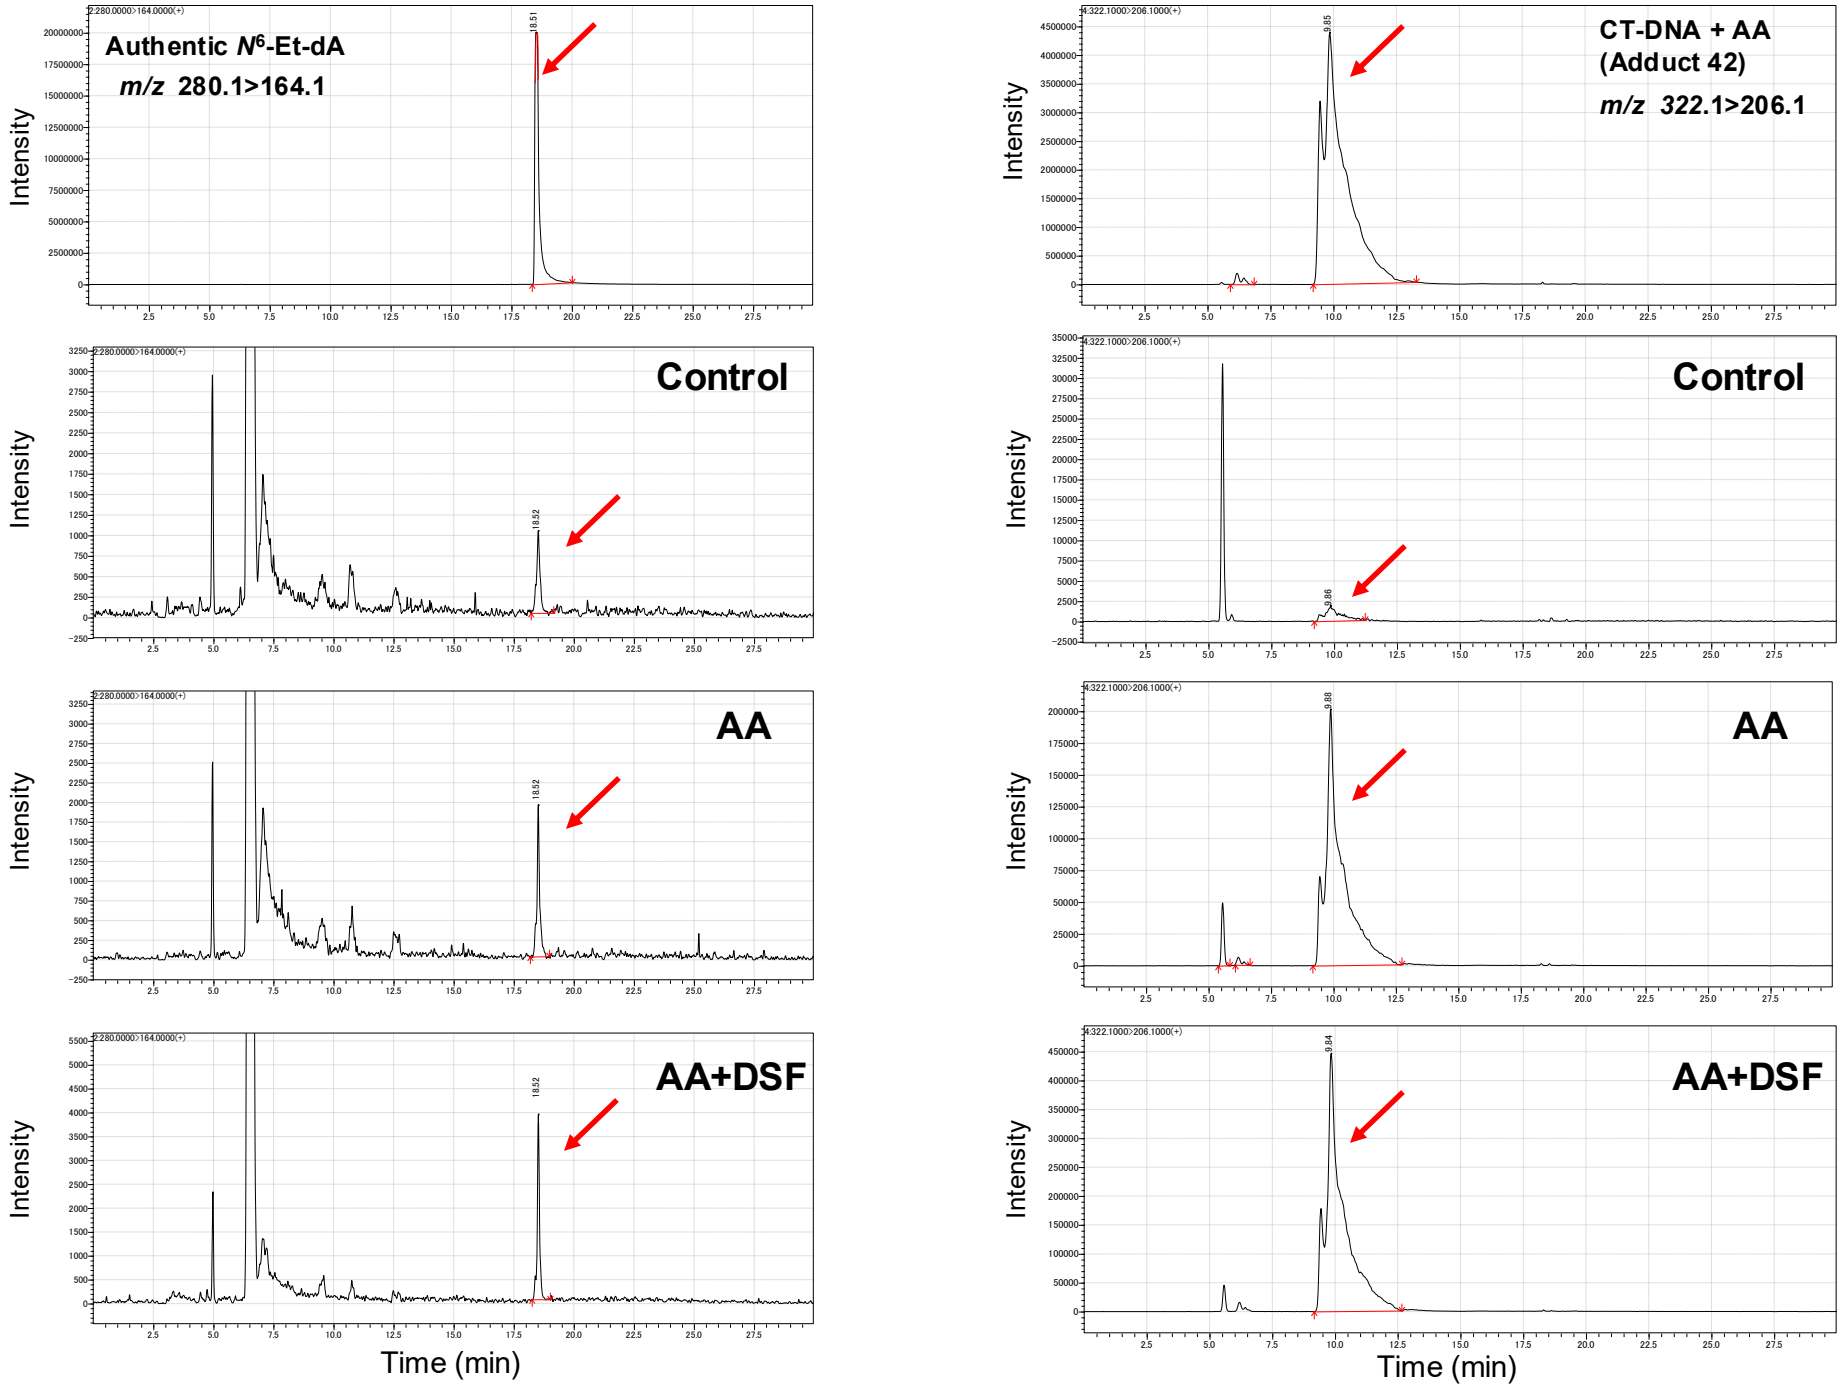
Figure S4


Authentic N6-Et-dA
m/z 280.1>164.1
Control
AA
AA+DSF
CT-DNA + AA
(Adduct 42)
m/z 322.1>206.1
Control
AA
AA+DSF
Intensity
Time (min)