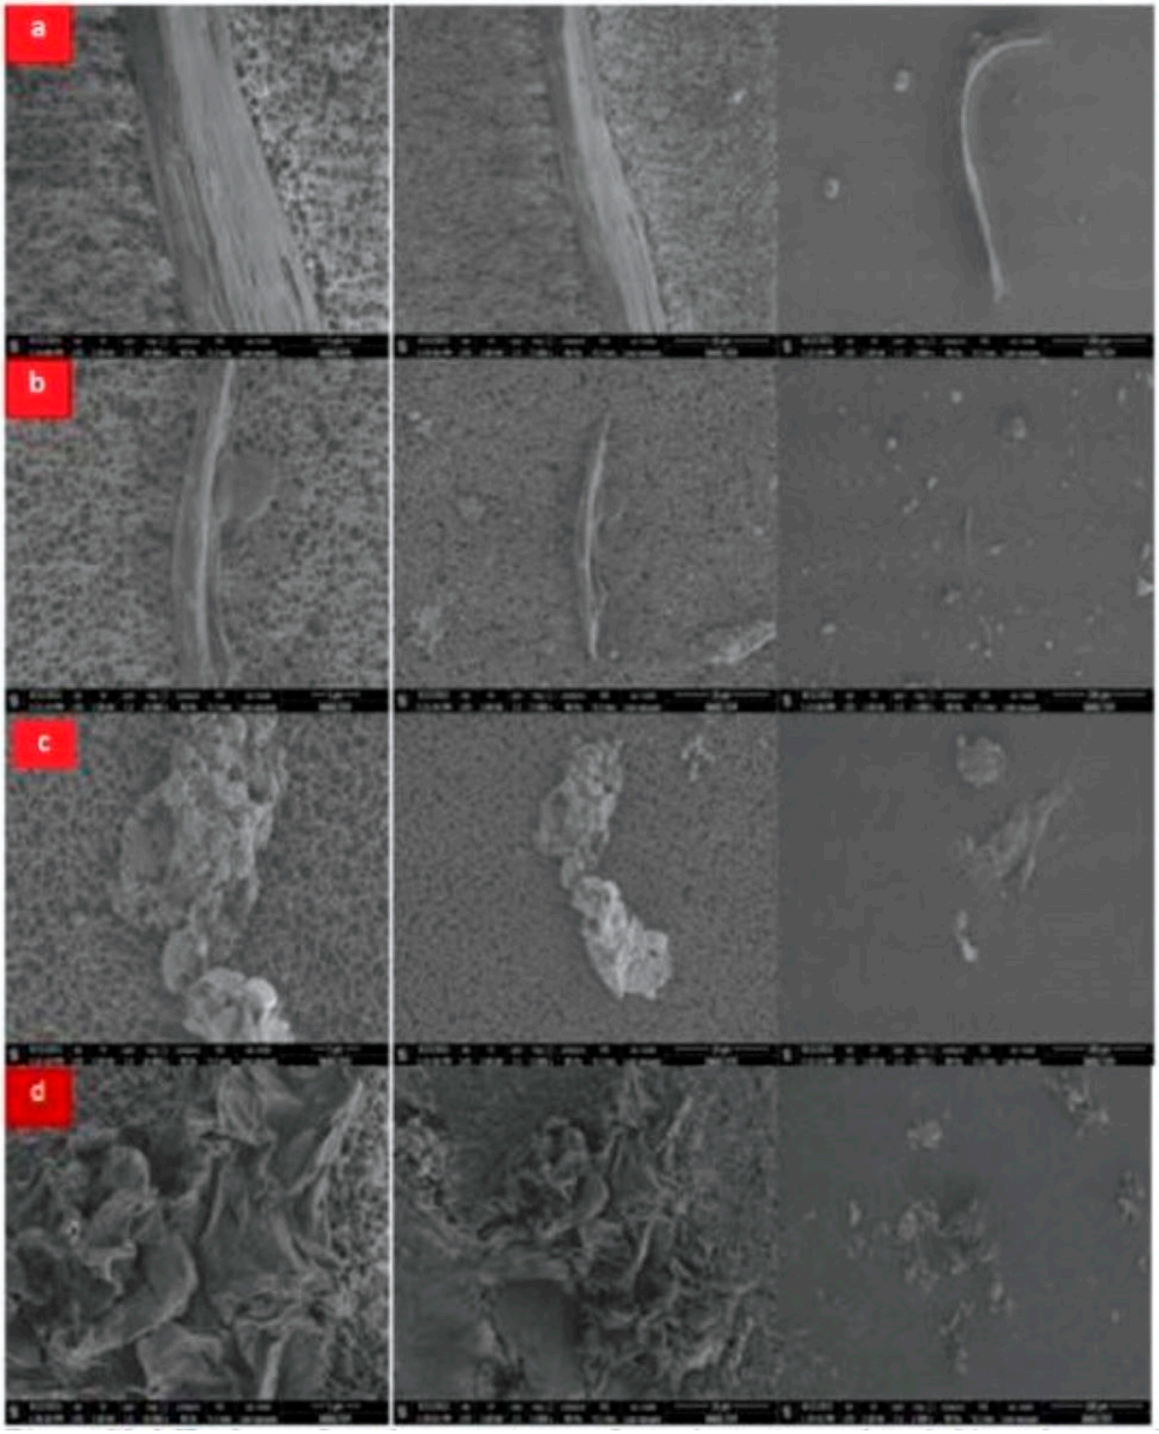


Figure S1. MP release after salt water exposure from; a) new surgical mask, b) aged surgical mask, c) new FFP2 mask, d) aged FFP2 mask.